

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923712

Luminaire Tested: DFN2DIP-TR4F0-060D040US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923712
REPORT IS A COMBINATION OF REPORTS P900374 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D040US940-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7704.4 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

Luminous Intensity Polar Plot

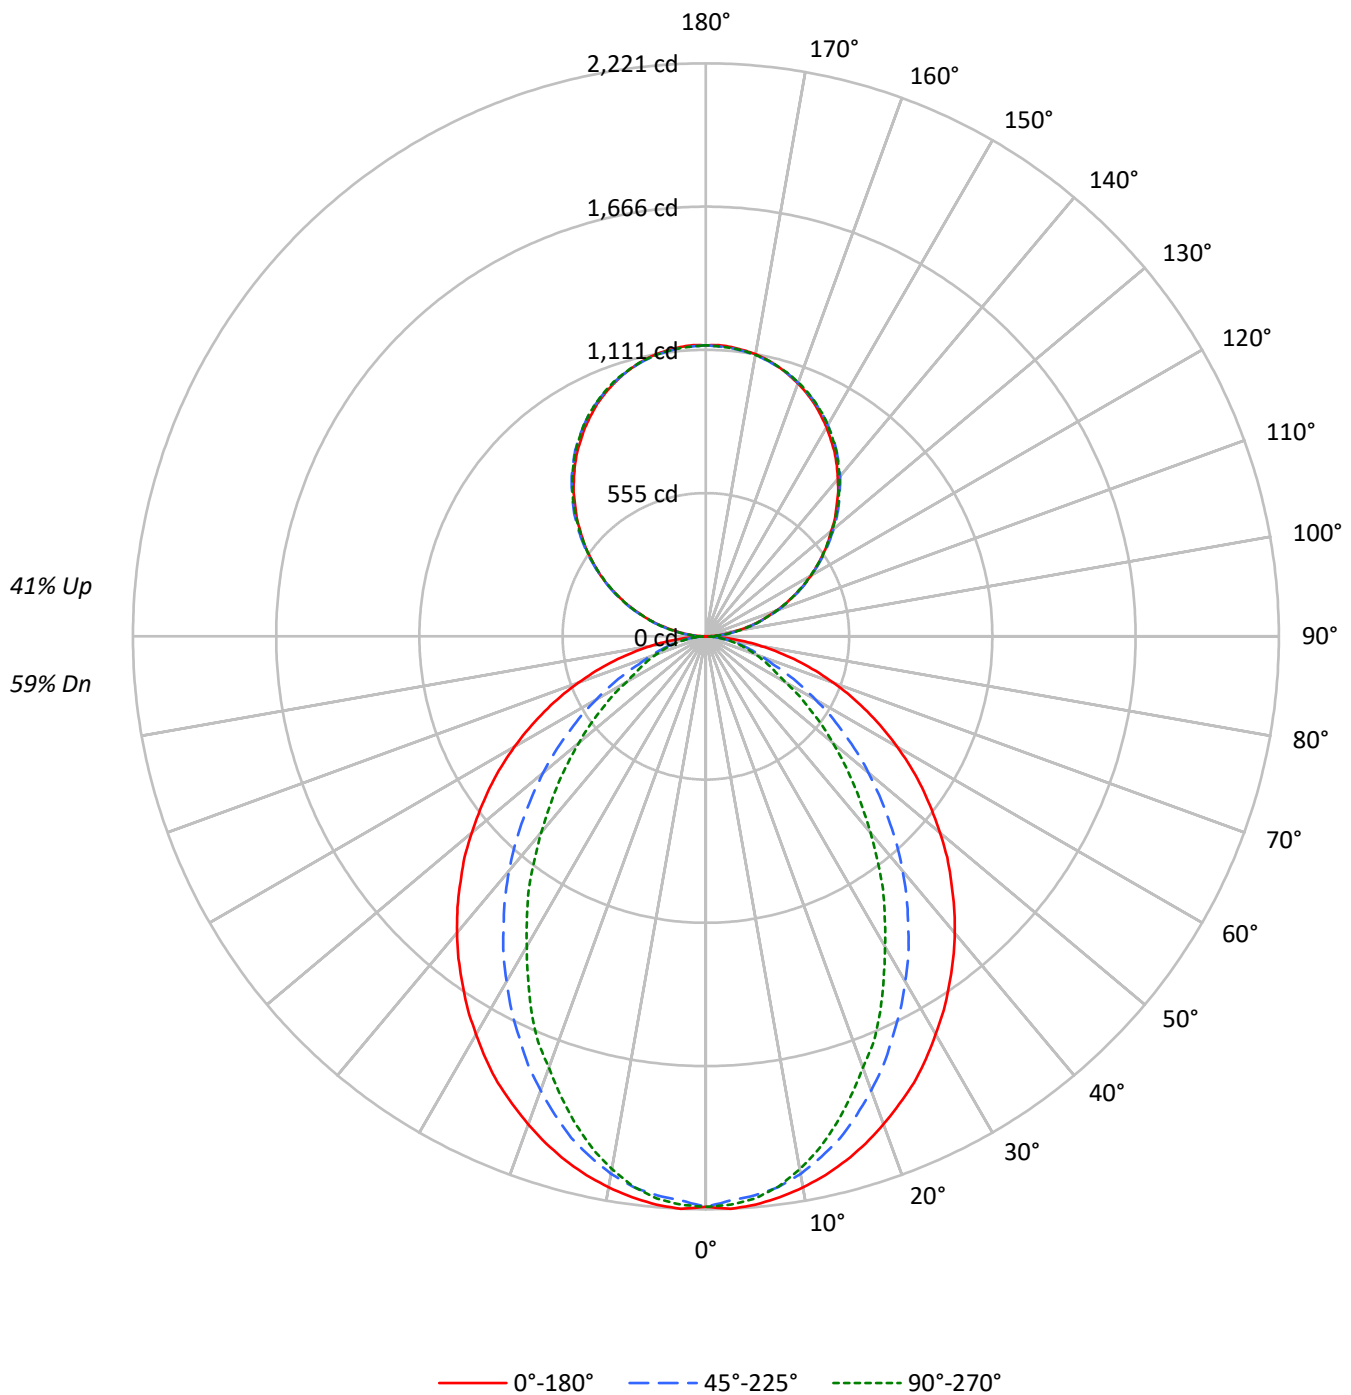

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1757	1757	1757
5°	1760	1729	1740
10°	1742	1695	1683
15°	1718	1639	1596
20°	1686	1562	1488
25°	1654	1475	1384
30°	1610	1386	1253
35°	1568	1291	1137
40°	1524	1192	1005
45°	1474	1083	885
50°	1421	972	767
55°	1367	854	655
60°	1304	730	539
65°	1231	605	485
70°	1143	487	439
75°	1033	430	399
80°	872	360	346
85°	608	240	260

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1474 cd/sqm

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.7
10°-20°	568.9	7.4
20°-30°	798.7	10.4
30°-40°	870.7	11.3
40°-50°	800.3	10.4
50°-60°	628.5	8.2
60°-70°	409.1	5.3
70°-80°	210.6	2.7
80°-90°	57.0	0.7
90°-100°	69.8	0.9
100°-110°	221.8	2.9
110°-120°	379.5	4.9
120°-130°	499.2	6.5
130°-140°	560.3	7.3
140°-150°	549.4	7.1
150°-160°	460.9	6.0
160°-170°	305.7	4.0
170°-180°	106.8	1.4
0°-30°	1574.9	20.4
0°-40°	2445.6	31.7
0°-60°	3874.3	50.3
0°-90°	4550.9	59.1
90°-120°	671.2	8.7
90°-150°	2280.1	29.6
90°-180°	3153.0	40.9
0°-180°	7704.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	12	33	31	32	8
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P923712

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.90	10.82	10.79	11.71	12.85	5.88	6.79	6.76	7.69	8.83
	3H	11.59	12.40	12.48	13.31	14.47	7.07	7.89	7.97	8.80	9.96
	4H	12.20	12.97	13.11	13.88	15.06	7.53	8.30	8.44	9.21	10.39
	6H	12.63	13.33	13.55	14.25	15.44	7.86	8.56	8.78	9.48	10.67
	8H	12.75	13.43	13.68	14.36	15.55	7.95	8.62	8.88	9.56	10.74
	12H	12.82	13.46	13.75	14.39	15.60	8.00	8.64	8.93	9.57	10.78
4H	2H	9.93	10.70	10.85	11.61	12.79	6.48	7.25	7.40	8.17	9.34
	3H	11.77	12.41	12.70	13.35	14.54	7.84	8.48	8.77	9.42	10.61
	4H	12.46	13.05	13.40	13.99	15.20	8.39	8.98	9.33	9.92	11.13
	6H	12.98	13.48	13.93	14.45	15.66	8.82	9.32	9.77	10.28	11.50
	8H	13.16	13.63	14.11	14.58	15.81	8.95	9.42	9.90	10.37	11.60
	12H	13.26	13.68	14.23	14.65	15.89	9.02	9.44	9.99	10.41	11.65
8H	4H	12.44	12.91	13.39	13.86	15.09	8.68	9.15	9.63	10.10	11.33
	6H	13.01	13.39	13.98	14.39	15.62	9.20	9.59	10.18	10.59	11.81
	8H	13.22	13.57	14.21	14.55	15.80	9.39	9.74	10.38	10.72	11.97
	12H	13.37	13.67	14.35	14.65	15.94	9.52	9.82	10.51	10.80	12.09
12H	4H	12.39	12.82	13.36	13.79	15.02	8.69	9.11	9.66	10.08	11.32
	6H	12.98	13.32	13.97	14.31	15.56	9.25	9.59	10.24	10.58	11.83
	8H	13.21	13.51	14.20	14.49	15.78	9.47	9.77	10.46	10.75	12.04

END OF REPORT