

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923716

Luminaire Tested: DFN2DIP-TR4F0-060D050US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923716
REPORT IS A COMBINATION OF REPORTS P900392 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D050US940-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8493.6 lumens
Efficiency: N/A
Efficacy: 93.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

Luminous Intensity Polar Plot

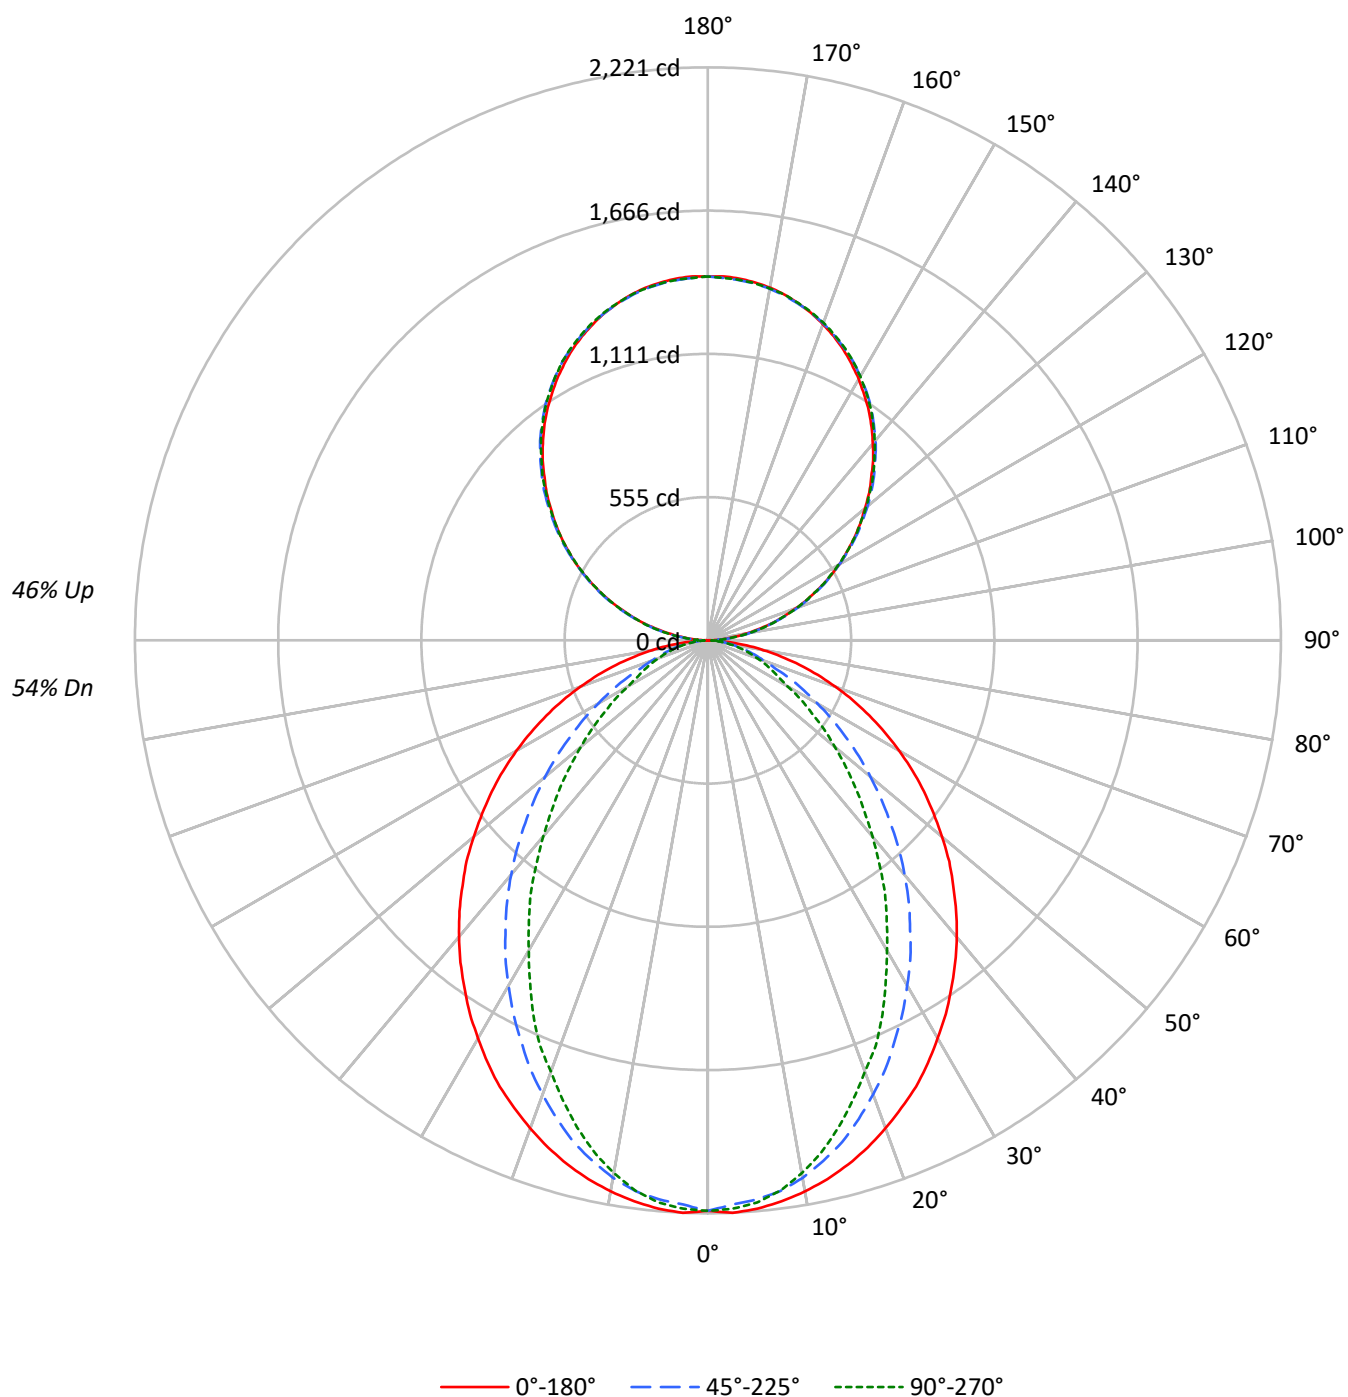

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1757	1757	1757
5°	1760	1729	1740
10°	1742	1695	1683
15°	1718	1639	1596
20°	1686	1562	1488
25°	1654	1475	1384
30°	1610	1386	1253
35°	1568	1291	1137
40°	1524	1192	1005
45°	1474	1083	885
50°	1421	972	767
55°	1367	854	655
60°	1304	730	539
65°	1231	605	485
70°	1143	487	439
75°	1033	430	399
80°	872	360	346
85°	608	240	260

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1474 cd/sqm

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.4
10°-20°	568.9	6.7
20°-30°	798.7	9.4
30°-40°	870.7	10.3
40°-50°	800.3	9.4
50°-60°	628.5	7.4
60°-70°	409.1	4.8
70°-80°	210.6	2.5
80°-90°	57.8	0.7
90°-100°	87.3	1.0
100°-110°	277.2	3.3
110°-120°	474.5	5.6
120°-130°	624.0	7.3
130°-140°	700.4	8.2
140°-150°	686.8	8.1
150°-160°	576.1	6.8
160°-170°	382.1	4.5
170°-180°	133.5	1.6
0°-30°	1574.9	18.5
0°-40°	2445.6	28.8
0°-60°	3874.3	45.6
0°-90°	4551.7	53.6
90°-120°	838.9	9.9
90°-150°	2850.1	33.6
90°-180°	3942.0	46.4
0°-180°	8493.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	15	42	39	40	8
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1

TEST NUMBER: P923716

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.43	10.29	10.36	11.23	12.45	5.40	6.26	6.33	7.21	8.43
	3H	11.11	11.88	12.05	12.83	14.08	6.59	7.36	7.54	8.32	9.56
	4H	11.72	12.44	12.68	13.40	14.66	7.05	7.77	8.00	8.73	9.99
	6H	12.14	12.81	13.11	13.77	15.04	7.37	8.04	8.34	9.00	10.27
	8H	12.27	12.90	13.24	13.88	15.15	7.46	8.10	8.44	9.08	10.34
	12H	12.33	12.93	13.31	13.91	15.20	7.51	8.11	8.49	9.09	10.37
4H	2H	9.45	10.18	10.41	11.14	12.39	6.00	6.73	6.96	7.69	8.94
	3H	11.28	11.89	12.25	12.87	14.14	7.35	7.96	8.33	8.95	10.22
	4H	11.97	12.53	12.96	13.51	14.80	7.90	8.46	8.89	9.44	10.73
	6H	12.49	12.96	13.49	13.97	15.26	8.33	8.80	9.32	9.81	11.10
	8H	12.67	13.11	13.66	14.11	15.41	8.46	8.90	9.45	9.90	11.20
	12H	12.76	13.16	13.78	14.18	15.49	8.52	8.92	9.54	9.94	11.25
8H	4H	11.94	12.39	12.94	13.39	14.69	8.19	8.63	9.18	9.63	10.93
	6H	12.51	12.88	13.53	13.92	15.22	8.71	9.07	9.73	10.11	11.42
	8H	12.73	13.05	13.76	14.08	15.40	8.90	9.22	9.93	10.25	11.57
	12H	12.87	13.15	13.90	14.17	15.54	9.02	9.30	10.05	10.33	11.69
12H	4H	11.90	12.30	12.91	13.31	14.62	8.19	8.59	9.21	9.61	10.92
	6H	12.49	12.81	13.52	13.84	15.16	8.76	9.08	9.78	10.11	11.43
	8H	12.71	12.99	13.74	14.01	15.38	8.97	9.25	10.00	10.27	11.64

END OF REPORT