

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923729

Luminaire Tested: DFN2DIP-TR4F0-060D080US940-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923729
REPORT IS A COMBINATION OF REPORTS P901966 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D080US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11610.1 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLLONL

Luminous Intensity Polar Plot

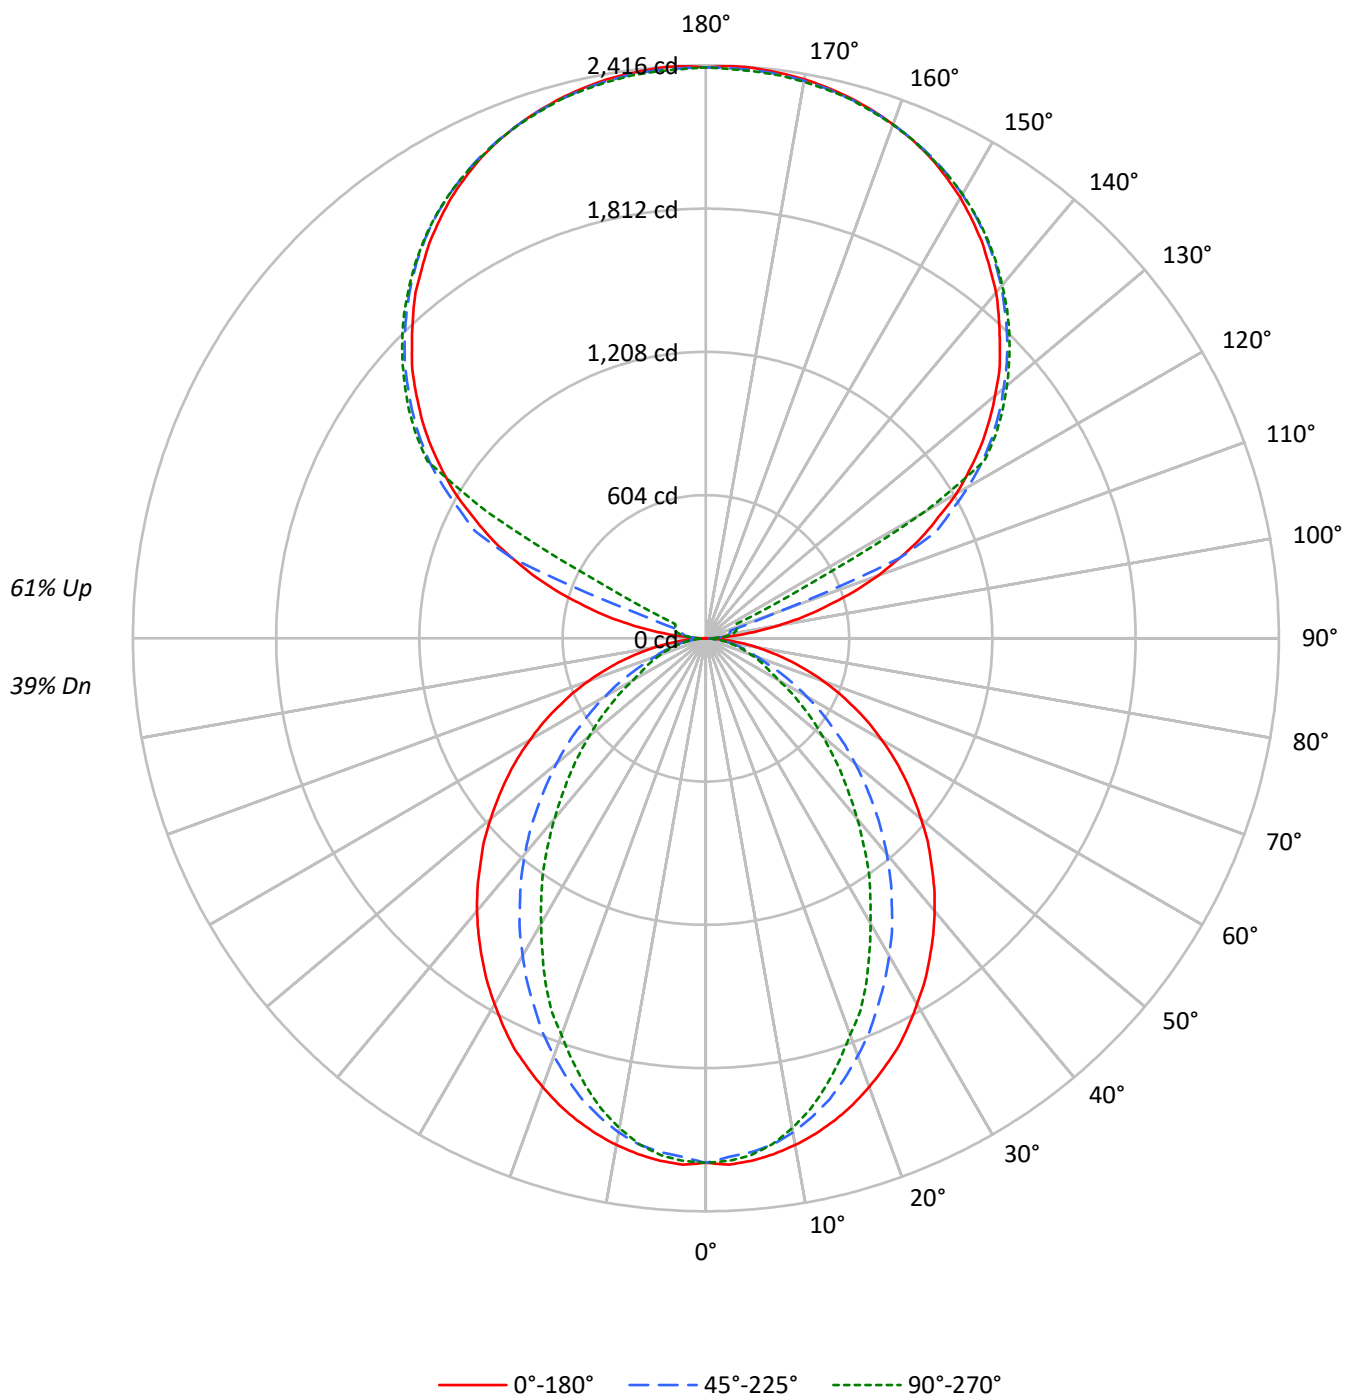

TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1757	1757	1757
5°	1760	1729	1740
10°	1742	1695	1683
15°	1718	1639	1596
20°	1686	1562	1488
25°	1654	1475	1384
30°	1610	1386	1253
35°	1568	1291	1137
40°	1524	1192	1005
45°	1474	1083	885
50°	1421	972	767
55°	1367	854	655
60°	1304	730	539
65°	1231	605	485
70°	1143	487	439
75°	1033	430	399
80°	872	360	346
85°	608	240	260

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1474 cd/sqm

TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	1.8
10°-20°	568.9	4.9
20°-30°	798.7	6.9
30°-40°	870.7	7.5
40°-50°	800.3	6.9
50°-60°	628.5	5.4
60°-70°	409.1	3.5
70°-80°	210.6	1.8
80°-90°	58.0	0.5
90°-100°	79.4	0.7
100°-110°	295.9	2.5
110°-120°	784.9	6.8
120°-130°	1301.8	11.2
130°-140°	1382.8	11.9
140°-150°	1285.1	11.1
150°-160°	1033.2	8.9
160°-170°	665.8	5.7
170°-180°	229.2	2.0
0°-30°	1574.9	13.6
0°-40°	2445.6	21.1
0°-60°	3874.3	33.4
0°-90°	4552.0	39.2
90°-120°	1160.2	10.0
90°-150°	5129.9	44.2
90°-180°	7058.0	60.8
0°-180°	11610.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	2	21	35	44	47	11
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1031	1075	268	143	986
125°	1416	1439	1472	1484	1489	1263
135°	1753	1780	1796	1814	1810	1354
145°	2033	2031	2061	2073	2064	1272
155°	2238	2223	2244	2254	2240	1032
165°	2359	2348	2354	2366	2354	666
175°	2413	2400	2404	2416	2399	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.6	41.8	45.3	47.0
95°	113.2	55.6	67.9	76.8	74.9
97.5°	203.8	61.0	88.7	94.2	95.8
100°	308.4	69.7	99.3	113.2	116.6
102.5°	423.3	419.9	102.8	121.8	127.2
105°	529.6	581.9	106.3	125.4	132.4
107.5°	653.3	696.7	109.9	128.9	135.9
110°	771.9	808.2	305.0	130.7	137.6



TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.3	914.5	885.0	134.0	139.5
115°	1001.7	1031.3	1074.9	268.3	142.9
117.5°	1104.5	1139.2	1169.0	919.7	463.4
120°	1219.5	1245.5	1277.0	1297.9	1062.7
122.5°	1316.9	1344.9	1379.8	1390.2	1392.0
125°	1416.2	1439.0	1472.0	1484.3	1489.4
127.5°	1506.8	1531.2	1557.6	1574.8	1576.5
130°	1592.2	1620.1	1639.2	1658.5	1656.8
132.5°	1679.4	1702.1	1721.2	1736.9	1735.2
135°	1752.6	1780.5	1796.0	1813.6	1810.1
137.5°	1829.2	1850.0	1867.6	1885.0	1879.8
140°	1904.0	1918.1	1937.2	1952.8	1944.1
142.5°	1966.9	1979.1	2001.6	2015.5	2006.8
145°	2033.1	2031.2	2060.8	2073.0	2064.3
147.5°	2090.4	2085.3	2114.8	2123.5	2116.7
150°	2146.3	2134.0	2162.0	2172.3	2163.6
152.5°	2193.3	2179.3	2205.4	2216.0	2203.8
155°	2238.5	2223.0	2243.9	2254.2	2240.4
157.5°	2275.1	2261.3	2277.0	2289.2	2275.1
160°	2306.6	2296.1	2306.6	2316.9	2304.7
162.5°	2334.3	2324.0	2332.6	2344.8	2329.1
165°	2358.8	2348.4	2353.6	2365.7	2353.6
167.5°	2377.9	2367.4	2372.8	2385.0	2369.3
170°	2393.7	2383.1	2386.7	2398.9	2383.1
172.5°	2404.1	2393.7	2397.2	2409.4	2393.7
175°	2412.7	2400.5	2404.1	2416.2	2398.9
177.5°	2416.2	2404.1	2405.8	2418.1	2402.4
180°	2407.5	2407.5	2407.5	2407.5	2407.5

TEST NUMBER: P923729

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.00	8.75	9.05	9.80	11.22	3.97	4.72	5.03	5.77	7.19
	3H	9.67	10.34	10.73	11.40	12.84	5.16	5.83	6.22	6.89	8.33
	4H	10.28	10.91	11.35	11.97	13.42	5.61	6.24	6.68	7.30	8.75
	6H	10.69	11.28	11.77	12.34	13.80	5.92	6.51	7.00	7.57	9.03
	8H	10.82	11.37	11.90	12.45	13.91	6.01	6.57	7.10	7.65	9.10
	12H	10.88	11.40	11.97	12.48	13.95	6.05	6.58	7.14	7.65	9.13
4H	2H	8.01	8.64	9.09	9.71	11.15	4.56	5.19	5.64	6.26	7.70
	3H	9.83	10.36	10.92	11.45	12.91	5.90	6.43	6.99	7.52	8.98
	4H	10.52	11.00	11.61	12.08	13.56	6.45	6.93	7.54	8.01	9.49
	6H	11.03	11.44	12.13	12.55	14.02	6.87	7.28	7.96	8.38	9.86
	8H	11.20	11.59	12.30	12.69	14.17	6.99	7.38	8.09	8.47	9.96
	12H	11.29	11.64	12.41	12.75	14.25	7.05	7.40	8.17	8.51	10.01
8H	4H	10.48	10.87	11.58	11.96	13.45	6.72	7.11	7.82	8.21	9.69
	6H	11.04	11.36	12.16	12.50	13.99	7.24	7.56	8.36	8.70	10.18
	8H	11.26	11.54	12.39	12.66	14.16	7.43	7.71	8.56	8.83	10.33
	12H	11.40	11.64	12.53	12.76	14.30	7.55	7.79	8.68	8.91	10.45
12H	4H	10.43	10.78	11.55	11.89	13.38	6.72	7.07	7.84	8.18	9.68
	6H	11.02	11.30	12.15	12.42	13.92	7.29	7.57	8.42	8.69	10.19
	8H	11.24	11.48	12.37	12.60	14.14	7.50	7.74	8.63	8.86	10.40

END OF REPORT