

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923741

Luminaire Tested: DFN2DIP-TR4F0-060D110US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923741
REPORT IS A COMBINATION OF REPORTS P902020 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D110US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14258.4 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 138.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLLONL

Luminous Intensity Polar Plot

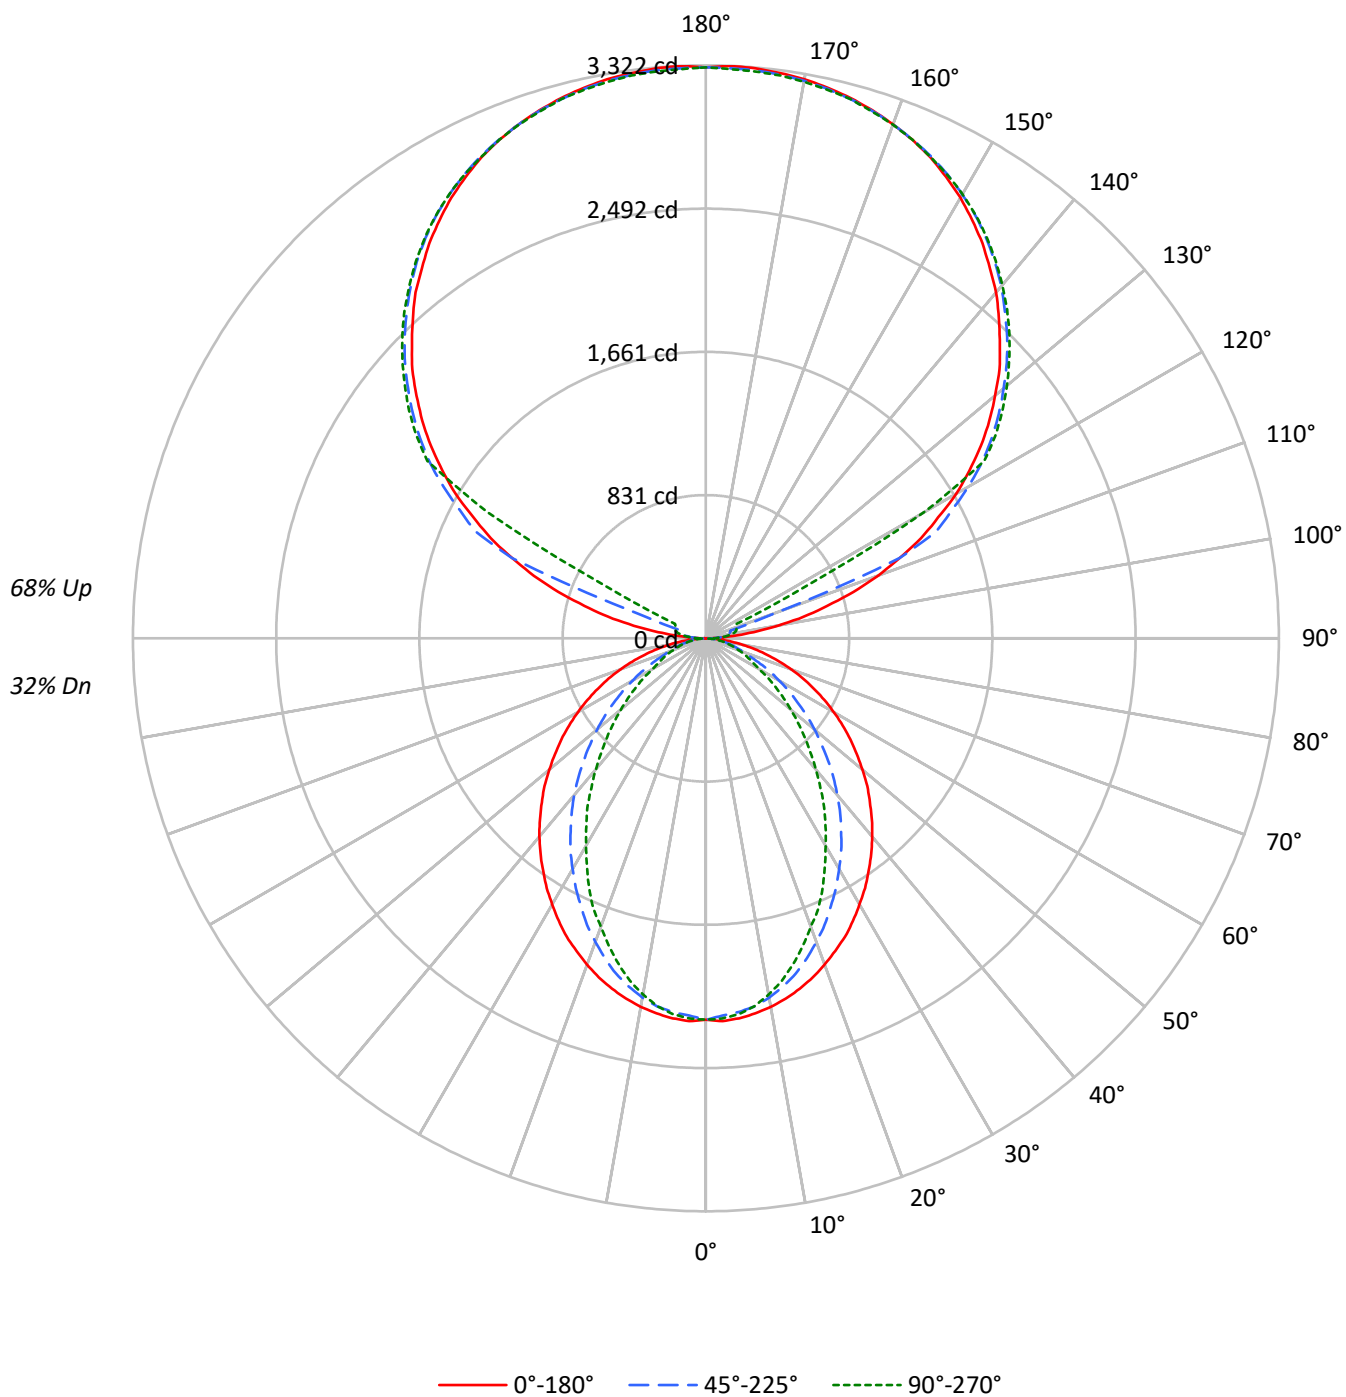

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	54	51	44	42	40	31	30	29
3	78	70	63	57	70	63	57	52	50	46	43	39	36	34	28	26	25
4	72	62	54	48	64	56	49	44	45	40	37	35	32	29	25	23	22
5	66	55	47	42	59	50	43	38	40	35	32	31	28	25	23	21	19
6	61	49	42	36	55	45	38	33	36	31	28	28	25	22	21	19	17
7	56	44	37	32	51	41	34	29	33	28	24	26	22	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	15	14
9	48	37	30	25	44	34	27	23	27	23	19	22	18	16	16	14	12
10	45	34	27	22	41	31	25	21	25	21	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1757	1757	1757
5°	1760	1729	1740
10°	1742	1695	1683
15°	1718	1639	1596
20°	1686	1562	1488
25°	1654	1475	1384
30°	1610	1386	1253
35°	1568	1291	1137
40°	1524	1192	1005
45°	1474	1083	885
50°	1421	972	767
55°	1367	854	655
60°	1304	730	539
65°	1231	605	485
70°	1143	487	439
75°	1033	430	399
80°	872	360	346
85°	608	240	260

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1758 cd/sqm

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	1.5
10°-20°	568.9	4.0
20°-30°	798.7	5.6
30°-40°	870.7	6.1
40°-50°	800.3	5.6
50°-60°	628.5	4.4
60°-70°	409.1	2.9
70°-80°	210.6	1.5
80°-90°	59.6	0.4
90°-100°	109.2	0.8
100°-110°	406.9	2.9
110°-120°	1079.2	7.6
120°-130°	1789.9	12.6
130°-140°	1901.3	13.3
140°-150°	1767.1	12.4
150°-160°	1420.7	10.0
160°-170°	915.4	6.4
170°-180°	315.1	2.2
0°-30°	1574.9	11.0
0°-40°	2445.6	17.2
0°-60°	3874.3	27.2
0°-90°	4553.6	31.9
90°-120°	1595.3	11.2
90°-150°	7053.7	49.5
90°-180°	9705.0	68.1
0°-180°	14258.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	2	29	48	60	65	13
95°	156	76	93	106	103	184
105°	728	800	146	172	182	778
115°	1377	1418	1478	369	196	1356
125°	1947	1979	2024	2041	2048	1737
135°	2410	2448	2470	2494	2489	1862
145°	2796	2793	2834	2850	2838	1748
155°	3078	3057	3085	3100	3080	1418
165°	3243	3229	3236	3253	3236	916
175°	3317	3301	3306	3322	3298	316
180°	3310	3310	3310	3310	3310	

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	2.3	28.7	47.8	60.0	64.6
92.5°	60.0	50.4	57.4	62.3	64.6
95°	155.6	76.5	93.3	105.5	103.0
97.5°	280.2	83.9	122.0	129.4	131.7
100°	424.1	95.9	136.5	155.6	160.4
102.5°	581.9	577.4	141.3	167.6	175.0
105°	728.2	800.1	146.2	172.4	182.1
107.5°	898.3	958.0	151.1	177.2	186.9
110°	1061.2	1111.3	419.3	179.8	189.1

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1214.6	1257.5	1216.8	184.3	191.7
115°	1377.2	1417.9	1478.0	368.9	196.5
117.5°	1518.7	1566.5	1607.4	1264.6	637.1
120°	1676.8	1712.6	1755.9	1784.6	1461.2
122.5°	1810.8	1849.1	1897.2	1911.5	1914.1
125°	1947.3	1978.6	2024.1	2040.9	2048.0
127.5°	2071.9	2105.4	2141.5	2165.4	2167.7
130°	2189.3	2227.8	2253.9	2280.4	2278.1
132.5°	2309.1	2340.4	2366.6	2388.2	2385.9
135°	2409.8	2448.2	2469.5	2493.8	2488.9
137.5°	2515.1	2543.8	2567.9	2591.8	2584.7
140°	2618.1	2637.3	2663.5	2685.1	2673.2
142.5°	2704.5	2721.2	2752.3	2771.3	2759.4
145°	2795.5	2792.9	2833.6	2850.4	2838.5
147.5°	2874.3	2867.2	2907.9	2919.8	2910.5
150°	2951.1	2934.4	2972.7	2987.0	2975.0
152.5°	3015.7	2996.6	3032.4	3047.0	3030.2
155°	3078.0	3056.6	3085.3	3099.6	3080.5
157.5°	3128.3	3109.2	3130.9	3147.6	3128.3
160°	3171.5	3157.0	3171.5	3185.7	3169.0
162.5°	3209.6	3195.4	3207.4	3224.2	3202.6
165°	3243.2	3229.0	3236.1	3252.9	3236.1
167.5°	3269.6	3255.2	3262.6	3279.4	3257.8
170°	3291.3	3276.8	3281.6	3298.4	3276.8
172.5°	3305.5	3291.3	3296.1	3312.9	3291.3
175°	3317.4	3300.7	3305.5	3322.3	3298.4
177.5°	3322.3	3305.5	3308.1	3324.8	3303.3
180°	3310.4	3310.4	3310.4	3310.4	3310.4

TEST NUMBER: P923741

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.13	7.83	8.23	8.92	10.43	3.10	3.80	4.20	4.90	6.41
	3H	8.79	9.42	9.91	10.53	12.05	4.28	4.91	5.39	6.01	7.54
	4H	9.40	9.99	10.52	11.10	12.63	4.72	5.32	5.85	6.43	7.96
	6H	9.81	10.36	10.94	11.47	13.01	5.04	5.59	6.17	6.70	8.24
	8H	9.93	10.45	11.07	11.58	13.11	5.13	5.65	6.26	6.77	8.31
	12H	9.99	10.48	11.13	11.60	13.16	5.17	5.66	6.30	6.78	8.34
4H	2H	7.13	7.72	8.26	8.83	10.36	3.68	4.27	4.81	5.38	6.91
	3H	8.95	9.44	10.08	10.57	12.12	5.02	5.51	6.15	6.65	8.19
	4H	9.63	10.09	10.77	11.21	12.77	5.56	6.02	6.70	7.14	8.70
	6H	10.14	10.53	11.29	11.67	13.23	5.98	6.37	7.12	7.51	9.07
	8H	10.31	10.68	11.46	11.81	13.39	6.10	6.47	7.25	7.60	9.17
	12H	10.40	10.73	11.56	11.88	13.46	6.16	6.49	7.32	7.64	9.22
8H	4H	9.59	9.95	10.74	11.09	12.66	5.83	6.20	6.98	7.33	8.90
	6H	10.15	10.45	11.32	11.63	13.20	6.35	6.65	7.51	7.83	9.39
	8H	10.37	10.63	11.54	11.79	13.38	6.54	6.80	7.71	7.96	9.55
	12H	10.50	10.73	11.67	11.89	13.51	6.65	6.88	7.83	8.04	9.66
12H	4H	9.54	9.87	10.70	11.01	12.59	5.83	6.16	6.99	7.31	8.89
	6H	10.13	10.39	11.30	11.55	13.14	6.40	6.66	7.57	7.82	9.40
	8H	10.34	10.57	11.52	11.73	13.35	6.60	6.83	7.78	7.99	9.61

END OF REPORT