

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923742

Luminaire Tested: DFN2DIP-TR4F0-060D120US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923742
REPORT IS A COMBINATION OF REPORTS P900517 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D120US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 14766.7 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 144.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923742
CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

Luminous Intensity Polar Plot

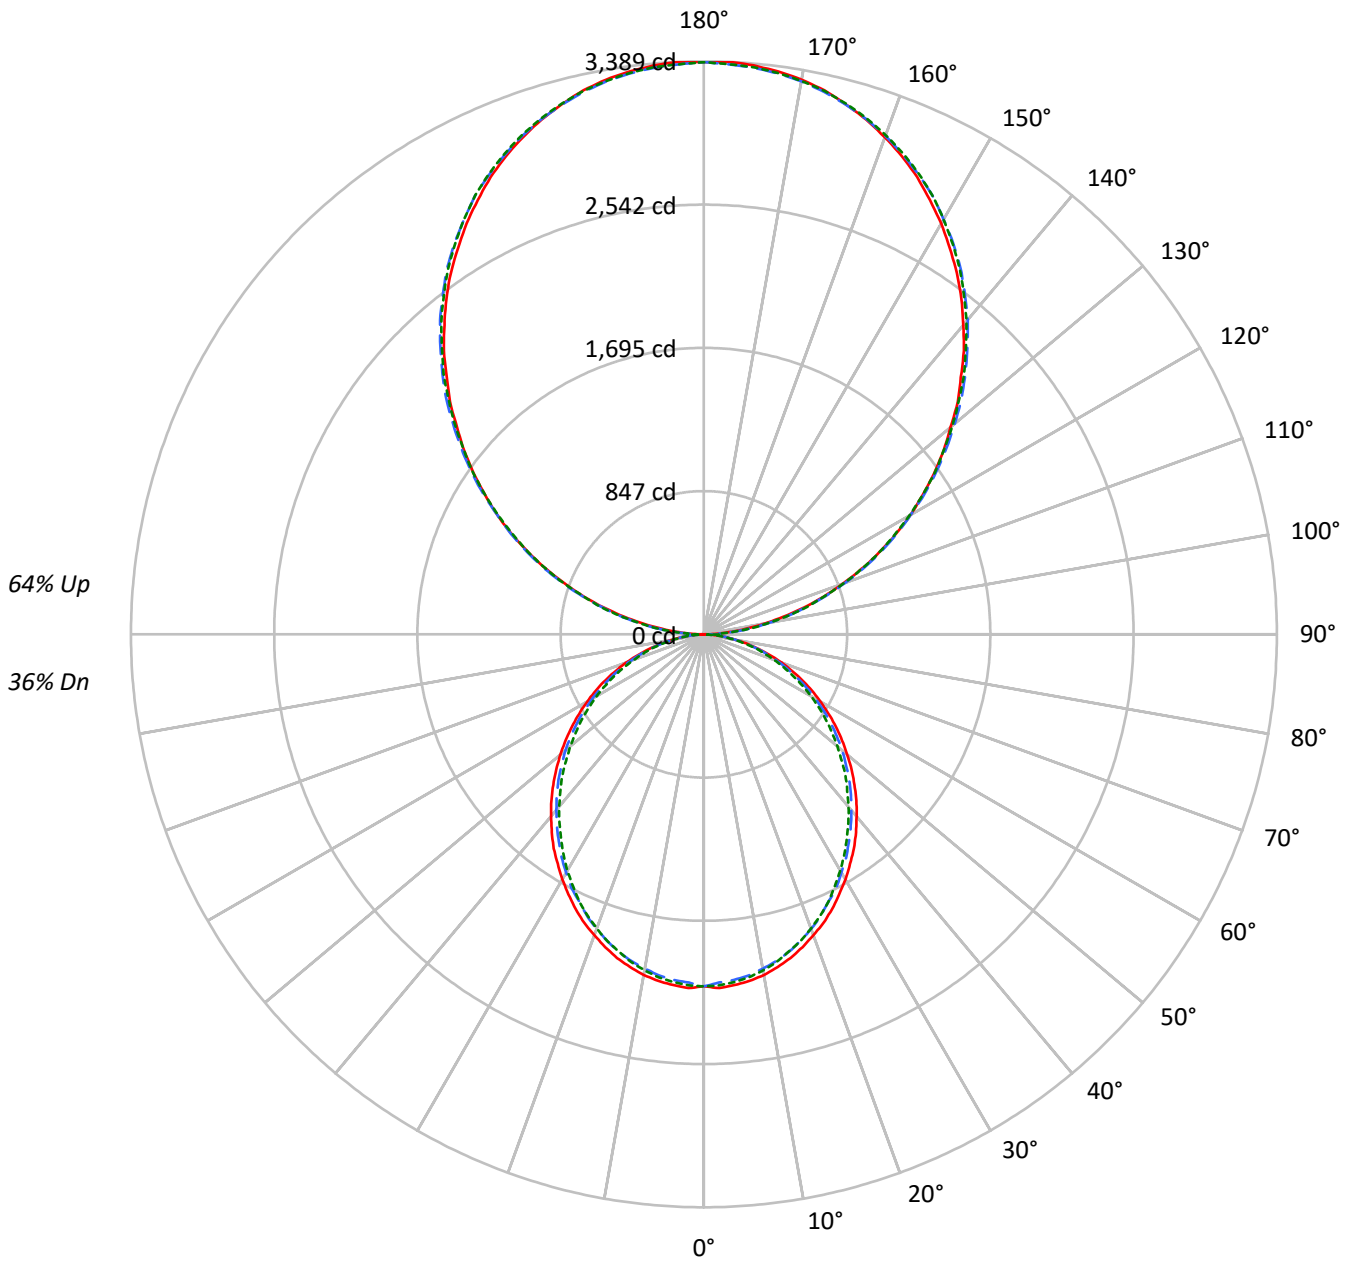

— 0°-180° - - 45°-225° - - - 90°-270°



TEST NUMBER: P923742

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43	36				36
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36	30				30
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31	25				25
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26	21				21
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22	18				18
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20	16				16
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17	14				14
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15	12				12
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14	11				11
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12	10				10
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11	9				9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1654	1654	1654
5°	1657	1631	1642
10°	1643	1609	1619
15°	1619	1582	1585
20°	1586	1545	1549
25°	1554	1501	1508
30°	1513	1460	1456
35°	1475	1412	1400
40°	1427	1363	1348
45°	1380	1314	1294
50°	1328	1263	1231
55°	1274	1204	1174
60°	1213	1133	1108
65°	1146	1060	1031
70°	1061	971	947
75°	943	865	870
80°	801	729	723
85°	579	494	479

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 2637 cd/sqm



TEST NUMBER: P923742

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.3
10°-20°	551.3	3.7
20°-30°	810.2	5.5
30°-40°	941.0	6.4
40°-50°	939.8	6.4
50°-60°	819.5	5.5
60°-70°	605.8	4.1
70°-80°	342.7	2.3
80°-90°	100.1	0.7
90°-100°	209.4	1.4
100°-110°	665.4	4.5
110°-120°	1138.7	7.7
120°-130°	1497.5	10.1
130°-140°	1680.9	11.4
140°-150°	1648.3	11.2
150°-160°	1382.7	9.4
160°-170°	917.0	6.2
170°-180°	320.5	2.2
0°-30°	1557.4	10.5
0°-40°	2498.4	16.9
0°-60°	4257.8	28.8
0°-90°	5306.4	35.9
90°-120°	2013.4	13.6
90°-150°	6840.1	46.3
90°-180°	9460.0	64.1
0°-180°	14766.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	3	37	100	94	97	14
95°	149	178	183	183	178	166
105°	614	622	628	634	634	648
115°	1143	1159	1154	1151	1143	1130
125°	1662	1688	1679	1670	1667	1485
135°	2150	2181	2188	2184	2176	1662
145°	2610	2630	2646	2650	2638	1631
155°	2984	2992	3002	3016	3007	1374
165°	3246	3243	3243	3264	3250	916
175°	3378	3370	3364	3384	3367	321
180°	3384	3384	3384	3384	3384	



TEST NUMBER: P923742

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	3.0	36.7	100.0	93.9	96.9
92.5°	63.2	85.7	88.7	91.8	91.8
95°	148.9	177.5	182.6	182.6	177.5
97.5°	247.9	274.5	285.7	285.7	285.7
100°	362.2	385.7	393.8	393.8	390.7
102.5°	482.6	499.9	511.1	514.2	511.1
105°	614.2	622.3	628.5	633.6	633.6
107.5°	744.8	757.1	757.1	759.0	744.8
110°	871.3	887.6	887.6	887.6	879.5



TEST NUMBER: P923742

CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1008.0	1025.4	1022.3	1014.1	1008.0
115°	1142.6	1159.0	1153.9	1150.8	1142.6
117.5°	1276.3	1298.8	1284.5	1276.3	1268.2
120°	1411.0	1433.4	1411.0	1411.0	1401.9
122.5°	1533.5	1562.0	1547.7	1539.5	1533.5
125°	1662.0	1687.5	1679.4	1670.2	1667.1
127.5°	1787.5	1819.1	1807.9	1795.6	1787.5
130°	1904.8	1941.5	1936.4	1930.3	1919.0
132.5°	2036.4	2065.0	2067.0	2052.7	2044.6
135°	2149.6	2181.3	2187.5	2184.3	2176.2
137.5°	2276.2	2301.7	2306.8	2304.7	2292.5
140°	2387.4	2412.9	2427.1	2427.1	2415.9
142.5°	2501.7	2527.2	2535.3	2538.3	2527.2
145°	2609.8	2630.2	2646.5	2649.6	2638.4
147.5°	2706.7	2732.2	2744.5	2749.6	2738.4
150°	2806.7	2824.0	2835.3	2844.5	2835.3
152.5°	2895.5	2912.8	2927.1	2938.4	2927.1
155°	2984.2	2992.4	3001.6	3015.9	3006.7
157.5°	3060.8	3066.9	3071.9	3092.4	3078.1
160°	3129.1	3135.3	3138.3	3155.7	3143.4
162.5°	3192.3	3192.3	3195.4	3214.8	3200.5
165°	3246.4	3243.4	3243.4	3263.7	3249.5
167.5°	3295.4	3286.2	3286.2	3306.6	3292.4
170°	3332.1	3323.9	3320.9	3341.3	3323.9
172.5°	3357.6	3349.4	3346.4	3366.8	3349.4
175°	3378.1	3369.9	3363.8	3384.1	3366.8
177.5°	3389.3	3381.1	3374.9	3392.3	3374.9
180°	3384.1	3384.1	3384.1	3384.1	3384.1



TEST NUMBER: P923742
 CATALOG NUMBER: DFN2DIP-TR4F0-060D120US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.55	8.30	8.62	9.37	10.83	7.12	7.87	8.19	8.94	10.40
	3H	9.20	9.87	10.28	10.95	12.43	8.73	9.40	9.81	10.48	11.96
	4H	9.78	10.42	10.87	11.50	12.98	9.31	9.95	10.40	11.03	12.51
	6H	10.18	10.76	11.28	11.85	13.34	9.70	10.29	10.80	11.37	12.87
	8H	10.28	10.84	11.38	11.94	13.43	9.80	10.36	10.91	11.46	12.95
	12H	10.32	10.85	11.43	11.95	13.46	9.84	10.37	10.95	11.47	12.98
4H	2H	8.00	8.63	9.10	9.72	11.20	7.65	8.29	8.75	9.37	10.85
	3H	9.85	10.38	10.96	11.49	12.99	9.46	9.99	10.56	11.10	12.60
	4H	10.56	11.05	11.67	12.15	13.67	10.16	10.65	11.27	11.74	13.26
	6H	11.07	11.49	12.19	12.61	14.12	10.66	11.08	11.78	12.20	13.71
	8H	11.22	11.61	12.33	12.72	14.25	10.81	11.20	11.92	12.31	13.84
	12H	11.29	11.64	12.42	12.77	14.30	10.86	11.22	12.00	12.34	13.87
8H	4H	10.75	11.14	11.87	12.25	13.78	10.39	10.78	11.51	11.89	13.42
	6H	11.38	11.70	12.51	12.85	14.38	11.01	11.34	12.15	12.49	14.01
	8H	11.60	11.88	12.74	13.01	14.56	11.23	11.51	12.37	12.65	14.19
	12H	11.72	11.97	12.87	13.10	14.68	11.34	11.59	12.49	12.72	14.30
12H	4H	10.73	11.08	11.86	12.21	13.74	10.38	10.73	11.51	11.86	13.39
	6H	11.41	11.69	12.55	12.82	14.37	11.05	11.34	12.20	12.47	14.01
	8H	11.64	11.89	12.79	13.02	14.60	11.29	11.53	12.43	12.67	14.24