

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923793

Luminaire Tested: DFN2DIP-TR4F0-080D060US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923793
REPORT IS A COMBINATION OF REPORTS P901934 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D060US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11360.4 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 119.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLLONL

Luminous Intensity Polar Plot

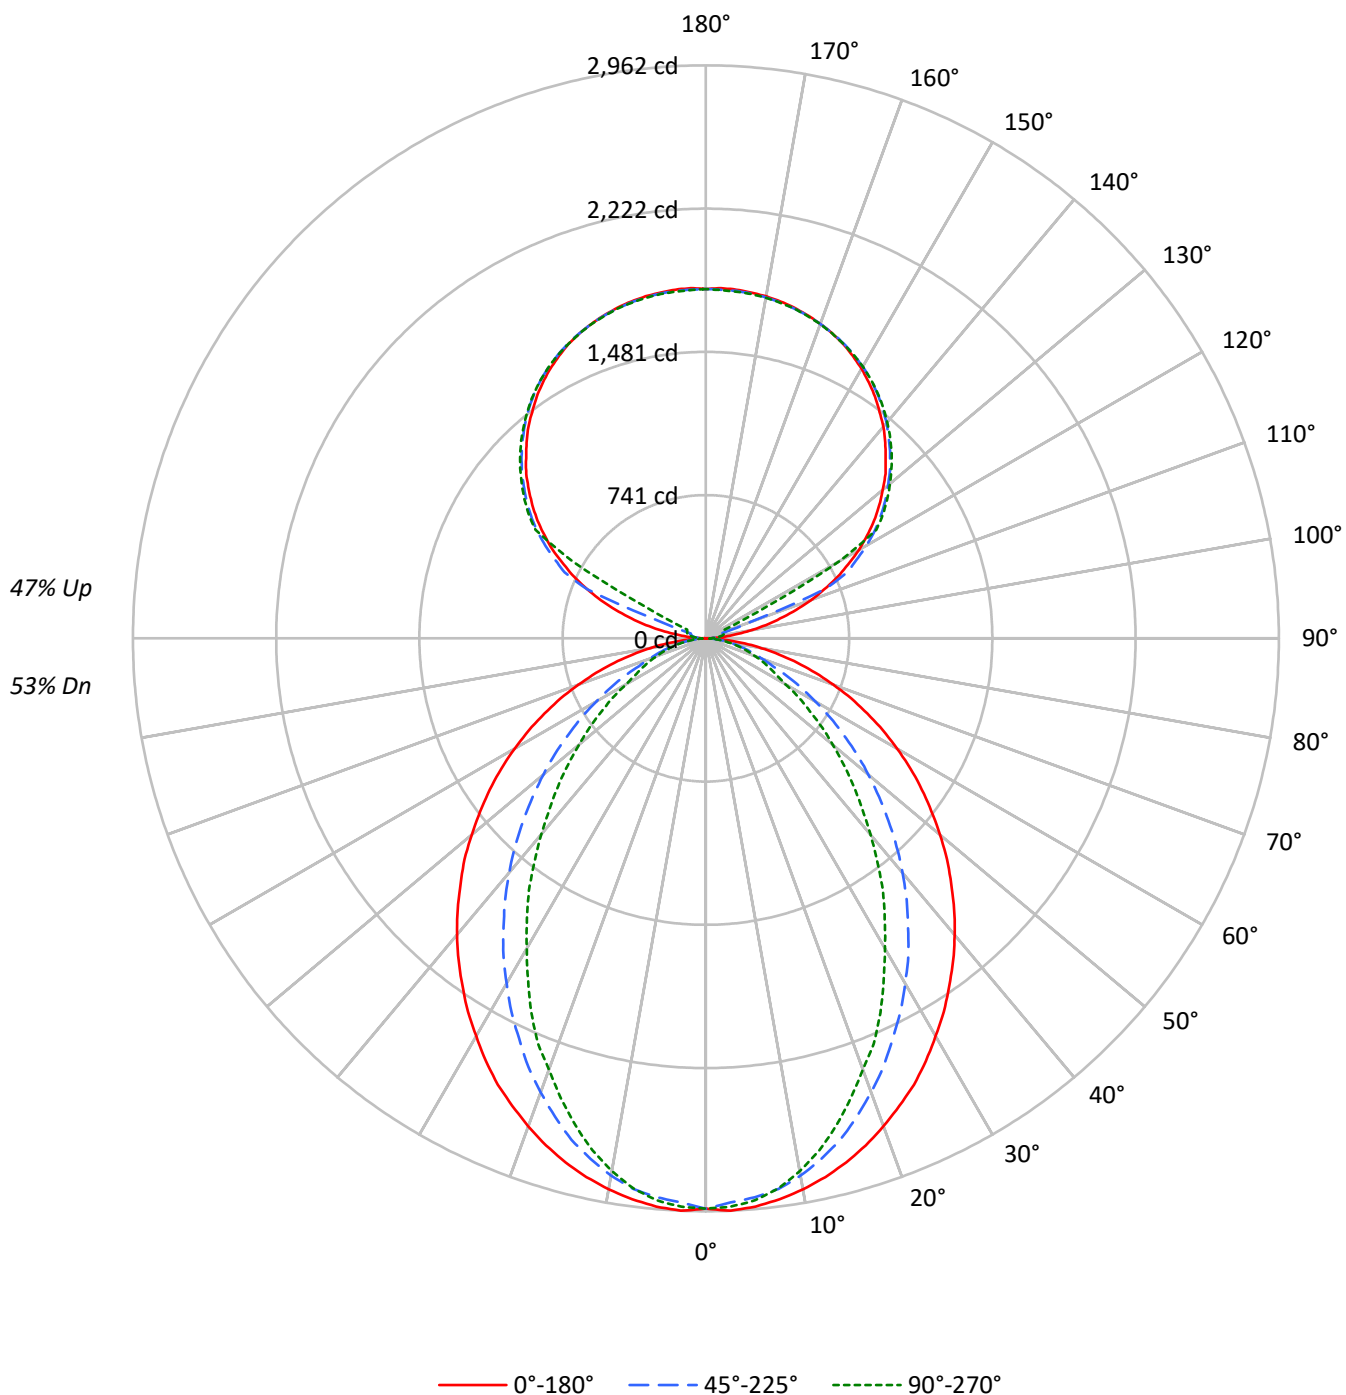

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	83	78	73	84	78	73	68	67	63	60	57	54	52	47	45	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	42	40	38
4	76	66	58	52	70	61	55	49	53	48	44	45	42	38	38	35	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	28	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	26	29	26	23
8	56	44	36	31	52	41	34	29	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	26	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2342	2342	2342
5°	2346	2305	2320
10°	2323	2260	2244
15°	2291	2185	2127
20°	2249	2082	1984
25°	2205	1967	1846
30°	2147	1848	1670
35°	2090	1721	1516
40°	2032	1589	1340
45°	1965	1443	1180
50°	1895	1296	1023
55°	1822	1138	873
60°	1738	974	718
65°	1642	806	646
70°	1524	650	585
75°	1377	573	532
80°	1163	481	461
85°	811	320	346

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1965 cd/sqm

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.3	2.4
10°-20°	758.6	6.7
20°-30°	1065.0	9.4
30°-40°	1160.9	10.2
40°-50°	1067.0	9.4
50°-60°	838.0	7.4
60°-70°	545.4	4.8
70°-80°	280.8	2.5
80°-90°	74.8	0.7
90°-100°	59.5	0.5
100°-110°	222.0	2.0
110°-120°	588.7	5.2
120°-130°	976.3	8.6
130°-140°	1037.1	9.1
140°-150°	963.9	8.5
150°-160°	774.9	6.8
160°-170°	499.3	4.4
170°-180°	171.9	1.5
0°-30°	2099.9	18.5
0°-40°	3260.8	28.7
0°-60°	5165.8	45.5
0°-90°	6066.8	53.4
90°-120°	870.2	7.7
90°-150°	3847.4	33.9
90°-180°	5294.0	46.6
0°-180°	11360.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2948	2948	2948	2948	2948	
5°	2948	2935	2900	2924	2916	280
15°	2804	2775	2684	2634	2607	790
25°	2546	2460	2284	2175	2134	1171
35°	2193	2057	1822	1654	1595	1373
45°	1793	1614	1334	1144	1081	1385
55°	1363	1155	867	707	656	1218
65°	921	704	464	374	365	913
75°	491	304	214	195	192	519
85°	115	59	51	51	51	132
90°	1	16	26	33	35	11
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2948.4	2948.4	2948.4	2948.4	2948.4
2.5°	2961.6	2948.4	2918.9	2945.8	2940.4
5°	2948.4	2935.1	2900.2	2924.3	2916.3
7.5°	2924.3	2908.4	2871.0	2881.6	2868.2
10°	2892.3	2873.6	2820.4	2812.2	2796.3
12.5°	2852.4	2828.3	2756.1	2740.2	2710.8
15°	2804.3	2774.8	2684.2	2633.6	2606.9
17.5°	2748.2	2705.4	2593.4	2534.8	2492.0
20°	2684.2	2630.7	2497.4	2430.9	2371.9
22.5°	2614.9	2553.4	2398.6	2308.0	2268.1
25°	2545.5	2460.1	2283.9	2174.7	2134.5
27.5°	2462.8	2371.9	2177.2	2051.8	1990.4
30°	2374.8	2273.1	2059.8	1923.9	1851.6
32.5°	2289.3	2166.5	1947.9	1787.7	1720.9
35°	2193.3	2057.2	1822.5	1654.4	1595.4
37.5°	2099.9	1953.0	1705.0	1520.7	1454.2
40°	2001.2	1841.2	1582.2	1392.8	1323.4
42.5°	1899.8	1729.1	1459.6	1262.0	1195.4
45°	1793.1	1614.2	1334.2	1144.5	1080.6
47.5°	1691.8	1502.4	1214.2	1024.5	965.9
50°	1579.6	1390.3	1096.7	912.4	856.6
52.5°	1470.1	1269.9	984.5	808.5	757.9
55°	1363.3	1155.3	867.1	707.1	656.5
57.5°	1254.1	1040.6	763.2	613.8	571.0
60°	1141.9	928.5	653.6	517.7	475.0
62.5°	1032.7	819.2	560.3	432.3	411.1
65°	920.6	704.3	464.2	373.7	365.4
67.5°	813.9	597.6	373.7	328.1	320.2
70°	701.8	493.7	309.4	282.8	272.1
72.5°	595.0	397.4	258.8	237.6	232.1
75°	490.9	304.1	213.5	194.7	192.3
77.5°	387.0	216.0	168.2	157.4	152.0
80°	290.7	154.9	128.0	117.4	117.4
82.5°	202.7	104.2	88.0	82.7	82.7
85°	114.7	58.6	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P923793

CATALOG NUMBER: DFN2DIP-TR4F0-080D060US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.41	11.27	11.35	12.22	13.44	6.39	7.24	7.32	8.19	9.42
	3H	12.09	12.86	13.04	13.82	15.06	7.58	8.35	8.52	9.30	10.55
	4H	12.70	13.43	13.66	14.39	15.64	8.03	8.76	8.99	9.72	10.97
	6H	13.12	13.79	14.10	14.76	16.03	8.35	9.02	9.32	9.99	11.26
	8H	13.25	13.89	14.23	14.87	16.14	8.44	9.08	9.42	10.06	11.33
	12H	13.31	13.92	14.30	14.89	16.19	8.49	9.09	9.47	10.07	11.36
4H	2H	10.43	11.16	11.40	12.12	13.38	6.98	7.71	7.95	8.67	9.93
	3H	12.27	12.87	13.24	13.86	15.13	8.34	8.94	9.31	9.93	11.20
	4H	12.96	13.51	13.94	14.49	15.79	8.89	9.44	9.87	10.42	11.72
	6H	13.48	13.95	14.47	14.96	16.25	9.31	9.78	10.31	10.79	12.08
	8H	13.65	14.09	14.65	15.09	16.40	9.44	9.88	10.44	10.88	12.19
	12H	13.75	14.14	14.76	15.16	16.47	9.51	9.90	10.52	10.92	12.23
8H	4H	12.93	13.37	13.93	14.37	15.68	9.17	9.61	10.17	10.61	11.92
	6H	13.50	13.86	14.52	14.90	16.21	9.69	10.05	10.71	11.10	12.40
	8H	13.71	14.03	14.74	15.06	16.39	9.88	10.20	10.91	11.23	12.56
	12H	13.85	14.13	14.89	15.16	16.53	10.00	10.29	11.04	11.31	12.68
12H	4H	12.88	13.28	13.90	14.30	15.61	9.18	9.57	10.19	10.59	11.90
	6H	13.47	13.79	14.50	14.82	16.15	9.74	10.06	10.77	11.09	12.41
	8H	13.69	13.98	14.73	15.00	16.37	9.95	10.23	10.99	11.26	12.63

END OF REPORT