

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923803

Luminaire Tested: DFN2DIP-TR4F0-080D090US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923803
REPORT IS A COMBINATION OF REPORTS P901987 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US940-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15007.5 lumens
Efficiency: N/A
Efficacy: 105.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLLONL

Luminous Intensity Polar Plot

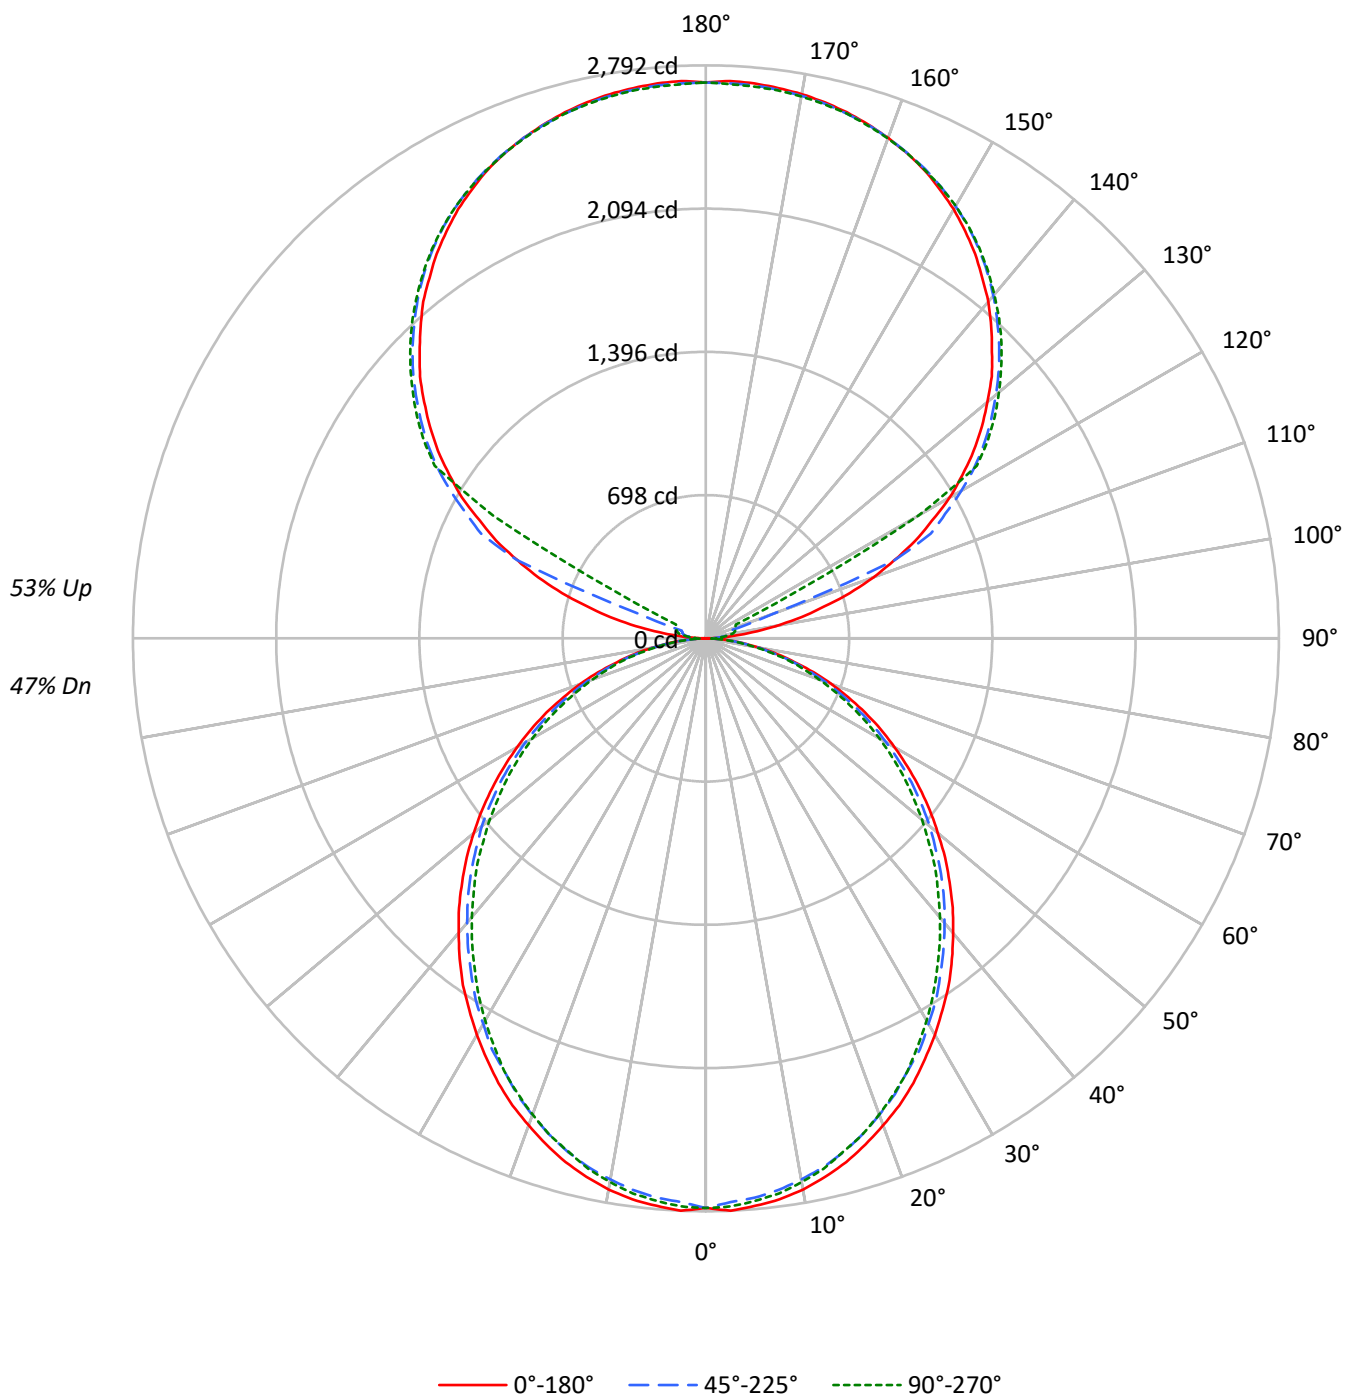

TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	53	53	53
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	34	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	32	29	30	27	24
6	62	50	42	36	57	47	39	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	53	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	34	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2205	2205	2205
5°	2209	2174	2189
10°	2191	2145	2159
15°	2159	2110	2113
20°	2115	2061	2065
25°	2072	2002	2011
30°	2018	1947	1941
35°	1966	1883	1867
40°	1903	1818	1797
45°	1840	1753	1725
50°	1771	1684	1642
55°	1699	1605	1565
60°	1617	1511	1478
65°	1528	1414	1374
70°	1415	1295	1263
75°	1257	1153	1160
80°	1069	972	964
85°	773	659	639

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1840 cd/sqm

TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	261.3	1.7
10°-20°	735.1	4.9
20°-30°	1080.3	7.2
30°-40°	1254.7	8.4
40°-50°	1253.1	8.3
50°-60°	1092.7	7.3
60°-70°	807.7	5.4
70°-80°	457.0	3.0
80°-90°	125.4	0.8
90°-100°	89.3	0.6
100°-110°	332.9	2.2
110°-120°	883.0	5.9
120°-130°	1464.5	9.8
130°-140°	1555.6	10.4
140°-150°	1445.8	9.6
150°-160°	1162.4	7.7
160°-170°	749.0	5.0
170°-180°	257.8	1.7
0°-30°	2076.6	13.8
0°-40°	3331.3	22.2
0°-60°	5677.0	37.8
0°-90°	7067.1	47.1
90°-120°	1305.2	8.7
90°-150°	5771.2	38.5
90°-180°	7940.0	52.9
0°-180°	15007.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2776	2776	2776	2776	2776	
5°	2776	2765	2736	2757	2752	263
15°	2642	2626	2592	2602	2589	744
25°	2392	2370	2325	2330	2325	1100
35°	2063	2037	1994	1978	1964	1288
45°	1679	1660	1620	1591	1580	1296
55°	1271	1254	1222	1190	1177	1136
65°	857	841	814	790	777	847
75°	448	443	430	414	419	479
85°	109	107	104	96	94	122
90°	2	24	39	49	53	14
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2775.7	2775.7	2775.7	2775.7	2775.7
2.5°	2791.9	2778.6	2749.1	2775.7	2770.6
5°	2775.7	2765.3	2735.9	2757.1	2752.0
7.5°	2757.1	2741.2	2711.8	2733.3	2727.9
10°	2727.9	2709.2	2677.2	2698.4	2690.6
12.5°	2687.7	2671.8	2639.8	2653.1	2647.8
15°	2642.4	2626.5	2591.7	2602.5	2589.2
17.5°	2586.3	2570.4	2535.6	2549.0	2535.6
20°	2524.9	2509.0	2471.6	2479.6	2469.1
22.5°	2463.7	2439.6	2404.8	2404.8	2399.4
25°	2391.5	2370.3	2325.0	2330.0	2325.0
27.5°	2311.3	2292.7	2258.1	2250.1	2236.9
30°	2231.5	2209.9	2170.1	2162.1	2151.3
32.5°	2146.0	2130.1	2087.3	2071.2	2060.5
35°	2063.2	2036.7	1993.9	1977.7	1964.4
37.5°	1969.8	1945.7	1903.0	1884.3	1871.0
40°	1873.8	1852.3	1809.5	1785.7	1774.9
42.5°	1780.4	1758.8	1716.4	1689.4	1673.7
45°	1679.0	1660.3	1620.1	1590.9	1580.2
47.5°	1580.2	1561.5	1518.7	1489.2	1473.4
50°	1476.0	1462.7	1425.2	1387.9	1374.6
52.5°	1374.6	1355.8	1321.3	1291.9	1273.2
55°	1270.6	1254.5	1222.5	1190.5	1177.1
57.5°	1166.4	1153.2	1118.3	1086.3	1075.5
60°	1062.2	1051.8	1014.3	984.9	977.0
62.5°	960.8	942.2	915.5	888.9	878.2
65°	856.9	840.8	814.1	790.1	776.8
67.5°	750.1	736.6	712.7	694.1	683.3
70°	651.3	640.5	616.5	597.8	587.3
72.5°	549.9	539.2	525.8	507.2	499.3
75°	448.3	443.2	429.6	413.8	419.1
77.5°	357.7	346.9	341.5	333.6	325.7
80°	267.1	264.2	258.9	250.9	245.5
82.5°	181.6	181.6	179.0	168.2	168.2
85°	109.3	106.7	104.2	96.0	93.5
87.5°	48.2	42.8	37.4	29.4	26.7
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8



TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P923803

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.74	10.57	10.72	11.57	12.88	9.31	10.14	10.29	11.14	12.45
	3H	11.40	12.15	12.39	13.15	14.48	10.92	11.67	11.92	12.68	14.01
	4H	11.98	12.69	12.99	13.70	15.04	11.51	12.22	12.52	13.23	14.57
	6H	12.38	13.04	13.40	14.05	15.40	11.91	12.56	12.92	13.57	14.93
	8H	12.49	13.11	13.51	14.14	15.49	12.01	12.63	13.03	13.66	15.01
	12H	12.53	13.13	13.56	14.15	15.52	12.05	12.64	13.08	13.67	15.04
4H	2H	10.20	10.91	11.21	11.91	13.26	9.85	10.56	10.86	11.57	12.91
	3H	12.06	12.65	13.08	13.69	15.04	11.67	12.26	12.69	13.30	14.65
	4H	12.77	13.32	13.80	14.34	15.72	12.37	12.91	13.40	13.94	15.32
	6H	13.29	13.75	14.33	14.81	16.18	12.88	13.35	13.92	14.40	15.77
	8H	13.44	13.87	14.48	14.92	16.31	13.03	13.46	14.06	14.50	15.89
	12H	13.51	13.90	14.57	14.96	16.36	13.09	13.48	14.14	14.54	15.93
8H	4H	12.97	13.40	14.01	14.45	15.84	12.61	13.04	13.65	14.09	15.48
	6H	13.60	13.96	14.66	15.05	16.43	13.24	13.60	14.30	14.68	16.07
	8H	13.82	14.14	14.89	15.21	16.61	13.45	13.77	14.52	14.84	16.24
	12H	13.95	14.23	15.02	15.29	16.74	13.57	13.84	14.64	14.91	16.36
12H	4H	12.95	13.35	14.01	14.41	15.80	12.60	13.00	13.66	14.05	15.45
	6H	13.63	13.95	14.70	15.02	16.42	13.28	13.59	14.35	14.66	16.07
	8H	13.87	14.15	14.94	15.21	16.66	13.51	13.79	14.59	14.86	16.30