

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923804

Luminaire Tested: DFN2DIP-TR4F0-080D090US940-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923804
REPORT IS A COMBINATION OF REPORTS P900468 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US940-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13166.1 lumens
Efficiency: N/A
Efficacy: 92.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

Luminous Intensity Polar Plot

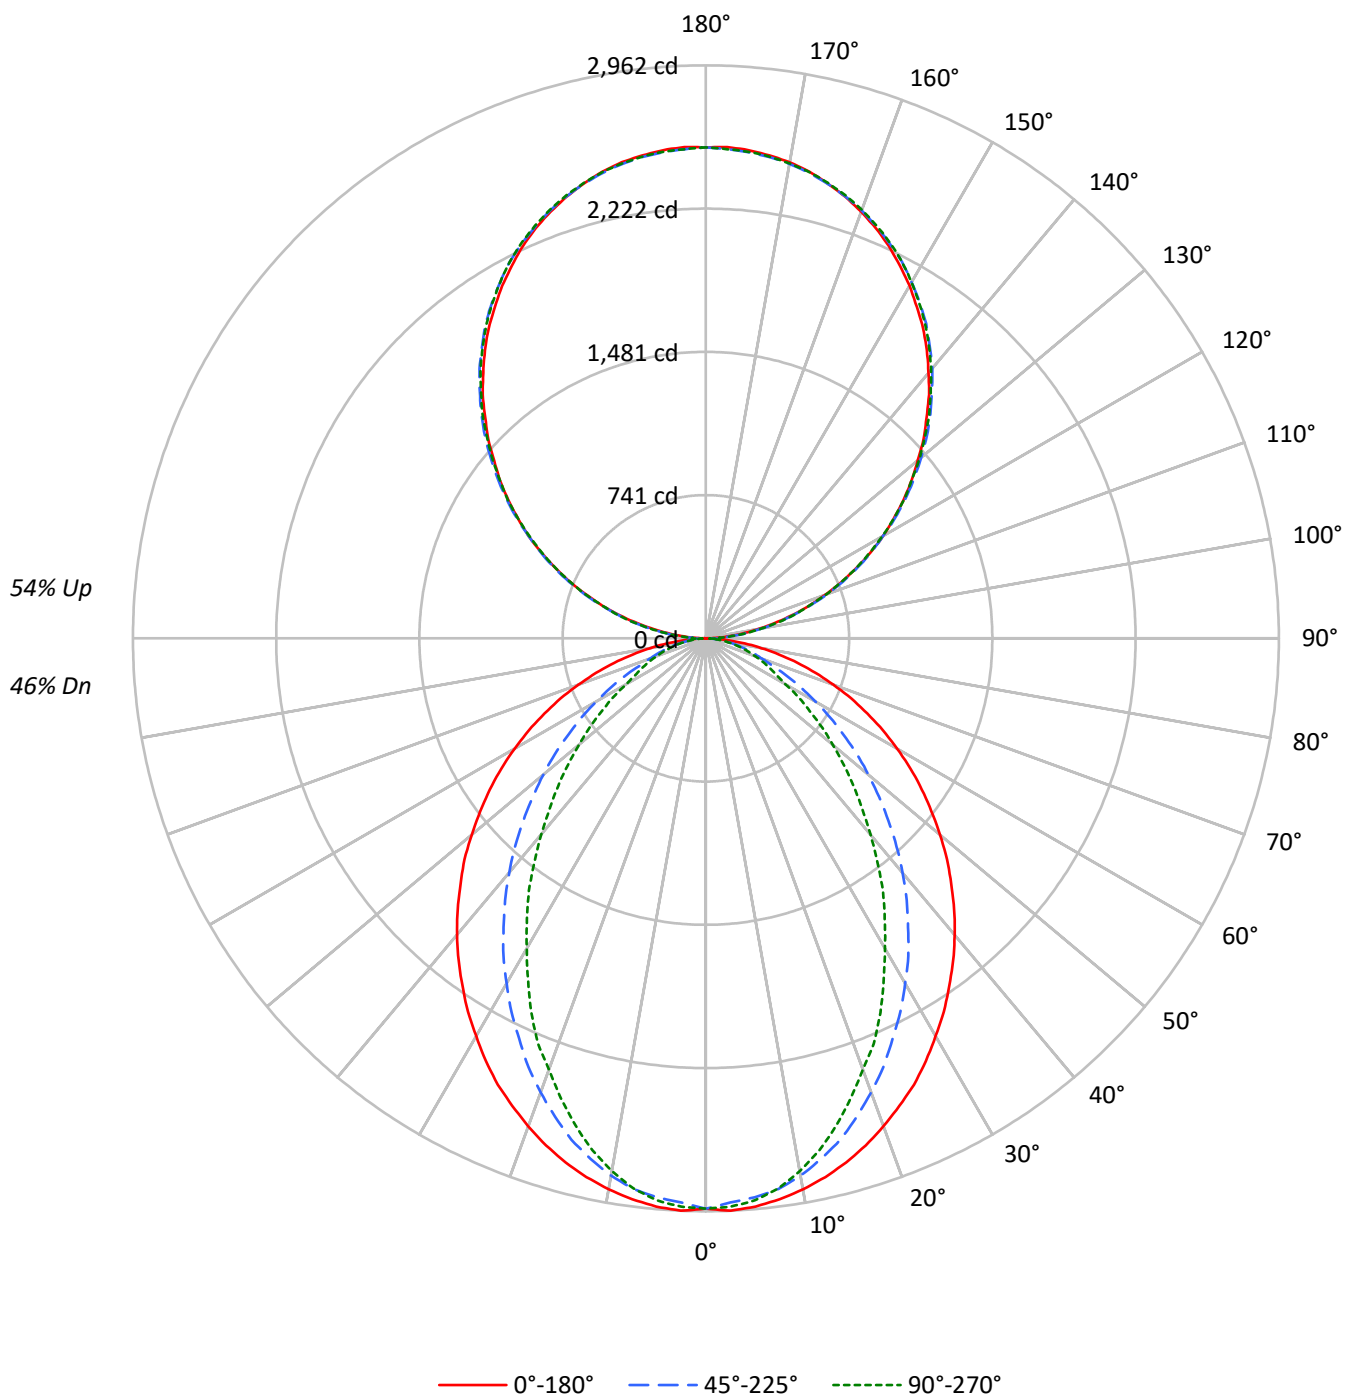

TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	57	56	47	46	45
2	89	82	76	71	82	75	70	66	63	60	57	52	50	47	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2342	2342	2342
5°	2346	2305	2320
10°	2323	2260	2244
15°	2291	2185	2127
20°	2249	2082	1984
25°	2205	1967	1846
30°	2147	1848	1670
35°	2090	1721	1516
40°	2032	1589	1340
45°	1965	1443	1180
50°	1895	1296	1023
55°	1822	1138	873
60°	1738	974	718
65°	1642	806	646
70°	1524	650	585
75°	1377	573	532
80°	1163	481	461
85°	811	320	346

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1979 cd/sqm

TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.3	2.1
10°-20°	758.6	5.8
20°-30°	1065.0	8.1
30°-40°	1160.9	8.8
40°-50°	1067.0	8.1
50°-60°	838.0	6.4
60°-70°	545.4	4.1
70°-80°	280.8	2.1
80°-90°	78.9	0.6
90°-100°	157.1	1.2
100°-110°	499.0	3.8
110°-120°	854.0	6.5
120°-130°	1123.1	8.5
130°-140°	1260.7	9.6
140°-150°	1236.2	9.4
150°-160°	1037.0	7.9
160°-170°	687.7	5.2
170°-180°	240.4	1.8
0°-30°	2099.9	15.9
0°-40°	3260.8	24.8
0°-60°	5165.8	39.2
0°-90°	6070.9	46.1
90°-120°	1510.1	11.5
90°-150°	5130.1	39.0
90°-180°	7095.0	53.9
0°-180°	13166.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2948	2948	2948	2948	2948	
5°	2948	2935	2900	2924	2916	280
15°	2804	2775	2684	2634	2607	790
25°	2546	2460	2284	2175	2134	1171
35°	2193	2057	1822	1654	1595	1373
45°	1793	1614	1334	1144	1081	1385
55°	1363	1155	867	707	656	1218
65°	921	704	464	374	365	913
75°	491	304	214	195	192	519
85°	115	59	51	51	51	132
90°	2	28	75	70	73	13
95°	112	133	137	137	133	124
105°	461	467	471	475	475	486
115°	857	869	865	863	857	848
125°	1246	1266	1260	1253	1250	1114
135°	1612	1636	1641	1638	1632	1246
145°	1957	1973	1985	1987	1979	1223
155°	2238	2244	2251	2262	2255	1030
165°	2435	2432	2432	2448	2437	687
175°	2534	2527	2523	2538	2525	241
180°	2538	2538	2538	2538	2538	



TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2948.4	2948.4	2948.4	2948.4	2948.4
2.5°	2961.6	2948.4	2918.9	2945.8	2940.4
5°	2948.4	2935.1	2900.2	2924.3	2916.3
7.5°	2924.3	2908.4	2871.0	2881.6	2868.2
10°	2892.3	2873.6	2820.4	2812.2	2796.3
12.5°	2852.4	2828.3	2756.1	2740.2	2710.8
15°	2804.3	2774.8	2684.2	2633.6	2606.9
17.5°	2748.2	2705.4	2593.4	2534.8	2492.0
20°	2684.2	2630.7	2497.4	2430.9	2371.9
22.5°	2614.9	2553.4	2398.6	2308.0	2268.1
25°	2545.5	2460.1	2283.9	2174.7	2134.5
27.5°	2462.8	2371.9	2177.2	2051.8	1990.4
30°	2374.8	2273.1	2059.8	1923.9	1851.6
32.5°	2289.3	2166.5	1947.9	1787.7	1720.9
35°	2193.3	2057.2	1822.5	1654.4	1595.4
37.5°	2099.9	1953.0	1705.0	1520.7	1454.2
40°	2001.2	1841.2	1582.2	1392.8	1323.4
42.5°	1899.8	1729.1	1459.6	1262.0	1195.4
45°	1793.1	1614.2	1334.2	1144.5	1080.6
47.5°	1691.8	1502.4	1214.2	1024.5	965.9
50°	1579.6	1390.3	1096.7	912.4	856.6
52.5°	1470.1	1269.9	984.5	808.5	757.9
55°	1363.3	1155.3	867.1	707.1	656.5
57.5°	1254.1	1040.6	763.2	613.8	571.0
60°	1141.9	928.5	653.6	517.7	475.0
62.5°	1032.7	819.2	560.3	432.3	411.1
65°	920.6	704.3	464.2	373.7	365.4
67.5°	813.9	597.6	373.7	328.1	320.2
70°	701.8	493.7	309.4	282.8	272.1
72.5°	595.0	397.4	258.8	237.6	232.1
75°	490.9	304.1	213.5	194.7	192.3
77.5°	387.0	216.0	168.2	157.4	152.0
80°	290.7	154.9	128.0	117.4	117.4
82.5°	202.7	104.2	88.0	82.7	82.7
85°	114.7	58.6	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	2.3	27.6	75.0	70.4	72.7
92.5°	47.4	64.3	66.6	68.8	68.8
95°	111.7	133.1	137.0	137.0	133.1
97.5°	185.9	205.8	214.3	214.3	214.3
100°	271.6	289.3	295.3	295.3	293.1
102.5°	361.9	375.0	383.3	385.7	383.3
105°	460.7	466.7	471.4	475.2	475.2
107.5°	558.6	567.8	567.8	569.3	558.6
110°	653.4	665.8	665.8	665.8	659.6

TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	756.0	769.0	766.7	760.6	756.0
115°	857.0	869.2	865.4	863.2	857.0
117.5°	957.3	974.1	963.4	957.3	951.1
120°	1058.3	1075.0	1058.3	1058.3	1051.3
122.5°	1150.0	1171.5	1160.8	1154.7	1150.0
125°	1246.5	1265.6	1259.5	1252.6	1250.4
127.5°	1340.6	1364.3	1355.9	1346.8	1340.6
130°	1428.6	1456.2	1452.3	1447.7	1439.3
132.5°	1527.3	1548.7	1550.2	1539.5	1533.5
135°	1612.2	1635.9	1640.6	1638.3	1632.2
137.5°	1707.1	1726.3	1730.1	1728.6	1719.4
140°	1790.6	1809.6	1820.3	1820.3	1812.0
142.5°	1876.2	1895.3	1901.5	1903.8	1895.3
145°	1957.4	1972.6	1984.9	1987.2	1978.8
147.5°	2030.1	2049.2	2058.3	2062.2	2053.8
150°	2105.1	2118.1	2126.5	2133.3	2126.5
152.5°	2171.6	2184.6	2195.3	2203.8	2195.3
155°	2238.2	2244.3	2251.2	2261.9	2255.0
157.5°	2295.5	2300.2	2304.0	2319.2	2308.5
160°	2346.8	2351.4	2353.8	2366.7	2357.5
162.5°	2394.2	2394.2	2396.6	2411.1	2400.4
165°	2434.8	2432.5	2432.5	2447.8	2437.1
167.5°	2471.6	2464.7	2464.7	2479.9	2469.2
170°	2499.1	2493.0	2490.7	2506.0	2493.0
172.5°	2518.2	2512.1	2509.8	2525.1	2512.1
175°	2533.5	2527.4	2522.8	2538.2	2525.1
177.5°	2541.9	2535.8	2531.2	2544.2	2531.2
180°	2538.2	2538.2	2538.2	2538.2	2538.2

TEST NUMBER: P923804

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.72	10.52	10.72	11.52	12.85	5.70	6.50	6.69	7.50	8.83
	3H	11.40	12.11	12.40	13.12	14.47	6.88	7.60	7.89	8.61	9.96
	4H	12.00	12.68	13.02	13.70	15.05	7.33	8.01	8.35	9.02	10.38
	6H	12.42	13.05	13.45	14.07	15.44	7.65	8.28	8.68	9.30	10.66
	8H	12.55	13.14	13.58	14.18	15.54	7.74	8.34	8.78	9.37	10.74
	12H	12.61	13.17	13.65	14.20	15.59	7.79	8.35	8.83	9.38	10.77
4H	2H	9.74	10.41	10.76	11.43	12.79	6.29	6.96	7.31	7.98	9.34
	3H	11.56	12.13	12.60	13.17	14.54	7.64	8.20	8.67	9.24	10.61
	4H	12.25	12.77	13.30	13.80	15.20	8.18	8.70	9.22	9.73	11.13
	6H	12.77	13.21	13.82	14.27	15.66	8.60	9.04	9.65	10.10	11.49
	8H	12.94	13.35	13.99	14.41	15.81	8.73	9.14	9.78	10.19	11.60
	12H	13.04	13.41	14.10	14.47	15.88	8.79	9.17	9.86	10.23	11.64
8H	4H	12.22	12.63	13.27	13.68	15.09	8.46	8.87	9.51	9.93	11.33
	6H	12.78	13.12	13.86	14.22	15.62	8.98	9.32	10.05	10.41	11.81
	8H	13.00	13.30	14.08	14.38	15.80	9.17	9.47	10.25	10.55	11.97
	12H	13.14	13.40	14.22	14.47	15.94	9.29	9.55	10.37	10.62	12.09
12H	4H	12.17	12.54	13.24	13.61	15.02	8.46	8.84	9.53	9.90	11.31
	6H	12.76	13.06	13.84	14.14	15.56	9.03	9.33	10.11	10.40	11.83
	8H	12.98	13.24	14.06	14.31	15.78	9.24	9.50	10.32	10.57	12.04

END OF REPORT