

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923818

Luminaire Tested: DFN2DIP-TR4F0-090D040US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923818
REPORT IS A COMBINATION OF REPORTS P900379 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D040US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11101.8 lumens
Efficiency: N/A
Efficacy: 94.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 117.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

Luminous Intensity Polar Plot

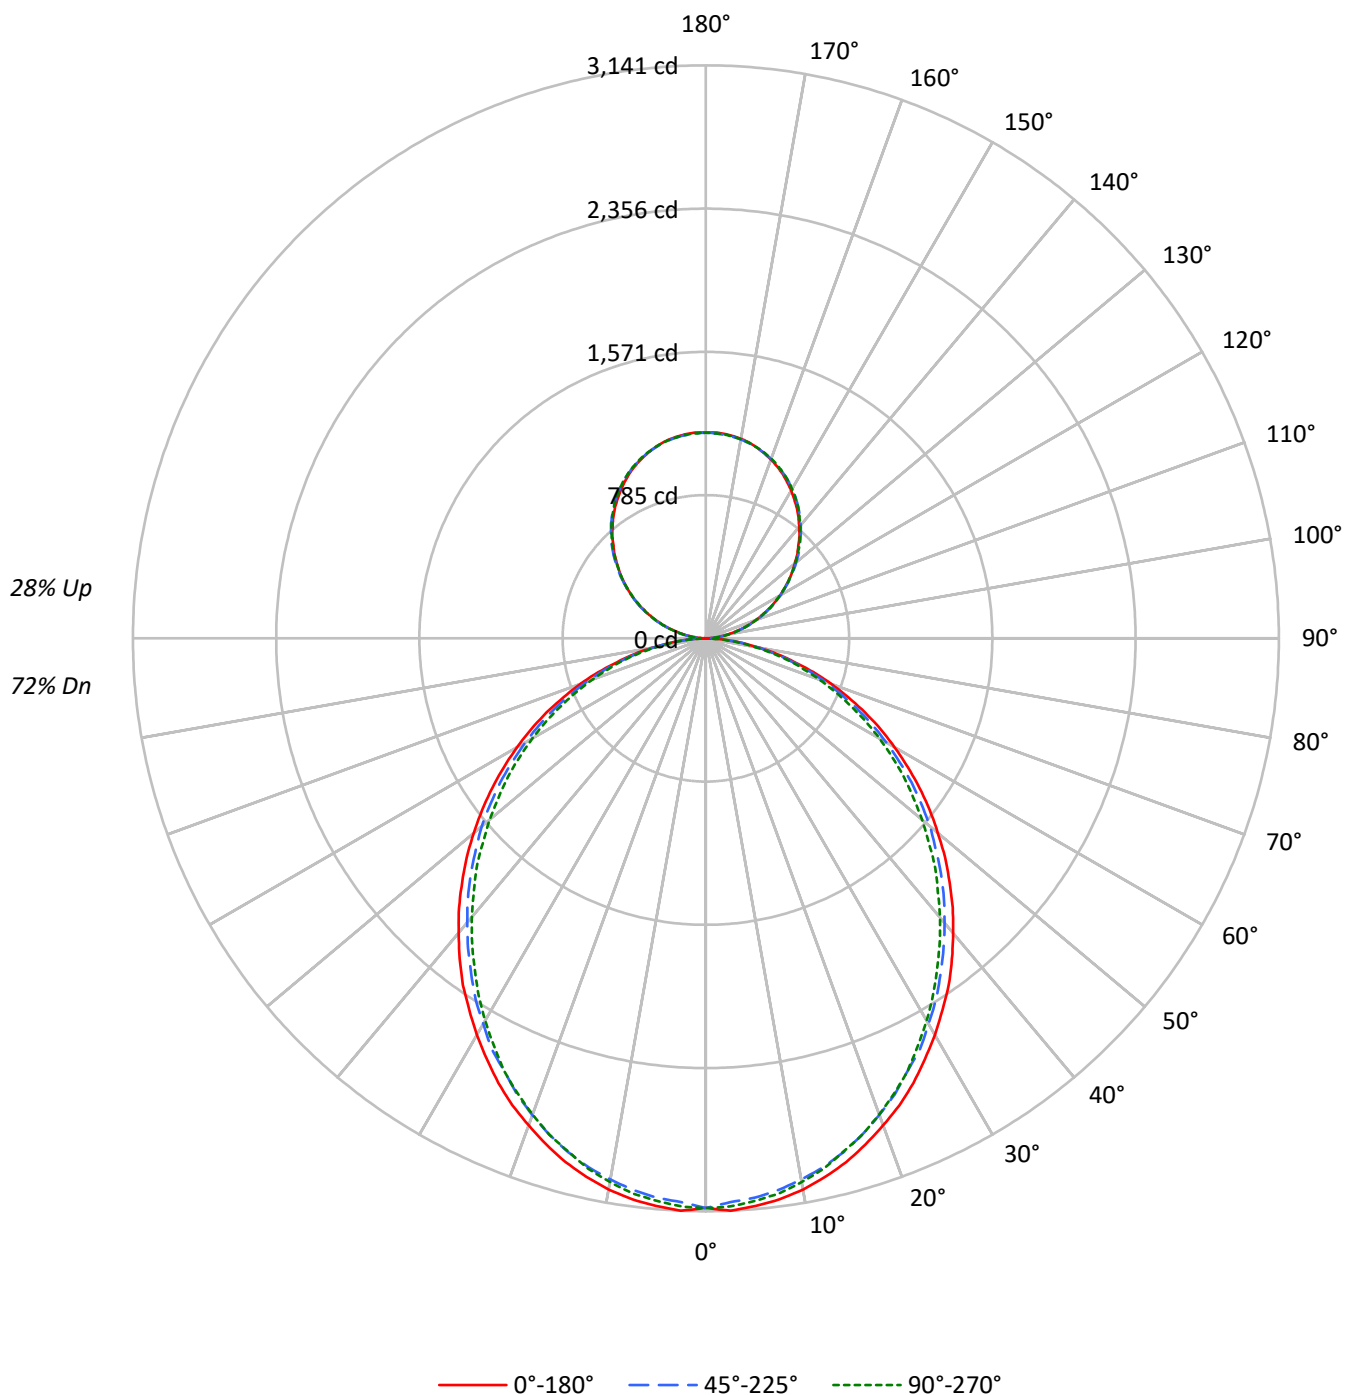

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	91	97	93	90	86	84	81	79	75	73	71	67	66	64
2	93	86	79	74	88	81	76	71	73	69	65	66	63	59	59	56	54
3	85	75	68	62	81	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	51	58	52	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	44	52	45	41	47	42	38	42	38	35
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	31
7	61	49	40	35	58	47	39	34	42	36	31	39	33	29	35	31	27
8	57	44	36	31	54	42	35	30	39	33	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	30	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2481	2481	2481
5°	2485	2446	2463
10°	2465	2413	2429
15°	2428	2373	2377
20°	2380	2318	2324
25°	2331	2252	2262
30°	2270	2191	2183
35°	2212	2118	2100
40°	2141	2045	2021
45°	2070	1972	1941
50°	1992	1895	1847
55°	1911	1806	1761
60°	1819	1700	1662
65°	1719	1590	1546
70°	1591	1457	1421
75°	1415	1297	1305
80°	1202	1093	1085
85°	870	742	718

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2070 cd/sqm

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	2.6
10°-20°	827.0	7.4
20°-30°	1215.3	10.9
30°-40°	1411.5	12.7
40°-50°	1409.7	12.7
50°-60°	1229.3	11.1
60°-70°	908.7	8.2
70°-80°	514.1	4.6
80°-90°	138.9	1.3
90°-100°	69.8	0.6
100°-110°	221.8	2.0
110°-120°	379.5	3.4
120°-130°	499.2	4.5
130°-140°	560.3	5.0
140°-150°	549.4	4.9
150°-160°	460.9	4.2
160°-170°	305.7	2.8
170°-180°	106.8	1.0
0°-30°	2336.2	21.0
0°-40°	3747.7	33.8
0°-60°	6386.7	57.5
0°-90°	7948.4	71.6
90°-120°	671.2	6.0
90°-150°	2280.1	20.5
90°-180°	3153.0	28.4
0°-180°	11101.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	1	12	33	31	32	11
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P923818

CATALOG NUMBER: DFN2DIP-TR4F0-090D040US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.21	13.31	12.96	14.08	15.00	11.78	12.88	12.53	13.65	14.57
	3H	13.89	14.88	14.65	15.65	16.61	13.42	14.40	14.18	15.18	16.14
	4H	14.49	15.42	15.27	16.21	17.17	14.02	14.95	14.79	15.73	16.70
	6H	14.90	15.76	15.69	16.55	17.54	14.43	15.28	15.22	16.08	17.06
	8H	15.01	15.83	15.81	16.64	17.63	14.54	15.35	15.34	16.17	17.15
	12H	15.07	15.85	15.87	16.66	17.67	14.59	15.37	15.39	16.18	17.19
4H	2H	12.70	13.63	13.48	14.42	15.39	12.36	13.29	13.14	14.08	15.04
	3H	14.59	15.37	15.38	16.19	17.17	14.20	14.97	14.99	15.80	16.78
	4H	15.31	16.02	16.12	16.84	17.85	14.91	15.61	15.72	16.44	17.45
	6H	15.84	16.45	16.67	17.30	18.32	15.43	16.04	16.26	16.89	17.91
	8H	16.00	16.57	16.83	17.41	18.44	15.58	16.16	16.41	17.00	18.03
	12H	16.08	16.60	16.93	17.46	18.49	15.66	16.17	16.51	17.04	18.07
8H	4H	15.53	16.10	16.36	16.94	17.97	15.17	15.74	16.00	16.58	17.61
	6H	16.17	16.64	17.03	17.53	18.56	15.81	16.28	16.66	17.16	18.20
	8H	16.39	16.81	17.26	17.69	18.74	16.02	16.44	16.89	17.32	18.37
	12H	16.53	16.91	17.41	17.78	18.88	16.15	16.52	17.02	17.39	18.49
12H	4H	15.53	16.04	16.38	16.90	17.94	15.17	15.69	16.02	16.55	17.59
	6H	16.20	16.62	17.07	17.50	18.55	15.85	16.27	16.72	17.15	18.20
	8H	16.45	16.83	17.33	17.70	18.80	16.10	16.47	16.97	17.34	18.44

END OF REPORT