

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923825

Luminaire Tested: DFN2DIP-TR4F0-090D050US940-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923825
REPORT IS A COMBINATION OF REPORTS P901918 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D050US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11235.6 lumens
Efficiency: N/A
Efficacy: 89.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLLONL

Luminous Intensity Polar Plot

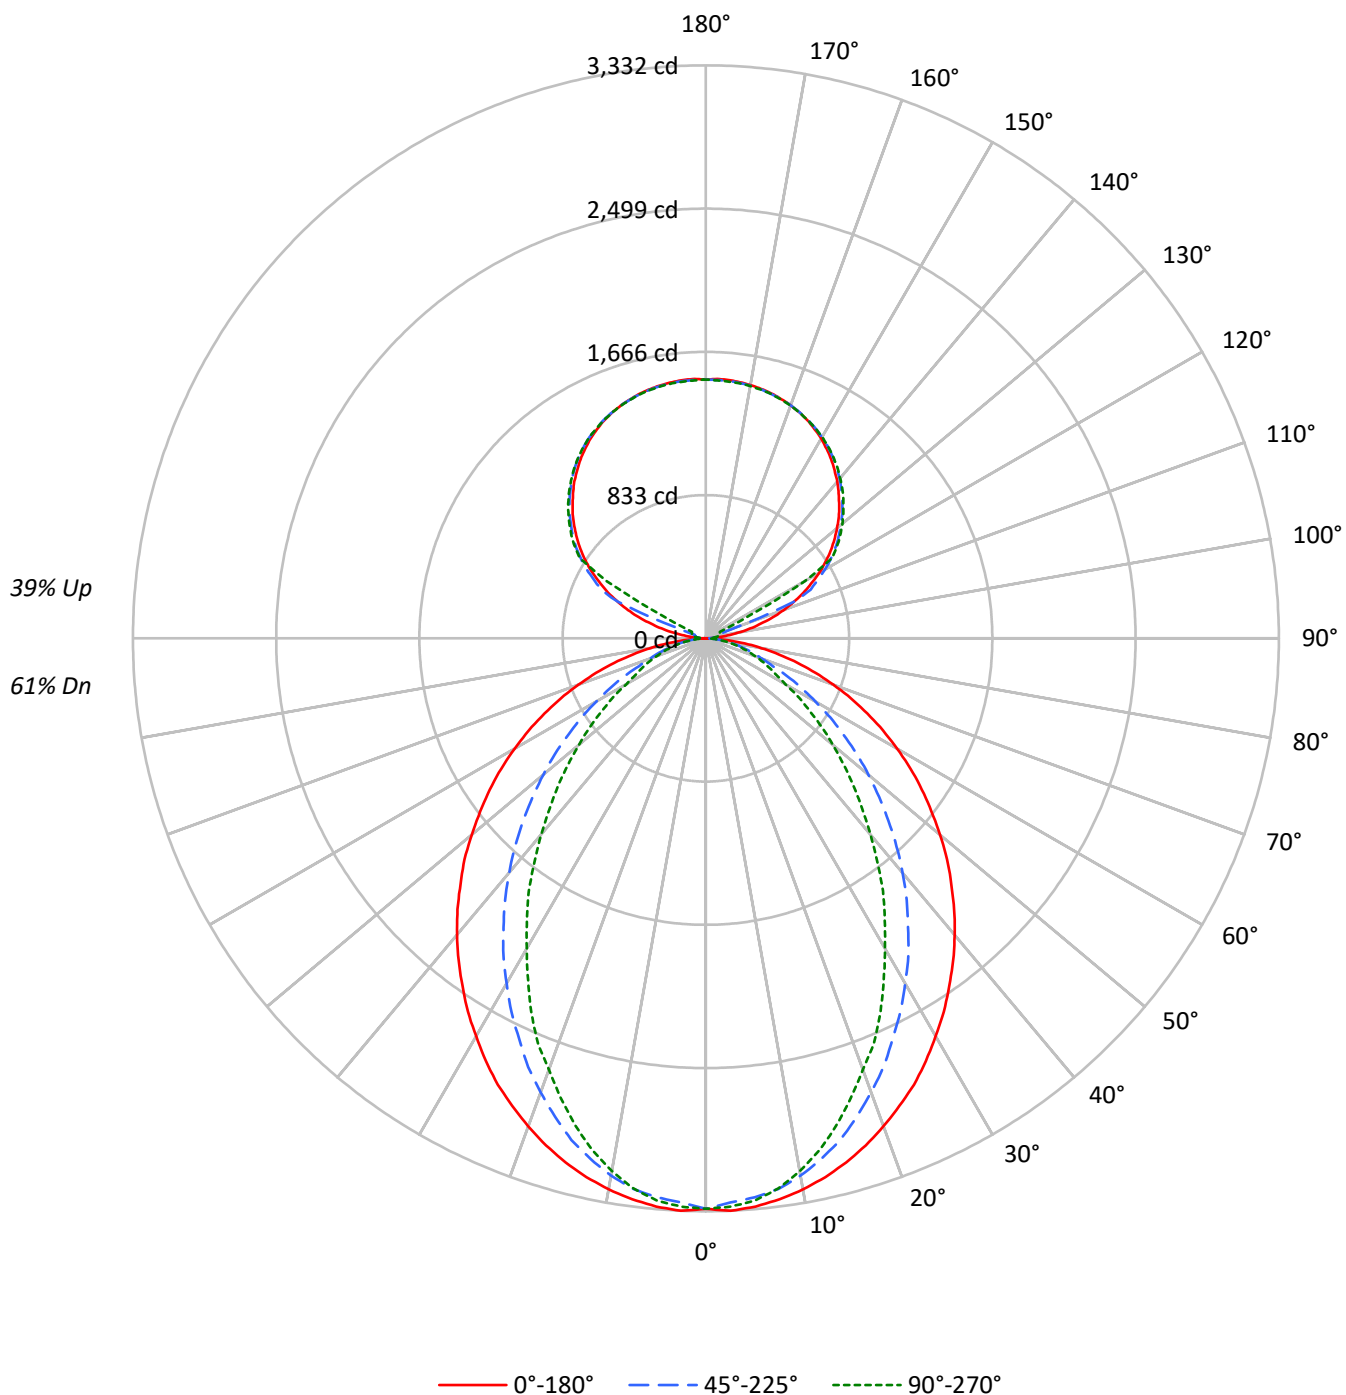

TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2635	2635	2635
5°	2639	2593	2610
10°	2613	2542	2525
15°	2577	2458	2393
20°	2530	2342	2232
25°	2481	2213	2077
30°	2416	2079	1879
35°	2351	1936	1706
40°	2286	1788	1507
45°	2210	1624	1327
50°	2132	1458	1151
55°	2050	1281	982
60°	1956	1095	808
65°	1847	907	727
70°	1715	731	658
75°	1549	644	598
80°	1309	540	519
85°	912	361	390

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2210 cd/sqm

TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.9	2.8
10°-20°	853.4	7.6
20°-30°	1198.1	10.7
30°-40°	1306.0	11.6
40°-50°	1200.4	10.7
50°-60°	942.7	8.4
60°-70°	613.6	5.5
70°-80°	315.9	2.8
80°-90°	83.3	0.7
90°-100°	49.6	0.4
100°-110°	185.0	1.6
110°-120°	490.6	4.4
120°-130°	813.6	7.2
130°-140°	864.3	7.7
140°-150°	803.2	7.1
150°-160°	645.8	5.7
160°-170°	416.1	3.7
170°-180°	143.2	1.3
0°-30°	2362.4	21.0
0°-40°	3668.4	32.6
0°-60°	5811.5	51.7
0°-90°	6824.3	60.7
90°-120°	725.2	6.5
90°-150°	3206.2	28.5
90°-180°	4411.0	39.3
0°-180°	11235.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3317	3317	3317	3317	3317	
5°	3317	3302	3263	3290	3281	315
15°	3155	3122	3020	2963	2933	889
25°	2864	2768	2570	2446	2401	1317
35°	2468	2314	2050	1861	1795	1544
45°	2017	1816	1501	1288	1216	1558
55°	1534	1300	975	796	738	1371
65°	1036	792	522	420	411	1027
75°	552	342	240	219	216	584
85°	129	66	57	57	57	148
90°	1	13	22	27	29	11
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3316.9	3316.9	3316.9	3316.9	3316.9
2.5°	3331.9	3316.9	3283.7	3314.0	3308.0
5°	3316.9	3301.9	3262.8	3289.8	3280.9
7.5°	3289.8	3272.0	3230.0	3241.7	3226.7
10°	3253.9	3232.8	3173.0	3163.7	3145.9
12.5°	3208.9	3181.9	3100.7	3082.8	3049.6
15°	3154.8	3121.7	3019.8	2962.7	2932.8
17.5°	3091.7	3043.7	2917.5	2851.6	2803.5
20°	3019.8	2959.6	2809.5	2734.7	2668.4
22.5°	2941.8	2872.6	2698.4	2596.5	2551.6
25°	2863.7	2767.5	2569.5	2446.5	2401.3
27.5°	2770.7	2668.4	2449.4	2308.3	2239.2
30°	2671.7	2557.3	2317.2	2164.4	2083.1
32.5°	2575.4	2437.2	2191.4	2011.2	1936.0
35°	2467.5	2314.3	2050.3	1861.2	1794.9
37.5°	2362.4	2197.2	1918.2	1710.8	1636.0
40°	2251.3	2071.4	1779.9	1566.9	1488.9
42.5°	2137.3	1945.3	1642.0	1419.8	1344.9
45°	2017.2	1816.0	1500.9	1287.5	1215.6
47.5°	1903.2	1690.1	1365.9	1152.5	1086.6
50°	1777.1	1564.0	1233.8	1026.4	963.7
52.5°	1653.9	1428.7	1107.7	909.5	852.6
55°	1533.7	1299.7	975.4	795.6	738.5
57.5°	1410.9	1170.7	858.6	690.5	642.4
60°	1284.7	1044.5	735.4	582.5	534.4
62.5°	1161.8	921.7	630.3	486.3	462.4
65°	1035.6	792.4	522.3	420.4	411.2
67.5°	915.6	672.3	420.4	369.1	360.2
70°	789.5	555.4	348.1	318.2	306.0
72.5°	669.4	447.1	291.1	267.2	261.2
75°	552.2	342.1	240.1	219.1	216.2
77.5°	435.3	243.0	189.1	177.1	171.0
80°	327.1	174.2	143.9	132.2	132.2
82.5°	228.0	117.2	99.1	93.0	93.0
85°	128.9	65.9	57.0	57.0	57.0
87.5°	48.1	23.9	23.9	21.0	21.0
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0



TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P923825

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.46	12.38	12.32	13.26	14.38	7.43	8.36	8.30	9.24	10.35
	3H	13.14	13.97	14.02	14.86	16.00	8.63	9.45	9.51	10.35	11.49
	4H	13.75	14.53	14.65	15.43	16.58	9.08	9.86	9.98	10.76	11.91
	6H	14.18	14.90	15.09	15.80	16.97	9.41	10.13	10.32	11.03	12.19
	8H	14.31	14.99	15.22	15.92	17.08	9.50	10.19	10.42	11.11	12.27
	12H	14.37	15.02	15.29	15.94	17.13	9.55	10.20	10.47	11.12	12.30
4H	2H	11.49	12.27	12.39	13.17	14.31	8.04	8.82	8.94	9.72	10.87
	3H	13.32	13.97	14.23	14.90	16.07	9.40	10.05	10.31	10.98	12.14
	4H	14.02	14.61	14.94	15.54	16.73	9.95	10.54	10.87	11.47	12.65
	6H	14.54	15.05	15.47	16.00	17.19	10.37	10.88	11.31	11.83	13.02
	8H	14.72	15.19	15.65	16.13	17.34	10.51	10.98	11.44	11.92	13.13
	12H	14.82	15.24	15.77	16.20	17.41	10.58	11.00	11.53	11.96	13.17
8H	4H	13.99	14.47	14.93	15.41	16.62	10.24	10.71	11.17	11.65	12.86
	6H	14.56	14.96	15.53	15.94	17.14	10.76	11.15	11.72	12.14	13.34
	8H	14.78	15.13	15.75	16.10	17.32	10.95	11.30	11.92	12.27	13.49
	12H	14.92	15.23	15.90	16.20	17.47	11.08	11.38	12.05	12.35	13.62
12H	4H	13.95	14.38	14.91	15.34	16.55	10.25	10.67	11.20	11.63	12.84
	6H	14.54	14.89	15.51	15.86	17.08	10.81	11.16	11.78	12.13	13.35
	8H	14.76	15.07	15.74	16.04	17.31	11.02	11.33	12.00	12.30	13.57

END OF REPORT