

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923841

Luminaire Tested: DFN2DIP-TR4F0-090D090US940-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923841
REPORT IS A COMBINATION OF REPORTS P901990 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D090US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14766.7 lumens
Efficiency: N/A
Efficacy: 95.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLLONL

Luminous Intensity Polar Plot

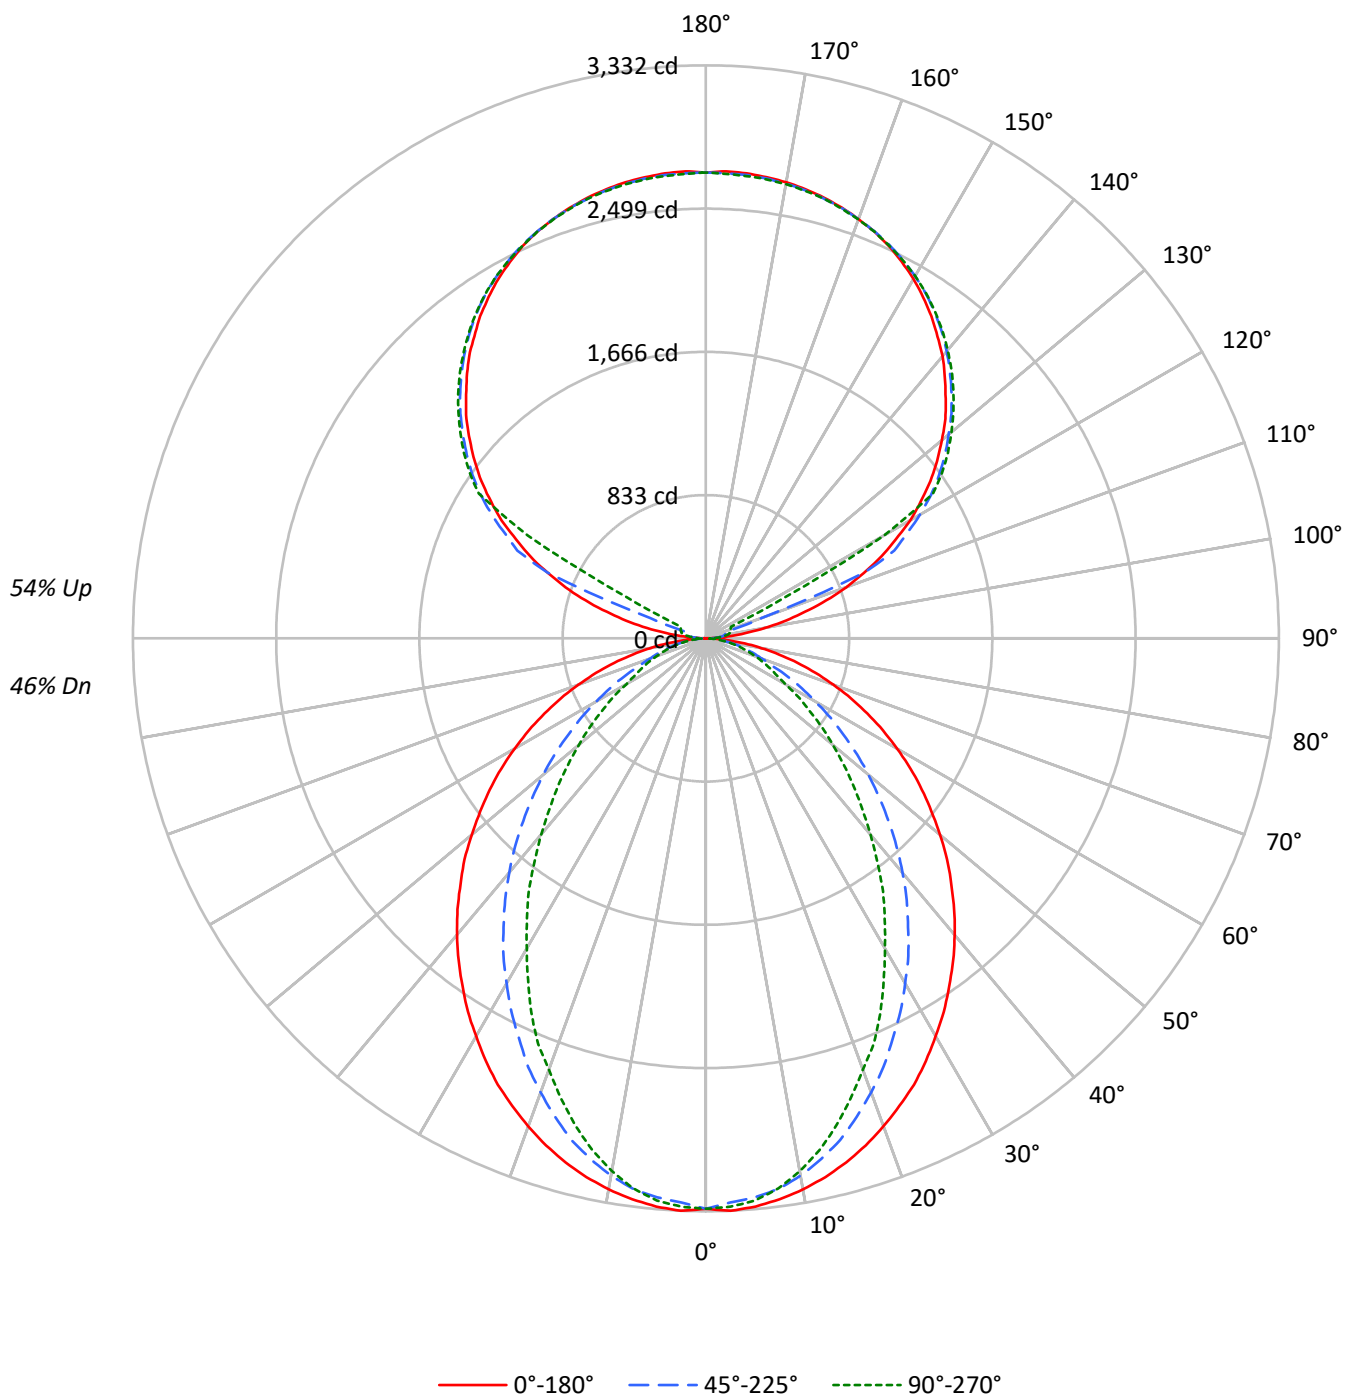

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53	46		
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45	40		
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39	34		
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34	29		
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29	26		
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26	23		
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23	20		
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21	18		
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19	16		
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17	15		
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15	13		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2635	2635	2635
5°	2639	2593	2610
10°	2613	2542	2525
15°	2577	2458	2393
20°	2530	2342	2232
25°	2481	2213	2077
30°	2416	2079	1879
35°	2351	1936	1706
40°	2286	1788	1507
45°	2210	1624	1327
50°	2132	1458	1151
55°	2050	1281	982
60°	1956	1095	808
65°	1847	907	727
70°	1715	731	658
75°	1549	644	598
80°	1309	540	519
85°	912	361	390

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2210 cd/sqm

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.9	2.1
10°-20°	853.4	5.8
20°-30°	1198.1	8.1
30°-40°	1306.0	8.8
40°-50°	1200.4	8.1
50°-60°	942.7	6.4
60°-70°	613.6	4.2
70°-80°	315.9	2.1
80°-90°	85.4	0.6
90°-100°	89.3	0.6
100°-110°	332.9	2.3
110°-120°	883.0	6.0
120°-130°	1464.5	9.9
130°-140°	1555.6	10.5
140°-150°	1445.8	9.8
150°-160°	1162.4	7.9
160°-170°	749.0	5.1
170°-180°	257.8	1.7
0°-30°	2362.4	16.0
0°-40°	3668.4	24.8
0°-60°	5811.5	39.4
0°-90°	6826.4	46.2
90°-120°	1305.2	8.8
90°-150°	5771.2	39.1
90°-180°	7940.0	53.8
0°-180°	14766.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3317	3317	3317	3317	3317	
5°	3317	3302	3263	3290	3281	315
15°	3155	3122	3020	2963	2933	889
25°	2864	2768	2570	2446	2401	1317
35°	2468	2314	2050	1861	1795	1544
45°	2017	1816	1501	1288	1216	1558
55°	1534	1300	975	796	738	1371
65°	1036	792	522	420	411	1027
75°	552	342	240	219	216	584
85°	129	66	57	57	57	148
90°	2	24	39	49	53	14
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3316.9	3316.9	3316.9	3316.9	3316.9
2.5°	3331.9	3316.9	3283.7	3314.0	3308.0
5°	3316.9	3301.9	3262.8	3289.8	3280.9
7.5°	3289.8	3272.0	3230.0	3241.7	3226.7
10°	3253.9	3232.8	3173.0	3163.7	3145.9
12.5°	3208.9	3181.9	3100.7	3082.8	3049.6
15°	3154.8	3121.7	3019.8	2962.7	2932.8
17.5°	3091.7	3043.7	2917.5	2851.6	2803.5
20°	3019.8	2959.6	2809.5	2734.7	2668.4
22.5°	2941.8	2872.6	2698.4	2596.5	2551.6
25°	2863.7	2767.5	2569.5	2446.5	2401.3
27.5°	2770.7	2668.4	2449.4	2308.3	2239.2
30°	2671.7	2557.3	2317.2	2164.4	2083.1
32.5°	2575.4	2437.2	2191.4	2011.2	1936.0
35°	2467.5	2314.3	2050.3	1861.2	1794.9
37.5°	2362.4	2197.2	1918.2	1710.8	1636.0
40°	2251.3	2071.4	1779.9	1566.9	1488.9
42.5°	2137.3	1945.3	1642.0	1419.8	1344.9
45°	2017.2	1816.0	1500.9	1287.5	1215.6
47.5°	1903.2	1690.1	1365.9	1152.5	1086.6
50°	1777.1	1564.0	1233.8	1026.4	963.7
52.5°	1653.9	1428.7	1107.7	909.5	852.6
55°	1533.7	1299.7	975.4	795.6	738.5
57.5°	1410.9	1170.7	858.6	690.5	642.4
60°	1284.7	1044.5	735.4	582.5	534.4
62.5°	1161.8	921.7	630.3	486.3	462.4
65°	1035.6	792.4	522.3	420.4	411.2
67.5°	915.6	672.3	420.4	369.1	360.2
70°	789.5	555.4	348.1	318.2	306.0
72.5°	669.4	447.1	291.1	267.2	261.2
75°	552.2	342.1	240.1	219.1	216.2
77.5°	435.3	243.0	189.1	177.1	171.0
80°	327.1	174.2	143.9	132.2	132.2
82.5°	228.0	117.2	99.1	93.0	93.0
85°	128.9	65.9	57.0	57.0	57.0
87.5°	48.1	23.9	23.9	21.0	21.0
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P923841

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.15	10.95	11.14	11.95	13.27	6.12	6.92	7.11	7.92	9.25
	3H	11.82	12.54	12.83	13.55	14.89	7.31	8.02	8.31	9.03	10.38
	4H	12.43	13.10	13.45	14.12	15.47	7.76	8.43	8.77	9.45	10.80
	6H	12.85	13.47	13.88	14.49	15.86	8.08	8.70	9.11	9.72	11.09
	8H	12.97	13.56	14.01	14.60	15.96	8.17	8.76	9.20	9.79	11.16
	12H	13.03	13.60	14.07	14.62	16.01	8.21	8.77	9.25	9.80	11.19
4H	2H	10.16	10.84	11.19	11.85	13.21	6.71	7.39	7.74	8.40	9.76
	3H	11.99	12.55	13.02	13.59	14.96	8.06	8.62	9.09	9.66	11.03
	4H	12.68	13.19	13.72	14.23	15.62	8.61	9.12	9.65	10.16	11.55
	6H	13.19	13.63	14.24	14.69	16.08	9.03	9.47	10.08	10.53	11.91
	8H	13.36	13.78	14.42	14.83	16.23	9.15	9.57	10.21	10.62	12.02
	12H	13.46	13.83	14.53	14.90	16.30	9.22	9.59	10.29	10.66	12.06
8H	4H	12.64	13.06	13.69	14.11	15.51	8.88	9.30	9.94	10.35	11.75
	6H	13.21	13.55	14.28	14.64	16.04	9.40	9.74	10.48	10.84	12.24
	8H	13.42	13.72	14.51	14.80	16.22	9.59	9.89	10.68	10.97	12.39
	12H	13.56	13.82	14.65	14.90	16.36	9.71	9.98	10.80	11.05	12.51
12H	4H	12.59	12.97	13.66	14.03	15.44	8.89	9.26	9.96	10.33	11.73
	6H	13.18	13.48	14.26	14.56	15.98	9.45	9.75	10.53	10.83	12.25
	8H	13.40	13.67	14.49	14.74	16.20	9.66	9.92	10.75	11.00	12.46

END OF REPORT