

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923848

Luminaire Tested: DFN2DIP-TR4F0-090D110US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923848
REPORT IS A COMBINATION OF REPORTS P900506 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D110US940-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15502.4 lumens
Efficiency: N/A
Efficacy: 90.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 172.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

Luminous Intensity Polar Plot

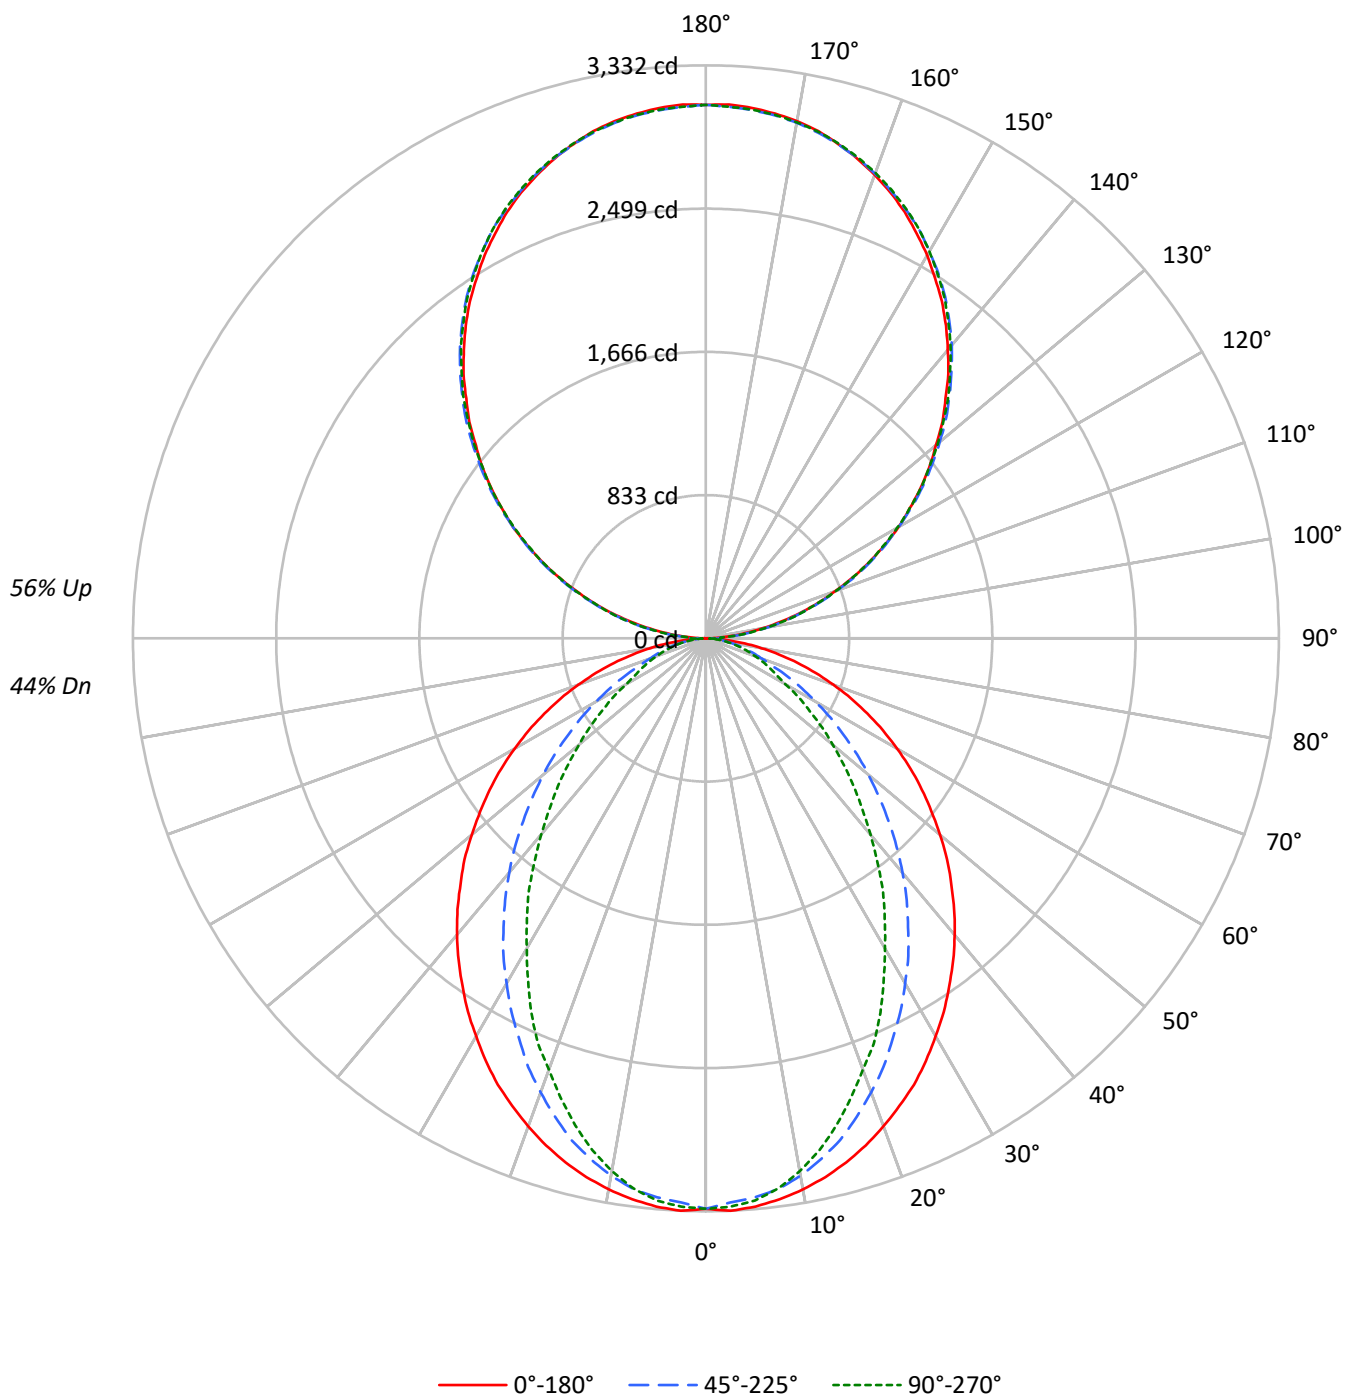

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	45	44	44
2	89	81	76	71	81	75	70	66	62	59	56	51	49	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	40	36	34	32
4	74	64	56	51	68	59	52	47	50	45	41	41	37	34	33	30	28
5	68	57	49	44	62	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	37	31	27	30	27	24	25	22	20
8	54	42	35	30	50	39	33	28	33	28	24	28	24	21	23	20	18
9	51	39	31	26	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2635	2635	2635
5°	2639	2593	2610
10°	2613	2542	2525
15°	2577	2458	2393
20°	2530	2342	2232
25°	2481	2213	2077
30°	2416	2079	1879
35°	2351	1936	1706
40°	2286	1788	1507
45°	2210	1624	1327
50°	2132	1458	1151
55°	2050	1281	982
60°	1956	1095	808
65°	1847	907	727
70°	1715	731	658
75°	1549	644	598
80°	1309	540	519
85°	912	361	390

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2417 cd/sqm

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.9	2.0
10°-20°	853.4	5.5
20°-30°	1198.1	7.7
30°-40°	1306.0	8.4
40°-50°	1200.4	7.7
50°-60°	942.7	6.1
60°-70°	613.6	4.0
70°-80°	315.9	2.0
80°-90°	89.5	0.6
90°-100°	192.0	1.2
100°-110°	609.9	3.9
110°-120°	1043.8	6.7
120°-130°	1372.7	8.9
130°-140°	1540.8	9.9
140°-150°	1511.0	9.7
150°-160°	1267.5	8.2
160°-170°	840.6	5.4
170°-180°	293.8	1.9
0°-30°	2362.4	15.2
0°-40°	3668.4	23.7
0°-60°	5811.5	37.5
0°-90°	6830.4	44.1
90°-120°	1845.7	11.9
90°-150°	6270.1	40.4
90°-180°	8672.0	55.9
0°-180°	15502.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3317	3317	3317	3317	3317	
5°	3317	3302	3263	3290	3281	315
15°	3155	3122	3020	2963	2933	889
25°	2864	2768	2570	2446	2401	1317
35°	2468	2314	2050	1861	1795	1544
45°	2017	1816	1501	1288	1216	1558
55°	1534	1300	975	796	738	1371
65°	1036	792	522	420	411	1027
75°	552	342	240	219	216	584
85°	129	66	57	57	57	148
90°	3	34	92	86	89	15
95°	136	163	167	167	163	152
105°	563	570	576	581	581	594
115°	1048	1062	1058	1055	1048	1036
125°	1524	1547	1539	1531	1528	1361
135°	1970	2000	2005	2002	1995	1523
145°	2392	2411	2426	2429	2418	1495
155°	2736	2743	2752	2765	2756	1259
165°	2976	2973	2973	2992	2979	840
175°	3097	3089	3083	3102	3086	294
180°	3102	3102	3102	3102	3102	

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3316.9	3316.9	3316.9	3316.9	3316.9
2.5°	3331.9	3316.9	3283.7	3314.0	3308.0
5°	3316.9	3301.9	3262.8	3289.8	3280.9
7.5°	3289.8	3272.0	3230.0	3241.7	3226.7
10°	3253.9	3232.8	3173.0	3163.7	3145.9
12.5°	3208.9	3181.9	3100.7	3082.8	3049.6
15°	3154.8	3121.7	3019.8	2962.7	2932.8
17.5°	3091.7	3043.7	2917.5	2851.6	2803.5
20°	3019.8	2959.6	2809.5	2734.7	2668.4
22.5°	2941.8	2872.6	2698.4	2596.5	2551.6
25°	2863.7	2767.5	2569.5	2446.5	2401.3
27.5°	2770.7	2668.4	2449.4	2308.3	2239.2
30°	2671.7	2557.3	2317.2	2164.4	2083.1
32.5°	2575.4	2437.2	2191.4	2011.2	1936.0
35°	2467.5	2314.3	2050.3	1861.2	1794.9
37.5°	2362.4	2197.2	1918.2	1710.8	1636.0
40°	2251.3	2071.4	1779.9	1566.9	1488.9
42.5°	2137.3	1945.3	1642.0	1419.8	1344.9
45°	2017.2	1816.0	1500.9	1287.5	1215.6
47.5°	1903.2	1690.1	1365.9	1152.5	1086.6
50°	1777.1	1564.0	1233.8	1026.4	963.7
52.5°	1653.9	1428.7	1107.7	909.5	852.6
55°	1533.7	1299.7	975.4	795.6	738.5
57.5°	1410.9	1170.7	858.6	690.5	642.4
60°	1284.7	1044.5	735.4	582.5	534.4
62.5°	1161.8	921.7	630.3	486.3	462.4
65°	1035.6	792.4	522.3	420.4	411.2
67.5°	915.6	672.3	420.4	369.1	360.2
70°	789.5	555.4	348.1	318.2	306.0
72.5°	669.4	447.1	291.1	267.2	261.2
75°	552.2	342.1	240.1	219.1	216.2
77.5°	435.3	243.0	189.1	177.1	171.0
80°	327.1	174.2	143.9	132.2	132.2
82.5°	228.0	117.2	99.1	93.0	93.0
85°	128.9	65.9	57.0	57.0	57.0
87.5°	48.1	23.9	23.9	21.0	21.0
90°	2.8	33.7	91.7	86.1	88.8
92.5°	58.0	78.6	81.3	84.2	84.2
95°	136.5	162.7	167.4	167.4	162.7
97.5°	227.3	251.6	261.9	261.9	261.9
100°	332.0	353.5	361.0	361.0	358.2
102.5°	442.4	458.2	468.6	471.4	468.6
105°	563.0	570.5	576.1	580.8	580.8
107.5°	682.7	693.9	693.9	695.8	682.7
110°	798.7	813.7	813.7	813.7	806.2

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	924.0	939.9	937.1	929.6	924.0
115°	1047.5	1062.4	1057.7	1055.0	1047.5
117.5°	1170.0	1190.5	1177.4	1170.0	1162.5
120°	1293.4	1314.0	1293.4	1293.4	1285.0
122.5°	1405.7	1431.8	1418.7	1411.2	1405.7
125°	1523.5	1546.8	1539.4	1531.0	1528.1
127.5°	1638.5	1667.5	1657.2	1646.0	1638.5
130°	1746.1	1779.8	1775.0	1769.4	1759.2
132.5°	1866.7	1892.9	1894.8	1881.7	1874.2
135°	1970.5	1999.5	2005.1	2002.3	1994.8
137.5°	2086.5	2109.9	2114.5	2112.6	2101.5
140°	2188.4	2211.8	2224.9	2224.9	2214.7
142.5°	2293.2	2316.6	2324.1	2326.8	2316.6
145°	2392.3	2411.0	2426.0	2428.8	2418.5
147.5°	2481.2	2504.5	2515.8	2520.4	2510.2
150°	2572.9	2588.7	2599.0	2607.5	2599.0
152.5°	2654.2	2670.0	2683.2	2693.5	2683.2
155°	2735.6	2743.0	2751.5	2764.6	2756.1
157.5°	2805.7	2811.3	2815.9	2834.7	2821.5
160°	2868.4	2874.0	2876.7	2892.7	2881.5
162.5°	2926.3	2926.3	2929.2	2946.9	2933.8
165°	2975.9	2973.1	2973.1	2991.8	2978.7
167.5°	3020.8	3012.4	3012.4	3031.1	3018.0
170°	3054.5	3047.0	3044.2	3062.8	3047.0
172.5°	3077.8	3070.3	3067.6	3086.3	3070.3
175°	3096.6	3089.1	3083.4	3102.2	3086.3
177.5°	3106.8	3099.3	3093.7	3109.7	3093.7
180°	3102.2	3102.2	3102.2	3102.2	3102.2

TEST NUMBER: P923848

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.93	10.71	10.94	11.73	13.08	5.90	6.68	6.91	7.70	9.06
	3H	11.60	12.30	12.62	13.33	14.70	7.08	7.79	8.11	8.81	10.19
	4H	12.20	12.87	13.24	13.90	15.28	7.53	8.20	8.57	9.23	10.61
	6H	12.62	13.23	13.67	14.27	15.66	7.85	8.46	8.90	9.50	10.89
	8H	12.75	13.33	13.80	14.38	15.77	7.94	8.52	8.99	9.57	10.97
	12H	12.81	13.36	13.86	14.40	15.82	7.99	8.54	9.04	9.58	11.00
4H	2H	9.94	10.60	10.98	11.63	13.02	6.49	7.15	7.53	8.18	9.57
	3H	11.76	12.31	12.81	13.37	14.77	7.84	8.39	8.89	9.44	10.84
	4H	12.45	12.96	13.51	14.01	15.43	8.38	8.89	9.44	9.94	11.36
	6H	12.97	13.40	14.03	14.47	15.89	8.80	9.23	9.87	10.31	11.72
	8H	13.14	13.54	14.21	14.61	16.04	8.93	9.33	9.99	10.40	11.83
	12H	13.23	13.60	14.32	14.68	16.11	8.99	9.36	10.08	10.44	11.87
8H	4H	12.42	12.82	13.48	13.89	15.32	8.66	9.06	9.72	10.13	11.56
	6H	12.98	13.32	14.07	14.42	15.85	9.18	9.51	10.27	10.62	12.04
	8H	13.20	13.49	14.29	14.58	16.03	9.37	9.66	10.46	10.75	12.20
	12H	13.33	13.59	14.43	14.68	16.16	9.49	9.74	10.58	10.83	12.32
12H	4H	12.37	12.73	13.45	13.81	15.25	8.66	9.03	9.74	10.11	11.54
	6H	12.96	13.25	14.05	14.34	15.79	9.23	9.52	10.32	10.61	12.06
	8H	13.18	13.43	14.27	14.52	16.00	9.44	9.69	10.53	10.78	12.26

END OF REPORT