

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923878

Luminaire Tested: DFN2DIP-TR4F0-100D100US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923878
REPORT IS A COMBINATION OF REPORTS P900489 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D100US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16719.6 lumens
Efficiency: N/A
Efficacy: 94.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 177.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

Luminous Intensity Polar Plot

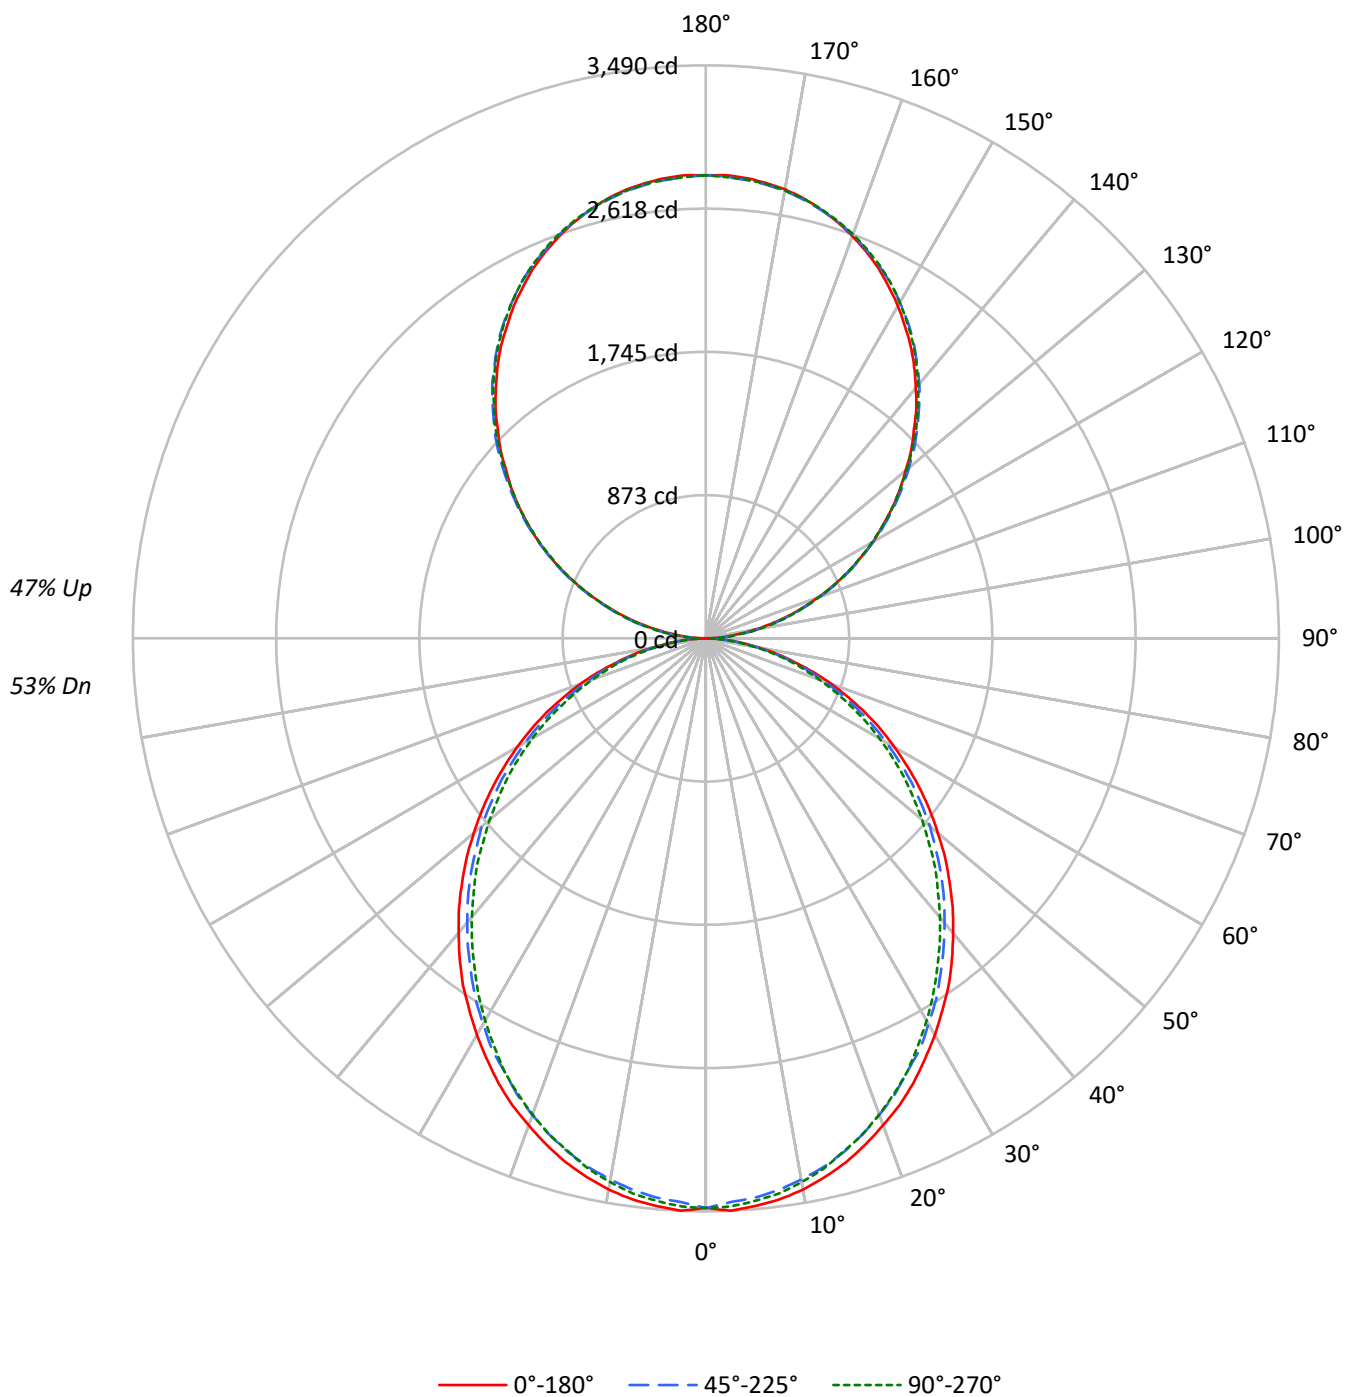

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2756	2756	2756
5°	2761	2718	2736
10°	2739	2681	2699
15°	2698	2637	2641
20°	2644	2576	2582
25°	2590	2503	2513
30°	2522	2434	2426
35°	2458	2354	2334
40°	2379	2272	2246
45°	2300	2191	2156
50°	2213	2105	2052
55°	2123	2006	1957
60°	2021	1889	1847
65°	1910	1767	1718
70°	1768	1619	1579
75°	1572	1441	1450
80°	1336	1215	1205
85°	966	825	798

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2300 cd/sqm

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	2.0
10°-20°	918.8	5.5
20°-30°	1350.3	8.1
30°-40°	1568.3	9.4
40°-50°	1566.4	9.4
50°-60°	1365.8	8.2
60°-70°	1009.7	6.0
70°-80°	571.3	3.4
80°-90°	158.8	0.9
90°-100°	174.5	1.0
100°-110°	554.5	3.3
110°-120°	948.9	5.7
120°-130°	1247.9	7.5
130°-140°	1400.8	8.4
140°-150°	1373.6	8.2
150°-160°	1152.3	6.9
160°-170°	764.1	4.6
170°-180°	267.1	1.6
0°-30°	2595.7	15.5
0°-40°	4164.0	24.9
0°-60°	7096.2	42.4
0°-90°	8835.9	52.8
90°-120°	1677.9	10.0
90°-150°	5700.1	34.1
90°-180°	7884.0	47.2
0°-180°	16719.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	3	31	83	78	81	16
95°	124	148	152	152	148	138
105°	512	519	524	528	528	540
115°	952	966	962	959	952	942
125°	1385	1406	1400	1392	1389	1238
135°	1791	1818	1823	1820	1814	1385
145°	2175	2192	2206	2208	2199	1359
155°	2487	2494	2501	2513	2506	1145
165°	2705	2703	2703	2720	2708	763
175°	2815	2808	2803	2820	2806	267
180°	2820	2820	2820	2820	2820	

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	2.6	30.6	83.3	78.2	80.8
92.5°	52.7	71.4	74.0	76.5	76.5
95°	124.1	147.9	152.2	152.2	147.9
97.5°	206.6	228.7	238.1	238.1	238.1
100°	301.8	321.4	328.1	328.1	325.7
102.5°	402.2	416.6	426.0	428.5	426.0
105°	511.8	518.6	523.7	528.0	528.0
107.5°	620.6	630.9	630.9	632.6	620.6
110°	726.1	739.7	739.7	739.7	732.9

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	840.0	854.4	851.9	845.1	840.0
115°	952.3	965.8	961.6	959.0	952.3
117.5°	1063.6	1082.4	1070.4	1063.6	1056.8
120°	1175.8	1194.5	1175.8	1175.8	1168.2
122.5°	1277.8	1301.6	1289.8	1283.0	1277.8
125°	1385.0	1406.2	1399.5	1391.8	1389.3
127.5°	1489.6	1515.9	1506.5	1496.4	1489.6
130°	1587.3	1617.9	1613.7	1608.6	1599.3
132.5°	1697.0	1720.8	1722.5	1710.7	1703.8
135°	1791.4	1817.8	1822.8	1820.3	1813.5
137.5°	1896.8	1918.1	1922.3	1920.7	1910.4
140°	1989.5	2010.7	2022.7	2022.7	2013.3
142.5°	2084.7	2106.0	2112.7	2115.3	2106.0
145°	2174.8	2191.8	2205.5	2208.0	2198.6
147.5°	2255.6	2276.9	2287.1	2291.3	2282.0
150°	2339.0	2353.4	2362.8	2370.3	2362.8
152.5°	2412.9	2427.3	2439.3	2448.6	2439.3
155°	2486.9	2493.7	2501.3	2513.2	2505.5
157.5°	2550.6	2555.7	2560.0	2577.0	2565.1
160°	2607.6	2612.7	2615.2	2629.7	2619.5
162.5°	2660.3	2660.3	2662.8	2679.0	2667.1
165°	2705.4	2702.8	2702.8	2719.8	2707.9
167.5°	2746.2	2738.5	2738.5	2755.6	2743.6
170°	2776.8	2770.0	2767.4	2784.5	2770.0
172.5°	2798.0	2791.2	2788.6	2805.7	2791.2
175°	2815.0	2808.3	2803.2	2820.1	2805.7
177.5°	2824.4	2817.6	2812.5	2826.9	2812.5
180°	2820.1	2820.1	2820.1	2820.1	2820.1

TEST NUMBER: P923878

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.05	11.94	11.98	12.89	14.12	10.62	11.50	11.55	12.45	13.68
	3H	12.71	13.51	13.65	14.46	15.72	12.24	13.03	13.18	13.99	15.25
	4H	13.30	14.05	14.26	15.02	16.28	12.83	13.58	13.78	14.54	15.80
	6H	13.70	14.39	14.67	15.36	16.64	13.22	13.92	14.19	14.89	16.16
	8H	13.80	14.47	14.78	15.45	16.72	13.33	13.99	14.31	14.98	16.25
	12H	13.85	14.48	14.84	15.46	16.76	13.37	14.00	14.36	14.98	16.28
4H	2H	11.51	12.27	12.48	13.23	14.49	11.17	11.92	12.13	12.89	14.15
	3H	13.38	14.01	14.35	15.00	16.28	12.99	13.62	13.96	14.61	15.89
	4H	14.10	14.67	15.08	15.66	16.96	13.69	14.27	14.67	15.25	16.55
	6H	14.61	15.11	15.61	16.12	17.42	14.20	14.70	15.20	15.71	17.01
	8H	14.76	15.23	15.76	16.23	17.54	14.35	14.81	15.35	15.82	17.13
	12H	14.84	15.26	15.85	16.27	17.59	14.42	14.83	15.43	15.85	17.17
8H	4H	14.29	14.76	15.29	15.76	17.07	13.93	14.40	14.93	15.40	16.71
	6H	14.93	15.31	15.95	16.36	17.67	14.56	14.95	15.59	15.99	17.30
	8H	15.15	15.49	16.18	16.52	17.85	14.78	15.12	15.81	16.15	17.48
	12H	15.28	15.58	16.31	16.60	17.98	14.90	15.19	15.93	16.22	17.59
12H	4H	14.28	14.70	15.30	15.72	17.04	13.93	14.35	14.95	15.37	16.69
	6H	14.96	15.30	15.99	16.33	17.66	14.61	14.94	15.64	15.98	17.31
	8H	15.20	15.50	16.23	16.52	17.90	14.84	15.14	15.88	16.17	17.54

END OF REPORT