

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923884

Luminaire Tested: DFN2DIP-TR4F0-100D110US940-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923884
REPORT IS A COMBINATION OF REPORTS P900508 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D110US940-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16260.3 lumens
Efficiency: N/A
Efficacy: 87.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 185.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLLFLL

Luminous Intensity Polar Plot

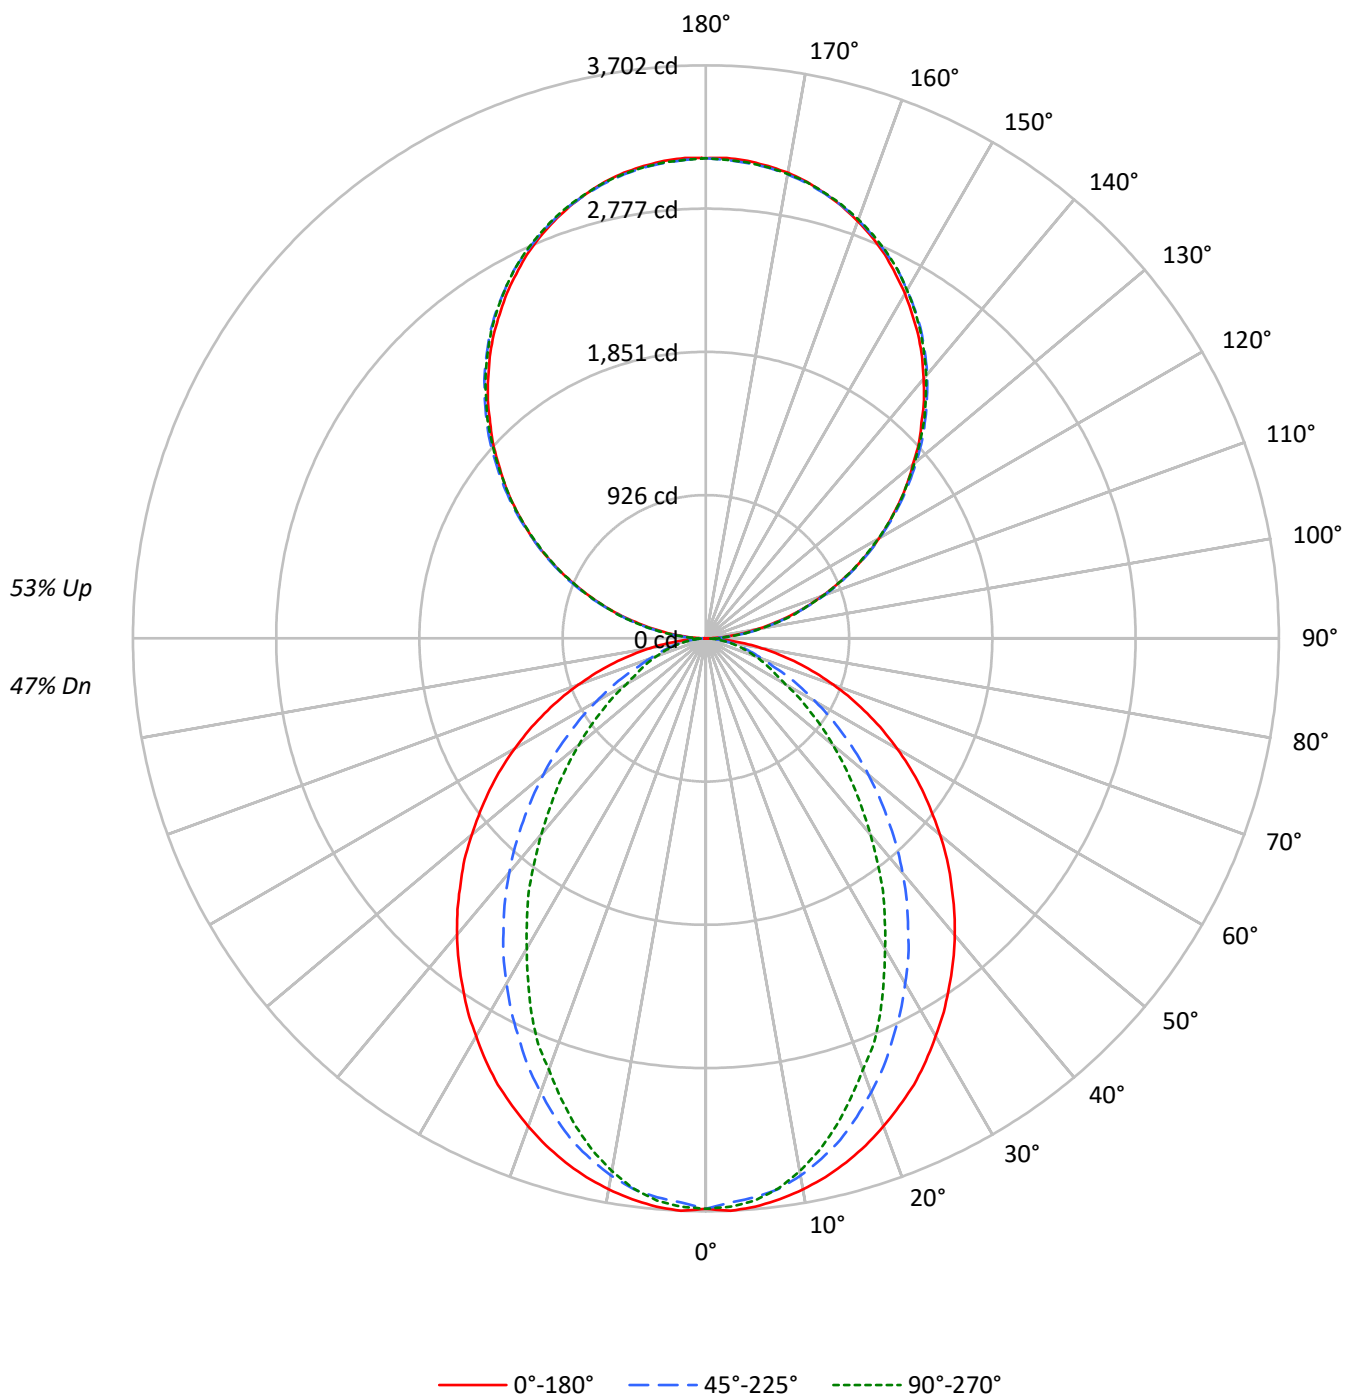

TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	67	67	67	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	48	47	46
2	89	82	76	71	82	76	71	66	64	60	57	53	50	48	42	41	39
3	82	72	65	60	75	67	61	56	57	52	48	47	44	41	38	36	34
4	75	64	57	51	69	60	53	48	51	46	42	42	38	35	34	32	30
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	64	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	32	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	23	27	23	20	22	19	17
10	48	36	29	24	44	34	27	23	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2928	2928	2928
5°	2933	2881	2900
10°	2904	2825	2805
15°	2864	2731	2659
20°	2811	2603	2480
25°	2757	2458	2307
30°	2684	2310	2088
35°	2613	2151	1895
40°	2540	1987	1675
45°	2456	1804	1474
50°	2369	1620	1279
55°	2278	1423	1091
60°	2173	1217	898
65°	2052	1008	808
70°	1905	812	731
75°	1721	716	665
80°	1454	601	577
85°	1013	401	433

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2456 cd/sqm

TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	345.4	2.1
10°-20°	948.2	5.8
20°-30°	1331.2	8.2
30°-40°	1451.1	8.9
40°-50°	1333.8	8.2
50°-60°	1047.4	6.4
60°-70°	681.8	4.2
70°-80°	351.0	2.2
80°-90°	98.4	0.6
90°-100°	192.0	1.2
100°-110°	609.9	3.8
110°-120°	1043.8	6.4
120°-130°	1372.7	8.4
130°-140°	1540.8	9.5
140°-150°	1511.0	9.3
150°-160°	1267.5	7.8
160°-170°	840.6	5.2
170°-180°	293.8	1.8
0°-30°	2624.8	16.1
0°-40°	4076.0	25.1
0°-60°	6457.2	39.7
0°-90°	7588.3	46.7
90°-120°	1845.7	11.4
90°-150°	6270.1	38.6
90°-180°	8672.0	53.3
0°-180°	16260.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3685	3685	3685	3685	3685	
5°	3685	3669	3625	3655	3645	349
15°	3505	3468	3355	3292	3259	988
25°	3182	3075	2855	2718	2668	1463
35°	2742	2572	2278	2068	1994	1716
45°	2241	2018	1668	1431	1351	1731
55°	1704	1444	1084	884	821	1523
65°	1151	880	580	467	457	1141
75°	614	380	267	243	240	649
85°	143	73	63	63	63	164
90°	3	34	92	86	89	16
95°	136	163	167	167	163	152
105°	563	570	576	581	581	594
115°	1048	1062	1058	1055	1048	1036
125°	1524	1547	1539	1531	1528	1361
135°	1970	2000	2005	2002	1995	1523
145°	2392	2411	2426	2429	2418	1495
155°	2736	2743	2752	2765	2756	1259
165°	2976	2973	2973	2992	2979	840
175°	3097	3089	3083	3102	3086	294
180°	3102	3102	3102	3102	3102	

TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3685.4	3685.4	3685.4	3685.4	3685.4
2.5°	3702.0	3685.4	3648.6	3682.2	3675.5
5°	3685.4	3668.8	3625.2	3655.4	3645.4
7.5°	3655.4	3635.5	3588.8	3601.9	3585.3
10°	3615.4	3592.0	3525.5	3515.2	3495.4
12.5°	3565.5	3535.4	3445.1	3425.3	3388.5
15°	3505.3	3468.5	3355.2	3291.9	3258.7
17.5°	3435.2	3381.8	3241.7	3168.4	3115.0
20°	3355.2	3288.4	3121.7	3038.6	2964.9
22.5°	3268.6	3191.8	2998.2	2885.0	2835.1
25°	3181.9	3075.1	2854.9	2718.3	2668.1
27.5°	3078.5	2964.9	2721.5	2564.7	2488.0
30°	2968.5	2841.4	2574.6	2404.9	2314.6
32.5°	2861.7	2708.0	2434.9	2234.6	2151.1
35°	2741.7	2571.5	2278.1	2068.0	1994.3
37.5°	2624.9	2441.2	2131.3	1900.9	1817.8
40°	2501.4	2301.5	1977.7	1741.0	1654.3
42.5°	2374.7	2161.3	1824.5	1577.5	1494.3
45°	2241.3	2017.7	1667.8	1430.7	1350.7
47.5°	2114.7	1877.9	1517.7	1280.6	1207.4
50°	1974.5	1737.8	1370.8	1140.5	1070.8
52.5°	1837.5	1587.4	1230.7	1010.6	947.3
55°	1704.1	1444.1	1083.9	884.0	820.6
57.5°	1567.6	1300.7	954.0	767.1	713.7
60°	1427.4	1160.7	817.1	647.2	593.8
62.5°	1290.8	1024.0	700.3	540.4	513.8
65°	1150.8	880.4	580.3	467.1	456.8
67.5°	1017.4	747.0	467.1	410.1	400.2
70°	877.2	617.2	386.7	353.5	340.1
72.5°	743.8	496.8	323.4	296.9	290.2
75°	613.6	380.0	266.8	243.4	240.2
77.5°	483.8	270.0	210.2	196.7	190.0
80°	363.4	193.6	160.0	146.9	146.9
82.5°	253.3	130.2	110.0	103.3	103.3
85°	143.3	73.2	63.3	63.3	63.3
87.5°	53.4	26.6	26.6	23.4	23.4
90°	2.8	33.7	91.7	86.1	88.8
92.5°	58.0	78.6	81.3	84.2	84.2
95°	136.5	162.7	167.4	167.4	162.7
97.5°	227.3	251.6	261.9	261.9	261.9
100°	332.0	353.5	361.0	361.0	358.2
102.5°	442.4	458.2	468.6	471.4	468.6
105°	563.0	570.5	576.1	580.8	580.8
107.5°	682.7	693.9	693.9	695.8	682.7
110°	798.7	813.7	813.7	813.7	806.2



TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	924.0	939.9	937.1	929.6	924.0
115°	1047.5	1062.4	1057.7	1055.0	1047.5
117.5°	1170.0	1190.5	1177.4	1170.0	1162.5
120°	1293.4	1314.0	1293.4	1293.4	1285.0
122.5°	1405.7	1431.8	1418.7	1411.2	1405.7
125°	1523.5	1546.8	1539.4	1531.0	1528.1
127.5°	1638.5	1667.5	1657.2	1646.0	1638.5
130°	1746.1	1779.8	1775.0	1769.4	1759.2
132.5°	1866.7	1892.9	1894.8	1881.7	1874.2
135°	1970.5	1999.5	2005.1	2002.3	1994.8
137.5°	2086.5	2109.9	2114.5	2112.6	2101.5
140°	2188.4	2211.8	2224.9	2224.9	2214.7
142.5°	2293.2	2316.6	2324.1	2326.8	2316.6
145°	2392.3	2411.0	2426.0	2428.8	2418.5
147.5°	2481.2	2504.5	2515.8	2520.4	2510.2
150°	2572.9	2588.7	2599.0	2607.5	2599.0
152.5°	2654.2	2670.0	2683.2	2693.5	2683.2
155°	2735.6	2743.0	2751.5	2764.6	2756.1
157.5°	2805.7	2811.3	2815.9	2834.7	2821.5
160°	2868.4	2874.0	2876.7	2892.7	2881.5
162.5°	2926.3	2926.3	2929.2	2946.9	2933.8
165°	2975.9	2973.1	2973.1	2991.8	2978.7
167.5°	3020.8	3012.4	3012.4	3031.1	3018.0
170°	3054.5	3047.0	3044.2	3062.8	3047.0
172.5°	3077.8	3070.3	3067.6	3086.3	3070.3
175°	3096.6	3089.1	3083.4	3102.2	3086.3
177.5°	3106.8	3099.3	3093.7	3109.7	3093.7
180°	3102.2	3102.2	3102.2	3102.2	3102.2

TEST NUMBER: P923884

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.55	11.36	11.54	12.36	13.68	6.53	7.33	7.52	8.33	9.65
	3H	12.23	12.95	13.23	13.95	15.30	7.71	8.43	8.72	9.44	10.78
	4H	12.83	13.51	13.85	14.53	15.88	8.16	8.84	9.18	9.85	11.20
	6H	13.26	13.88	14.28	14.90	16.26	8.48	9.11	9.51	10.13	11.49
	8H	13.38	13.98	14.41	15.01	16.37	8.57	9.17	9.61	10.20	11.56
	12H	13.44	14.01	14.48	15.03	16.41	8.62	9.18	9.65	10.21	11.59
4H	2H	10.57	11.25	11.59	12.26	13.61	7.12	7.80	8.14	8.81	10.16
	3H	12.39	12.96	13.42	14.00	15.36	8.47	9.03	9.50	10.07	11.43
	4H	13.09	13.60	14.12	14.63	16.02	9.01	9.53	10.05	10.56	11.95
	6H	13.60	14.04	14.65	15.10	16.48	9.43	9.88	10.48	10.93	12.31
	8H	13.77	14.19	14.82	15.24	16.63	9.56	9.98	10.61	11.02	12.42
	12H	13.87	14.24	14.93	15.30	16.71	9.63	10.00	10.69	11.06	12.46
8H	4H	13.05	13.47	14.10	14.51	15.91	9.29	9.71	10.34	10.75	12.15
	6H	13.62	13.96	14.69	15.05	16.44	9.81	10.15	10.88	11.24	12.64
	8H	13.83	14.13	14.91	15.21	16.62	10.00	10.30	11.08	11.38	12.79
	12H	13.97	14.23	15.05	15.30	16.76	10.12	10.39	11.20	11.45	12.91
12H	4H	13.00	13.38	14.07	14.44	15.84	9.30	9.67	10.36	10.73	12.13
	6H	13.59	13.89	14.67	14.97	16.38	9.86	10.16	10.94	11.23	12.65
	8H	13.81	14.08	14.89	15.14	16.60	10.07	10.33	11.15	11.40	12.86