

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923902

Luminaire Tested: DFN2DIP-TR4F0-110D070US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923902
REPORT IS A COMBINATION OF REPORTS P900437 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D070US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15235.0 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 164.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFLL

Luminous Intensity Polar Plot

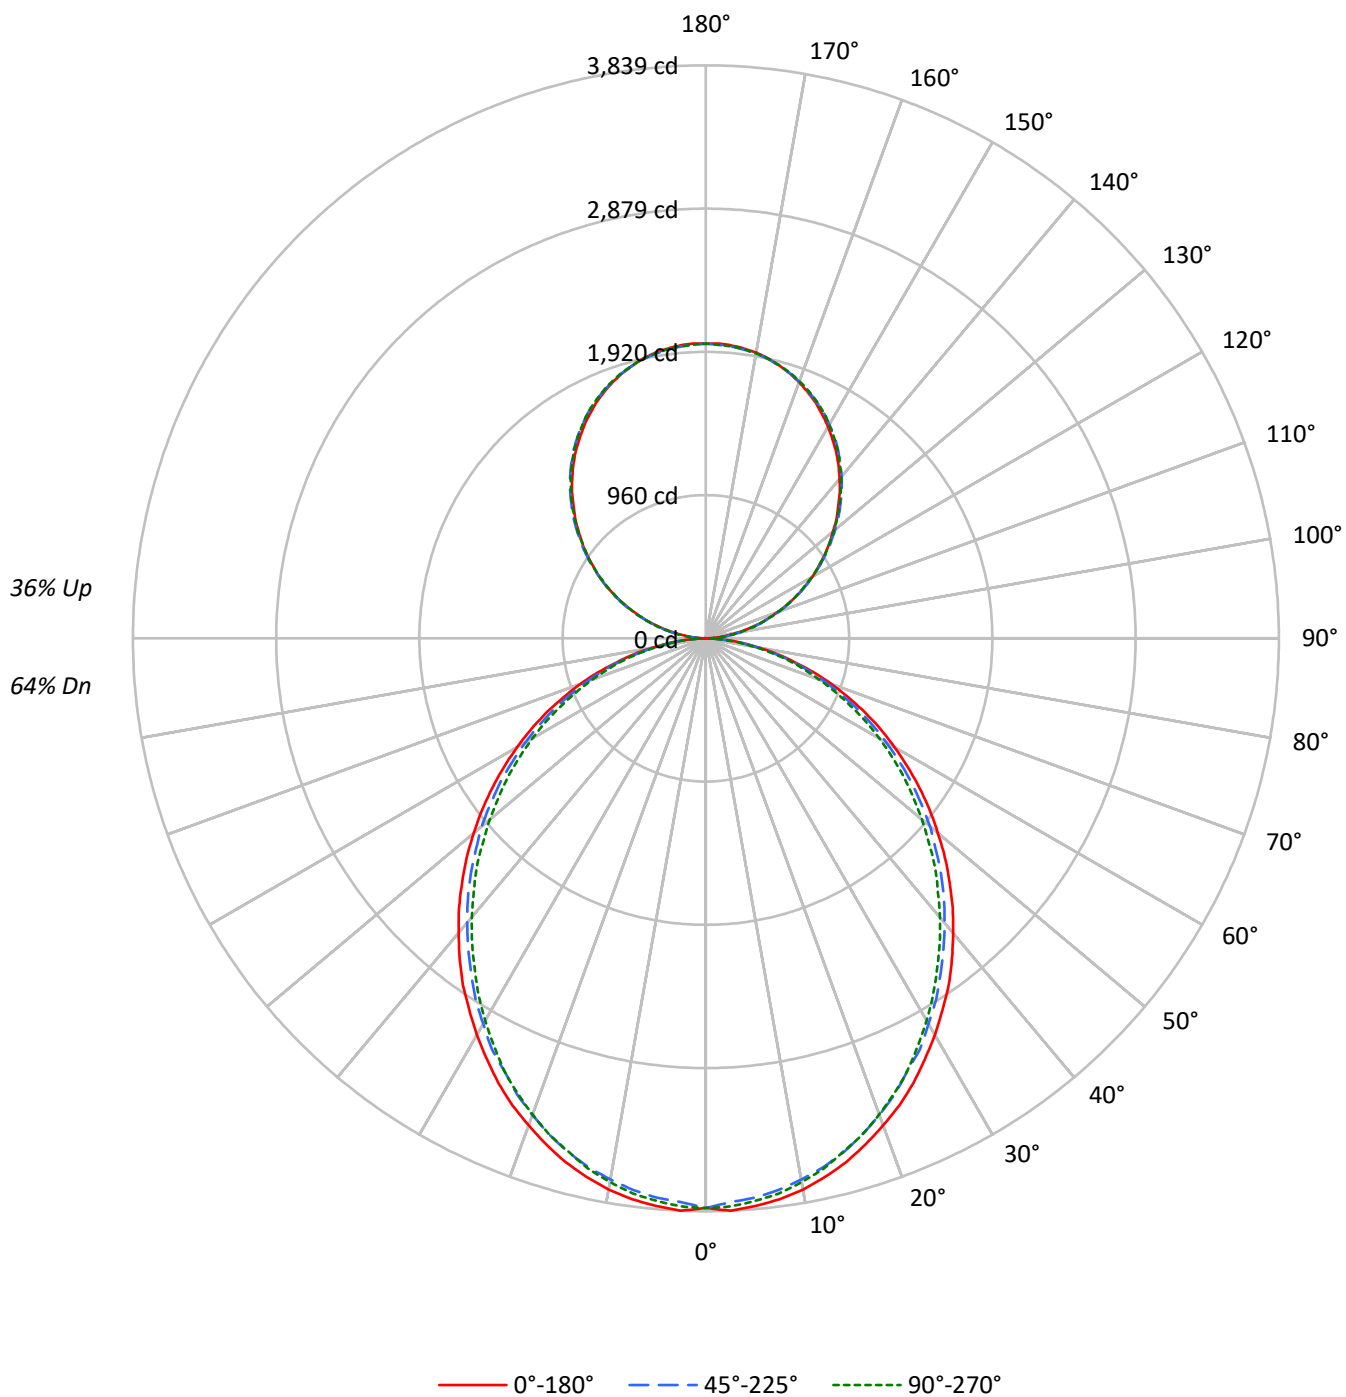

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91		79	79	79		69
1	101	96	92	89	95	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		61	58	55		54
3	84	74	67	61	78	70	63	58	62	57	52		54	50	47		47
4	77	66	58	51	72	62	55	49	55	49	45		48	44	40		42
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	44	38	34		39	34	31		35
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	52	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3032	3032	3032
5°	3037	2990	3010
10°	3012	2950	2969
15°	2968	2901	2905
20°	2908	2833	2840
25°	2849	2753	2765
30°	2774	2678	2669
35°	2704	2589	2567
40°	2616	2500	2471
45°	2530	2410	2372
50°	2435	2316	2257
55°	2335	2207	2152
60°	2223	2077	2032
65°	2101	1944	1890
70°	1945	1781	1736
75°	1729	1585	1595
80°	1469	1336	1325
85°	1063	907	878

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2530 cd/sqm

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	2.4
10°-20°	1010.7	6.6
20°-30°	1485.4	9.7
30°-40°	1725.2	11.3
40°-50°	1723.0	11.3
50°-60°	1502.4	9.9
60°-70°	1110.6	7.3
70°-80°	628.4	4.1
80°-90°	171.5	1.1
90°-100°	122.2	0.8
100°-110°	388.1	2.5
110°-120°	664.2	4.4
120°-130°	873.6	5.7
130°-140°	980.5	6.4
140°-150°	961.5	6.3
150°-160°	806.6	5.3
160°-170°	534.9	3.5
170°-180°	187.0	1.2
0°-30°	2855.3	18.7
0°-40°	4580.5	30.1
0°-60°	7805.9	51.2
0°-90°	9716.4	63.8
90°-120°	1174.5	7.7
90°-150°	3990.1	26.2
90°-180°	5519.0	36.2
0°-180°	15235.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	2	21	58	55	56	15
95°	87	104	107	107	104	97
105°	358	363	367	370	370	378
115°	667	676	673	671	667	659
125°	970	984	980	974	972	866
135°	1254	1272	1276	1274	1269	969
145°	1522	1534	1544	1546	1539	951
155°	1741	1746	1751	1759	1754	801
165°	1894	1892	1892	1904	1896	534
175°	1970	1966	1962	1974	1964	187
180°	1974	1974	1974	1974	1974	

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	1.8	21.4	58.3	54.8	56.5
92.5°	36.9	50.0	51.8	53.6	53.6
95°	86.9	103.5	106.6	106.6	103.5
97.5°	144.6	160.1	166.7	166.7	166.7
100°	211.2	225.0	229.7	229.7	227.9
102.5°	281.5	291.6	298.2	300.0	298.2
105°	358.3	363.0	366.6	369.6	369.6
107.5°	434.4	441.6	441.6	442.8	434.4
110°	508.3	517.8	517.8	517.8	513.0

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.0	598.2	596.4	591.6	588.0
115°	666.6	676.1	673.2	671.4	666.6
117.5°	744.5	757.6	749.3	744.5	739.8
120°	823.0	836.2	823.0	823.0	817.7
122.5°	894.5	911.1	902.9	898.0	894.5
125°	969.5	984.4	979.6	974.3	972.5
127.5°	1042.7	1061.1	1054.6	1047.5	1042.7
130°	1111.2	1132.6	1129.6	1126.1	1119.5
132.5°	1187.9	1204.6	1205.8	1197.5	1192.7
135°	1254.0	1272.4	1276.0	1274.2	1269.4
137.5°	1327.8	1342.6	1345.6	1344.4	1337.3
140°	1392.7	1407.6	1415.9	1415.9	1409.3
142.5°	1459.3	1474.2	1478.9	1480.7	1474.2
145°	1522.4	1534.3	1543.8	1545.6	1539.1
147.5°	1579.0	1593.8	1601.0	1603.9	1597.4
150°	1637.3	1647.3	1653.9	1659.3	1653.9
152.5°	1689.0	1699.2	1707.4	1714.0	1707.4
155°	1740.8	1745.5	1751.0	1759.3	1753.9
157.5°	1785.5	1789.0	1792.0	1803.9	1795.5
160°	1825.3	1828.9	1830.7	1840.8	1833.6
162.5°	1862.2	1862.2	1864.0	1875.3	1867.0
165°	1893.7	1891.9	1891.9	1903.9	1895.5
167.5°	1922.3	1917.0	1917.0	1928.9	1920.6
170°	1943.8	1939.0	1937.2	1949.1	1939.0
172.5°	1958.6	1953.8	1952.0	1964.0	1953.8
175°	1970.5	1965.8	1962.2	1974.1	1964.0
177.5°	1977.1	1972.3	1968.7	1978.9	1968.7
180°	1974.1	1974.1	1974.1	1974.1	1974.1

TEST NUMBER: P923902

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US940-FLLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.30	13.30	13.13	14.15	15.21	11.87	12.87	12.70	13.72	14.78
	3H	13.97	14.87	14.81	15.73	16.82	13.50	14.40	14.34	15.26	16.35
	4H	14.57	15.42	15.42	16.28	17.38	14.09	14.94	14.95	15.81	16.91
	6H	14.97	15.76	15.84	16.63	17.74	14.50	15.28	15.37	16.16	17.27
	8H	15.08	15.83	15.96	16.72	17.83	14.61	15.35	15.49	16.25	17.36
	12H	15.13	15.85	16.02	16.73	17.87	14.65	15.36	15.54	16.25	17.39
4H	2H	12.78	13.63	13.64	14.50	15.60	12.44	13.28	13.30	14.15	15.25
	3H	14.66	15.37	15.53	16.27	17.38	14.27	14.97	15.14	15.88	16.99
	4H	15.38	16.02	16.27	16.92	18.06	14.97	15.62	15.86	16.52	17.66
	6H	15.90	16.46	16.80	17.38	18.52	15.49	16.05	16.39	16.97	18.11
	8H	16.05	16.58	16.96	17.49	18.65	15.64	16.16	16.55	17.08	18.24
	12H	16.13	16.60	17.06	17.54	18.70	15.71	16.18	16.64	17.12	18.28
8H	4H	15.59	16.11	16.49	17.02	18.18	15.23	15.75	16.13	16.66	17.82
	6H	16.22	16.66	17.15	17.61	18.77	15.86	16.29	16.79	17.25	18.41
	8H	16.45	16.83	17.39	17.78	18.95	16.08	16.46	17.02	17.41	18.58
	12H	16.58	16.92	17.53	17.86	19.08	16.20	16.54	17.14	17.48	18.70
12H	4H	15.58	16.05	16.50	16.98	18.14	15.23	15.70	16.15	16.63	17.79
	6H	16.25	16.64	17.20	17.59	18.76	15.90	16.29	16.84	17.24	18.41
	8H	16.50	16.84	17.45	17.78	19.00	16.15	16.48	17.09	17.42	18.65

END OF REPORT