

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923919

Luminaire Tested: DFN2DIP-TR4F0-110D110US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923919
REPORT IS A COMBINATION OF REPORTS P902029 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D110US940-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19421.5 lumens
Efficiency: N/A
Efficacy: 98.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 197.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLLONL

Luminous Intensity Polar Plot

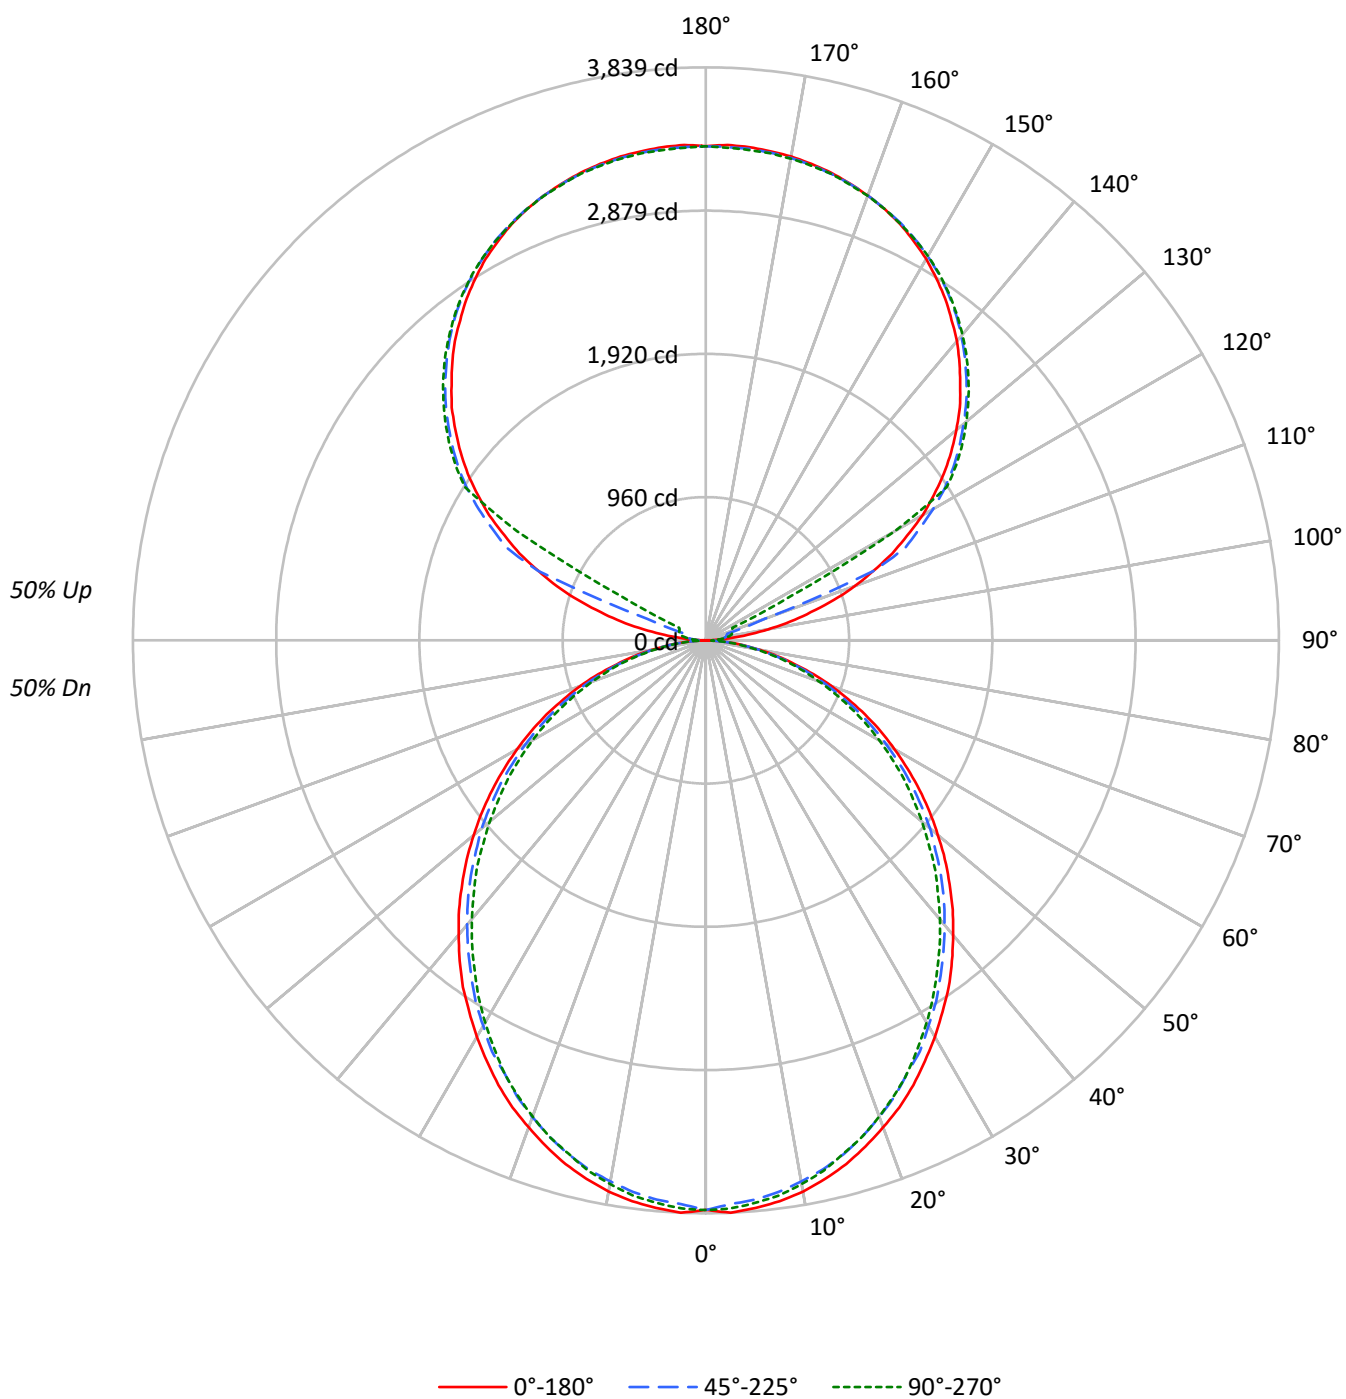

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83		69	69	69		56
1	98	93	90	86	90	86	83	80	73	71	68		61	59	58		50
2	89	82	75	70	82	76	70	66	64	60	57		53	51	48		44
3	81	72	64	59	75	66	60	55	56	52	48		47	44	41		39
4	74	64	56	50	68	59	52	47	50	45	41		42	38	35		35
5	68	57	48	42	63	53	45	40	45	39	35		38	34	30		31
6	63	51	43	37	58	47	40	35	40	35	31		34	30	27		28
7	58	46	38	32	53	43	36	30	37	31	27		31	27	23		26
8	54	42	34	29	50	39	32	27	33	28	24		28	24	21		24
9	50	38	30	25	46	35	29	24	31	25	21		26	22	19		22
10	47	35	28	23	43	33	26	22	28	23	19		24	20	17		20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3032	3032	3032
5°	3037	2990	3010
10°	3012	2950	2969
15°	2968	2901	2905
20°	2908	2833	2840
25°	2849	2753	2765
30°	2774	2678	2669
35°	2704	2589	2567
40°	2616	2500	2471
45°	2530	2410	2372
50°	2435	2316	2257
55°	2335	2207	2152
60°	2223	2077	2032
65°	2101	1944	1890
70°	1945	1781	1736
75°	1729	1585	1595
80°	1469	1336	1325
85°	1063	907	878

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2530 cd/sqm

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	1.8
10°-20°	1010.7	5.2
20°-30°	1485.4	7.6
30°-40°	1725.2	8.9
40°-50°	1723.0	8.9
50°-60°	1502.4	7.7
60°-70°	1110.6	5.7
70°-80°	628.4	3.2
80°-90°	171.7	0.9
90°-100°	109.2	0.6
100°-110°	406.9	2.1
110°-120°	1079.2	5.6
120°-130°	1789.9	9.2
130°-140°	1901.3	9.8
140°-150°	1767.1	9.1
150°-160°	1420.7	7.3
160°-170°	915.4	4.7
170°-180°	315.1	1.6
0°-30°	2855.3	14.7
0°-40°	4580.5	23.6
0°-60°	7805.9	40.2
0°-90°	9716.6	50.0
90°-120°	1595.3	8.2
90°-150°	7053.7	36.3
90°-180°	9705.0	50.0
0°-180°	19421.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	2	29	48	60	65	18
95°	156	76	93	106	103	184
105°	728	800	146	172	182	778
115°	1377	1418	1478	369	196	1356
125°	1947	1979	2024	2041	2048	1737
135°	2410	2448	2470	2494	2489	1862
145°	2796	2793	2834	2850	2838	1748
155°	3078	3057	3085	3100	3080	1418
165°	3243	3229	3236	3253	3236	916
175°	3317	3301	3306	3322	3298	316
180°	3310	3310	3310	3310	3310	

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	2.3	28.7	47.8	60.0	64.6
92.5°	60.0	50.4	57.4	62.3	64.6
95°	155.6	76.5	93.3	105.5	103.0
97.5°	280.2	83.9	122.0	129.4	131.7
100°	424.1	95.9	136.5	155.6	160.4
102.5°	581.9	577.4	141.3	167.6	175.0
105°	728.2	800.1	146.2	172.4	182.1
107.5°	898.3	958.0	151.1	177.2	186.9
110°	1061.2	1111.3	419.3	179.8	189.1

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1214.6	1257.5	1216.8	184.3	191.7
115°	1377.2	1417.9	1478.0	368.9	196.5
117.5°	1518.7	1566.5	1607.4	1264.6	637.1
120°	1676.8	1712.6	1755.9	1784.6	1461.2
122.5°	1810.8	1849.1	1897.2	1911.5	1914.1
125°	1947.3	1978.6	2024.1	2040.9	2048.0
127.5°	2071.9	2105.4	2141.5	2165.4	2167.7
130°	2189.3	2227.8	2253.9	2280.4	2278.1
132.5°	2309.1	2340.4	2366.6	2388.2	2385.9
135°	2409.8	2448.2	2469.5	2493.8	2488.9
137.5°	2515.1	2543.8	2567.9	2591.8	2584.7
140°	2618.1	2637.3	2663.5	2685.1	2673.2
142.5°	2704.5	2721.2	2752.3	2771.3	2759.4
145°	2795.5	2792.9	2833.6	2850.4	2838.5
147.5°	2874.3	2867.2	2907.9	2919.8	2910.5
150°	2951.1	2934.4	2972.7	2987.0	2975.0
152.5°	3015.7	2996.6	3032.4	3047.0	3030.2
155°	3078.0	3056.6	3085.3	3099.6	3080.5
157.5°	3128.3	3109.2	3130.9	3147.6	3128.3
160°	3171.5	3157.0	3171.5	3185.7	3169.0
162.5°	3209.6	3195.4	3207.4	3224.2	3202.6
165°	3243.2	3229.0	3236.1	3252.9	3236.1
167.5°	3269.6	3255.2	3262.6	3279.4	3257.8
170°	3291.3	3276.8	3281.6	3298.4	3276.8
172.5°	3305.5	3291.3	3296.1	3312.9	3291.3
175°	3317.4	3300.7	3305.5	3322.3	3298.4
177.5°	3322.3	3305.5	3308.1	3324.8	3303.3
180°	3310.4	3310.4	3310.4	3310.4	3310.4

TEST NUMBER: P923919

CATALOG NUMBER: DFN2DIP-TR4F0-110D110US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.12	11.99	12.08	12.96	14.23	10.69	11.55	11.65	12.53	13.80
	3H	12.78	13.56	13.75	14.54	15.83	12.31	13.08	13.28	14.07	15.36
	4H	13.37	14.10	14.35	15.09	16.39	12.90	13.63	13.88	14.61	15.92
	6H	13.77	14.44	14.76	15.44	16.75	13.30	13.97	14.29	14.96	16.27
	8H	13.88	14.52	14.87	15.52	16.84	13.40	14.04	14.40	15.05	16.36
	12H	13.92	14.53	14.93	15.54	16.87	13.44	14.05	14.45	15.05	16.39
4H	2H	11.59	12.32	12.57	13.30	14.60	11.24	11.97	12.23	12.96	14.26
	3H	13.45	14.06	14.45	15.08	16.39	13.06	13.67	14.06	14.68	16.00
	4H	14.17	14.72	15.17	15.73	17.07	13.76	14.32	14.77	15.33	16.66
	6H	14.68	15.16	15.70	16.19	17.53	14.27	14.75	15.29	15.78	17.12
	8H	14.83	15.28	15.85	16.30	17.65	14.42	14.87	15.44	15.89	17.24
	12H	14.90	15.31	15.94	16.35	17.70	14.48	14.89	15.52	15.93	17.28
8H	4H	14.36	14.81	15.38	15.84	17.19	14.00	14.45	15.02	15.48	16.83
	6H	14.99	15.37	16.04	16.43	17.78	14.63	15.00	15.67	16.07	17.42
	8H	15.21	15.54	16.26	16.59	17.96	14.85	15.17	15.90	16.22	17.59
	12H	15.35	15.63	16.40	16.68	18.09	14.96	15.25	16.02	16.30	17.71
12H	4H	14.35	14.75	15.38	15.79	17.15	14.00	14.40	15.03	15.44	16.80
	6H	15.02	15.35	16.07	16.40	17.77	14.67	15.00	15.72	16.05	17.42
	8H	15.27	15.55	16.32	16.60	18.01	14.91	15.20	15.96	16.24	17.65

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8