

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923925

Luminaire Tested: DFN2DIP-TR4F0-110D120US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923925
REPORT IS A COMBINATION OF REPORTS P902048 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D120US940-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18931.0 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 204
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLLONL

Luminous Intensity Polar Plot

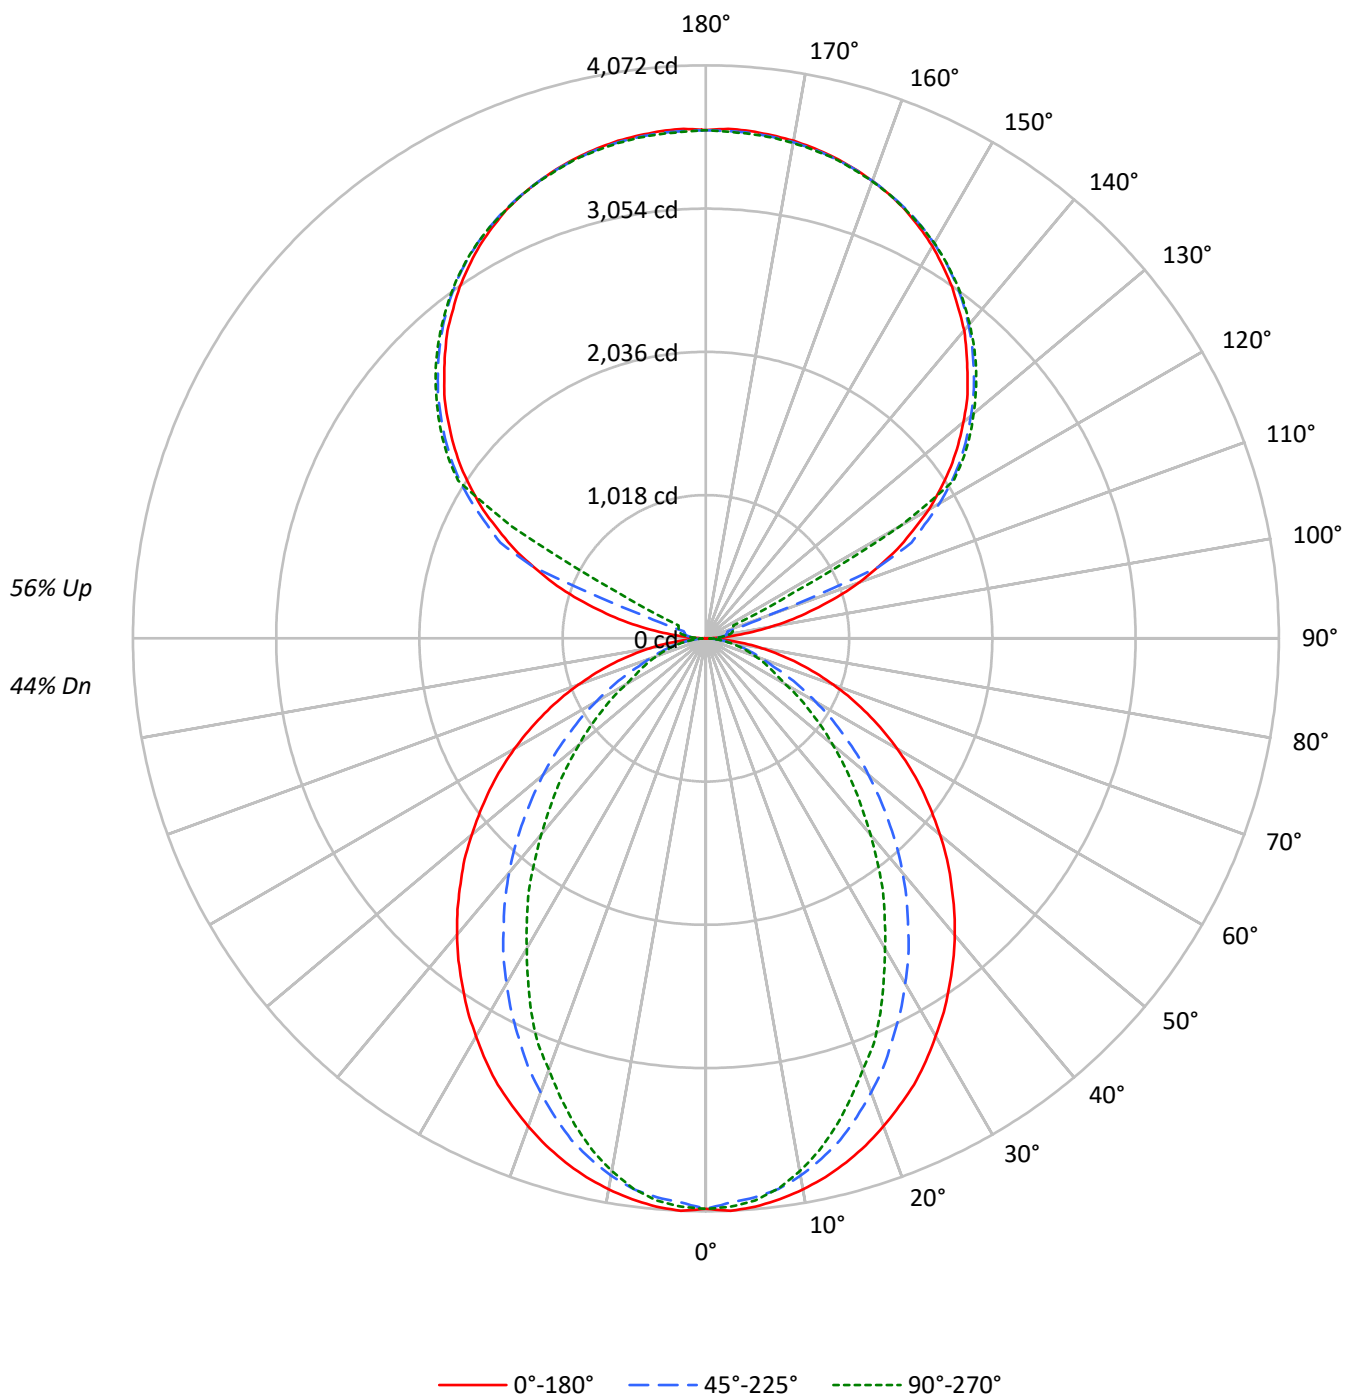

TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	45	44	44
2	89	81	76	71	81	75	70	66	62	59	56	51	49	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	46	42	40	36	34	32
4	74	64	56	51	68	59	52	47	50	45	41	41	37	34	33	30	28
5	68	57	49	44	62	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	37	31	27	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	33	28	24	28	24	21	23	20	18
9	51	39	31	26	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3221	3221	3221
5°	3226	3169	3190
10°	3194	3107	3086
15°	3150	3005	2925
20°	3092	2863	2728
25°	3032	2704	2538
30°	2952	2542	2297
35°	2874	2367	2085
40°	2794	2185	1842
45°	2702	1985	1622
50°	2606	1782	1407
55°	2506	1565	1200
60°	2390	1339	988
65°	2257	1108	889
70°	2096	894	804
75°	1893	788	732
80°	1600	660	634
85°	1115	440	476

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2702 cd/sqm

TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	379.9	2.0
10°-20°	1043.0	5.5
20°-30°	1464.4	7.7
30°-40°	1596.2	8.4
40°-50°	1467.1	7.7
50°-60°	1152.2	6.1
60°-70°	750.0	4.0
70°-80°	386.0	2.0
80°-90°	104.9	0.6
90°-100°	119.1	0.6
100°-110°	443.9	2.3
110°-120°	1177.3	6.2
120°-130°	1952.7	10.3
130°-140°	2074.2	11.0
140°-150°	1927.7	10.2
150°-160°	1549.8	8.2
160°-170°	998.7	5.3
170°-180°	343.7	1.8
0°-30°	2887.3	15.3
0°-40°	4483.6	23.7
0°-60°	7102.9	37.5
0°-90°	8343.8	44.1
90°-120°	1740.3	9.2
90°-150°	7694.9	40.6
90°-180°	10587.0	55.9
0°-180°	18931.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4054	4054	4054	4054	4054	
5°	4054	4036	3988	4021	4010	384
15°	3856	3815	3691	3621	3584	1087
25°	3500	3382	3140	2990	2935	1610
35°	3016	2829	2506	2275	2194	1888
45°	2466	2220	1834	1574	1486	1904
55°	1875	1588	1192	972	903	1675
65°	1266	968	638	514	502	1255
75°	675	418	294	268	264	714
85°	158	81	70	70	70	181
90°	2	31	52	66	70	18
95°	170	84	102	115	112	201
105°	794	873	160	188	199	849
115°	1502	1547	1612	402	214	1479
125°	2124	2158	2208	2226	2234	1895
135°	2629	2671	2694	2720	2715	2031
145°	3050	3047	3091	3110	3096	1907
155°	3358	3334	3366	3381	3361	1547
165°	3538	3522	3530	3549	3530	1000
175°	3619	3601	3606	3624	3598	344
180°	3611	3611	3611	3611	3611	

TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4054.0	4054.0	4054.0	4054.0	4054.0
2.5°	4072.3	4054.0	4013.5	4050.5	4043.1
5°	4054.0	4035.7	3987.8	4020.9	4010.0
7.5°	4020.9	3999.1	3947.7	3962.1	3943.8
10°	3976.9	3951.2	3878.0	3866.7	3845.0
12.5°	3922.0	3888.9	3789.7	3767.8	3727.3
15°	3855.8	3815.4	3690.8	3621.1	3584.5
17.5°	3778.8	3720.0	3565.9	3485.2	3426.5
20°	3690.8	3617.2	3433.9	3342.4	3261.4
22.5°	3595.5	3510.9	3298.1	3173.5	3118.6
25°	3500.1	3382.5	3140.4	2990.2	2934.9
27.5°	3386.4	3261.4	2993.7	2821.2	2736.7
30°	3265.4	3125.6	2832.2	2645.3	2546.0
32.5°	3147.8	2978.8	2678.3	2458.1	2366.2
35°	3015.9	2828.6	2506.0	2274.8	2193.8
37.5°	2887.4	2685.4	2344.4	2091.0	1999.6
40°	2751.6	2531.7	2175.5	1915.0	1819.7
42.5°	2612.2	2377.5	2007.0	1735.3	1643.8
45°	2465.5	2219.5	1834.5	1573.7	1485.8
47.5°	2326.1	2065.7	1669.5	1408.6	1328.1
50°	2171.9	1911.6	1508.0	1254.5	1177.9
52.5°	2021.3	1746.1	1353.8	1111.7	1042.0
55°	1874.6	1588.5	1192.2	972.3	902.7
57.5°	1724.4	1430.8	1049.4	843.9	785.1
60°	1570.2	1276.8	898.8	711.9	653.2
62.5°	1420.0	1126.5	770.3	594.4	565.2
65°	1265.8	968.4	638.4	513.8	502.5
67.5°	1119.1	821.7	513.8	451.1	440.2
70°	964.9	678.9	425.4	388.9	374.1
72.5°	818.1	546.5	355.8	326.5	319.1
75°	674.9	418.0	293.5	267.8	264.3
77.5°	532.1	297.0	231.2	216.4	209.0
80°	399.8	212.9	175.9	161.6	161.6
82.5°	278.7	143.2	121.1	113.7	113.7
85°	157.7	80.6	69.6	69.6	69.6
87.5°	58.8	29.2	29.2	25.7	25.7
90°	2.5	31.3	52.2	65.5	70.4
92.5°	65.5	54.9	62.7	67.9	70.4
95°	169.7	83.5	101.7	115.1	112.4
97.5°	305.7	91.6	133.1	141.2	143.7
100°	462.6	104.6	148.9	169.7	175.0
102.5°	634.9	629.9	154.2	182.8	190.8
105°	794.3	872.9	159.5	188.1	198.6
107.5°	979.9	1045.1	164.8	193.3	203.8
110°	1157.7	1212.4	457.4	196.1	206.3



TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1325.0	1371.8	1327.5	201.1	209.1
115°	1502.4	1546.8	1612.3	402.4	214.5
117.5°	1656.7	1708.9	1753.5	1379.6	695.1
120°	1829.3	1868.3	1915.5	1946.9	1594.0
122.5°	1975.4	2017.3	2069.7	2085.3	2088.0
125°	2124.3	2158.5	2208.1	2226.4	2234.2
127.5°	2260.2	2296.9	2336.3	2362.3	2364.8
130°	2388.4	2430.3	2458.8	2487.7	2485.2
132.5°	2519.0	2553.1	2581.7	2605.3	2602.8
135°	2628.9	2670.8	2694.0	2720.4	2715.2
137.5°	2743.7	2775.0	2801.4	2827.4	2819.7
140°	2856.1	2877.1	2905.6	2929.3	2916.2
142.5°	2950.3	2968.7	3002.5	3023.3	3010.2
145°	3049.6	3046.9	3091.2	3109.6	3096.5
147.5°	3135.6	3127.9	3172.3	3185.3	3175.0
150°	3219.3	3201.1	3243.0	3258.5	3245.5
152.5°	3289.8	3269.0	3308.2	3323.9	3305.7
155°	3357.7	3334.5	3365.8	3381.4	3360.6
157.5°	3412.7	3391.9	3415.5	3433.8	3412.7
160°	3459.8	3444.1	3459.8	3475.4	3457.1
162.5°	3501.5	3486.0	3499.0	3517.3	3493.7
165°	3538.0	3522.5	3530.3	3548.7	3530.3
167.5°	3566.9	3551.1	3559.2	3577.5	3553.9
170°	3590.5	3574.7	3579.9	3598.2	3574.7
172.5°	3606.0	3590.5	3595.8	3614.1	3590.5
175°	3619.0	3600.7	3606.0	3624.4	3598.2
177.5°	3624.4	3606.0	3608.8	3627.1	3603.6
180°	3611.3	3611.3	3611.3	3611.3	3611.3

TEST NUMBER: P923925

CATALOG NUMBER: DFN2DIP-TR4F0-110D120US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.63	11.41	11.64	12.43	13.78	6.60	7.38	7.61	8.40	9.76
	3H	12.30	13.00	13.32	14.03	15.40	7.79	8.49	8.81	9.51	10.89
	4H	12.91	13.57	13.94	14.60	15.98	8.23	8.90	9.27	9.93	11.31
	6H	13.32	13.94	14.37	14.97	16.36	8.55	9.16	9.60	10.20	11.59
	8H	13.45	14.03	14.50	15.08	16.47	8.64	9.22	9.69	10.27	11.67
	12H	13.51	14.06	14.56	15.10	16.52	8.69	9.24	9.74	10.28	11.70
4H	2H	10.64	11.30	11.68	12.33	13.72	7.19	7.85	8.23	8.88	10.27
	3H	12.46	13.01	13.51	14.07	15.47	8.54	9.09	9.59	10.15	11.54
	4H	13.15	13.66	14.21	14.71	16.13	9.08	9.59	10.14	10.64	12.06
	6H	13.67	14.10	14.73	15.17	16.59	9.50	9.93	10.57	11.01	12.42
	8H	13.84	14.24	14.91	15.31	16.74	9.63	10.03	10.70	11.10	12.53
	12H	13.93	14.30	15.02	15.38	16.81	9.69	10.06	10.78	11.14	12.57
8H	4H	13.12	13.52	14.18	14.59	16.02	9.36	9.76	10.43	10.83	12.26
	6H	13.68	14.02	14.77	15.12	16.55	9.88	10.21	10.97	11.32	12.74
	8H	13.90	14.19	14.99	15.28	16.73	10.07	10.36	11.16	11.45	12.90
	12H	14.04	14.29	15.13	15.38	16.86	10.19	10.44	11.29	11.53	13.02
12H	4H	13.07	13.43	14.15	14.51	15.95	9.36	9.73	10.45	10.81	12.24
	6H	13.66	13.95	14.75	15.04	16.49	9.93	10.22	11.02	11.31	12.76
	8H	13.88	14.13	14.98	15.22	16.71	10.14	10.39	11.23	11.48	12.96

END OF REPORT