

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923930

Luminaire Tested: DFN2DIP-TR4F0-120D050US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923930
REPORT IS A COMBINATION OF REPORTS P900403 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D050US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14539.3 lumens
Efficiency: N/A
Efficacy: 88.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 163.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFLL

Luminous Intensity Polar Plot

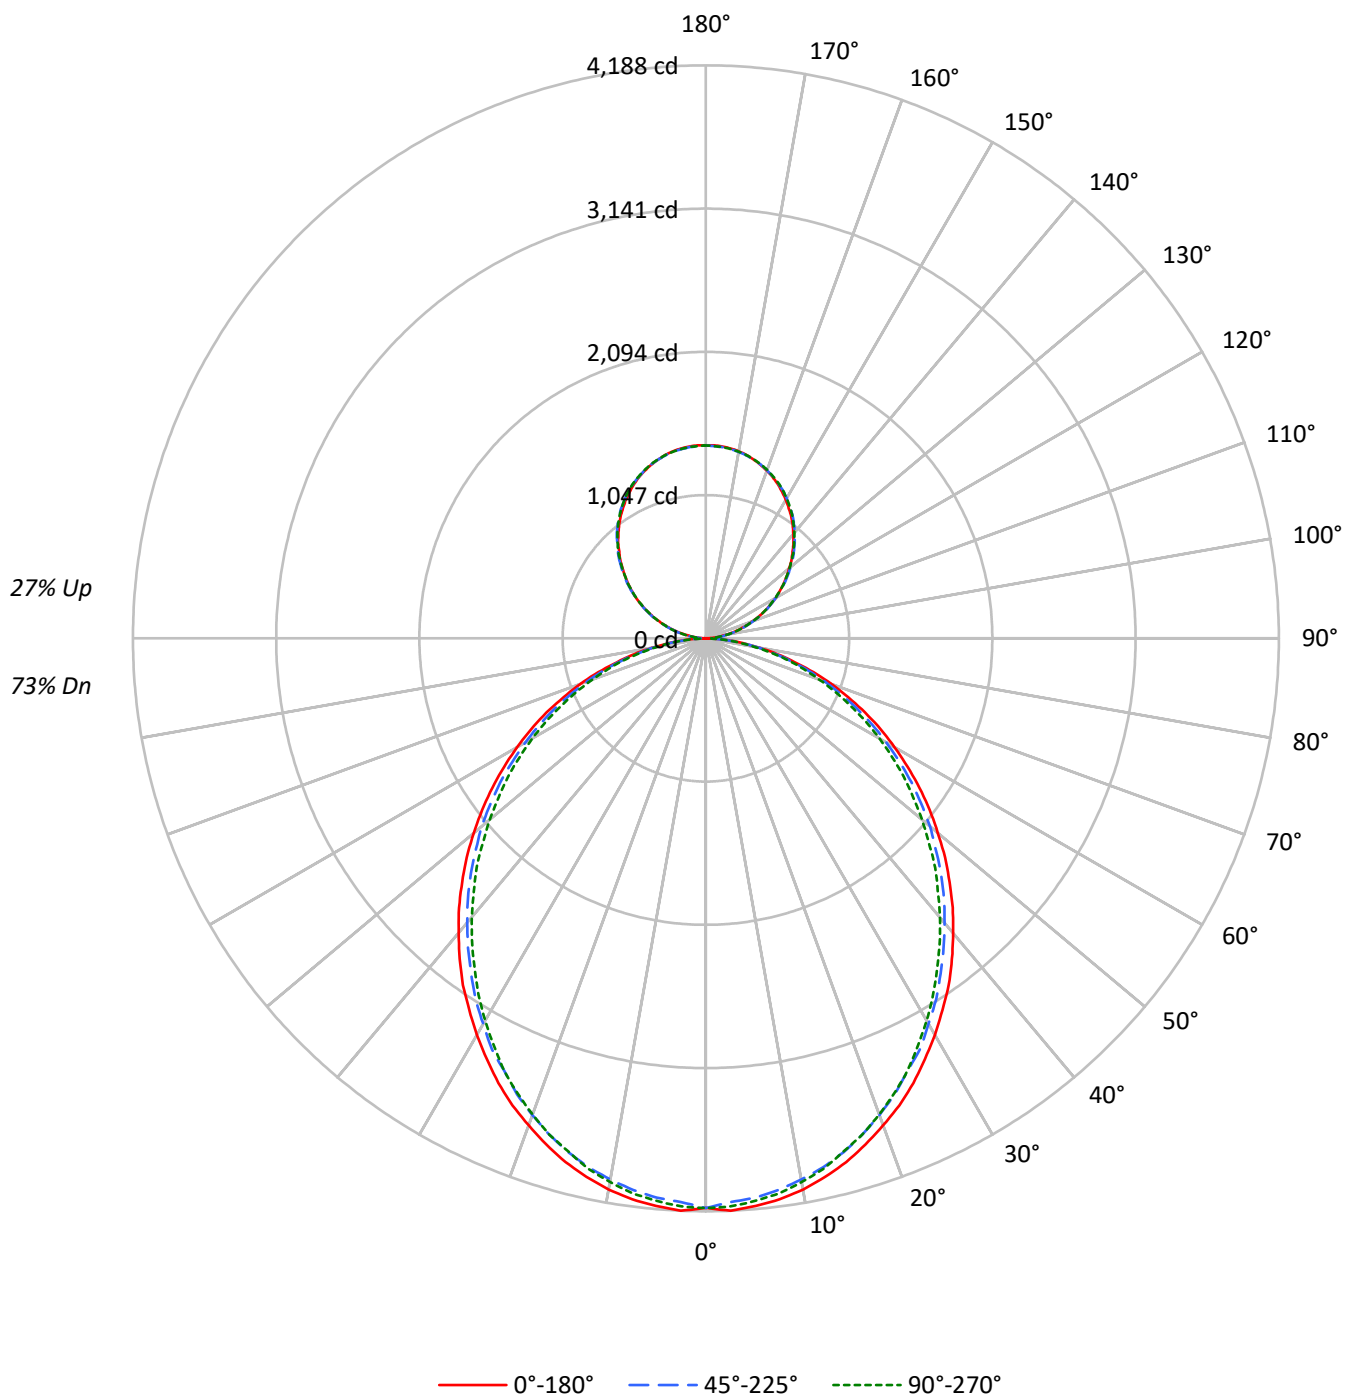

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	86	86	86	77	77	77
1	103	98	94	91	97	94	90	87	84	82	79	76	74	72	68	67	65
2	94	86	80	74	89	82	76	71	74	69	66	67	63	60	60	57	55
3	86	76	68	62	81	72	65	60	65	60	55	59	55	51	53	50	47
4	78	67	59	53	74	64	57	51	58	52	47	53	48	44	48	44	40
5	72	60	51	45	68	57	50	44	52	46	41	47	42	38	43	39	35
6	67	54	45	39	63	52	44	38	47	41	36	43	38	33	39	35	31
7	62	49	41	35	58	47	39	34	43	36	32	39	34	30	36	31	28
8	57	45	36	31	54	43	35	30	39	33	28	36	30	27	33	28	25
9	53	41	33	28	51	39	32	27	36	30	25	33	28	24	30	26	22
10	50	38	30	25	48	36	29	24	33	27	23	31	25	22	28	24	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3308	3308	3308
5°	3313	3262	3283
10°	3286	3218	3239
15°	3238	3165	3169
20°	3173	3091	3098
25°	3108	3003	3016
30°	3026	2921	2911
35°	2949	2824	2801
40°	2854	2727	2695
45°	2760	2629	2587
50°	2656	2526	2463
55°	2548	2407	2348
60°	2425	2266	2216
65°	2292	2120	2061
70°	2122	1942	1894
75°	1886	1729	1740
80°	1603	1458	1446
85°	1160	989	958

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2760 cd/sqm

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.9	2.7
10°-20°	1102.6	7.6
20°-30°	1620.4	11.1
30°-40°	1882.0	12.9
40°-50°	1879.7	12.9
50°-60°	1639.0	11.3
60°-70°	1211.6	8.3
70°-80°	685.5	4.7
80°-90°	184.9	1.3
90°-100°	87.3	0.6
100°-110°	277.2	1.9
110°-120°	474.5	3.3
120°-130°	624.0	4.3
130°-140°	700.4	4.8
140°-150°	686.8	4.7
150°-160°	576.1	4.0
160°-170°	382.1	2.6
170°-180°	133.5	0.9
0°-30°	3114.9	21.4
0°-40°	4996.9	34.4
0°-60°	8515.5	58.6
0°-90°	10597.5	72.9
90°-120°	838.9	5.8
90°-150°	2850.1	19.6
90°-180°	3942.0	27.1
0°-180°	14539.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4164	4164	4164	4164	4164	
5°	4164	4148	4104	4136	4128	395
15°	3964	3940	3888	3904	3884	1116
25°	3587	3555	3487	3495	3487	1651
35°	3095	3055	2991	2967	2947	1933
45°	2518	2490	2430	2386	2370	1944
55°	1906	1882	1834	1786	1766	1704
65°	1285	1261	1221	1185	1165	1271
75°	672	665	644	621	629	718
85°	164	160	156	144	140	183
90°	1	15	42	39	40	14
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4163.7	4163.7	4163.7	4163.7	4163.7
2.5°	4187.8	4167.9	4123.7	4163.7	4156.0
5°	4163.7	4147.9	4103.7	4135.6	4127.9
7.5°	4135.6	4111.8	4067.6	4099.9	4091.9
10°	4091.9	4063.8	4015.8	4047.7	4035.8
12.5°	4031.5	4007.7	3959.7	3979.7	3971.6
15°	3963.6	3939.8	3887.5	3903.6	3883.7
17.5°	3879.5	3855.7	3803.4	3823.4	3803.4
20°	3787.3	3763.5	3707.5	3719.3	3703.6
22.5°	3695.5	3659.4	3607.1	3607.1	3599.1
25°	3587.2	3555.3	3487.4	3495.1	3487.4
27.5°	3467.0	3439.0	3387.2	3375.2	3355.3
30°	3347.2	3314.9	3255.0	3243.2	3227.0
32.5°	3218.9	3195.2	3131.0	3106.8	3090.7
35°	3094.9	3055.0	2990.8	2966.6	2946.7
37.5°	2954.7	2918.7	2854.5	2826.5	2806.5
40°	2810.8	2778.5	2714.3	2678.6	2662.5
42.5°	2670.6	2638.3	2574.5	2534.2	2510.4
45°	2518.5	2490.5	2430.1	2386.4	2370.3
47.5°	2370.3	2342.2	2278.1	2233.9	2210.1
50°	2213.9	2194.0	2137.9	2081.8	2061.8
52.5°	2061.8	2033.8	1982.0	1937.8	1909.8
55°	1905.9	1881.8	1833.7	1785.7	1765.8
57.5°	1749.6	1729.7	1677.4	1629.4	1613.3
60°	1593.3	1577.6	1521.5	1477.4	1465.4
62.5°	1441.3	1413.2	1373.3	1333.4	1317.2
65°	1285.4	1261.1	1221.2	1185.1	1165.2
67.5°	1125.2	1104.8	1069.2	1041.2	1025.0
70°	977.0	960.8	924.7	896.7	881.0
72.5°	824.9	808.8	788.8	760.8	748.9
75°	672.4	664.8	644.3	620.6	628.7
77.5°	536.5	520.3	512.3	500.3	488.5
80°	400.6	396.3	388.3	376.4	368.3
82.5°	272.2	272.2	268.5	252.4	252.4
85°	164.0	160.2	156.3	144.0	140.2
87.5°	72.2	64.1	56.1	44.1	39.9
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1

TEST NUMBER: P923930

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US940-FLLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.31	14.42	14.04	15.18	16.08	12.88	13.99	13.61	14.75	15.65
	3H	14.99	15.99	15.73	16.75	17.69	14.52	15.52	15.26	16.28	17.21
	4H	15.59	16.53	16.35	17.30	18.25	15.11	16.06	15.88	16.83	17.78
	6H	16.00	16.87	16.78	17.65	18.61	15.53	16.40	16.30	17.18	18.14
	8H	16.11	16.94	16.90	17.74	18.70	15.64	16.47	16.42	17.27	18.23
	12H	16.17	16.96	16.96	17.76	18.74	15.69	16.48	16.48	17.28	18.26
4H	2H	13.80	14.75	14.57	15.52	16.46	13.46	14.40	14.22	15.17	16.12
	3H	15.69	16.48	16.47	17.29	18.25	15.30	16.09	16.08	16.89	17.86
	4H	16.41	17.13	17.21	17.94	18.93	16.01	16.73	16.80	17.53	18.52
	6H	16.94	17.57	17.76	18.40	19.39	16.53	17.16	17.35	17.99	18.98
	8H	17.10	17.68	17.91	18.51	19.52	16.69	17.27	17.50	18.10	19.11
	12H	17.18	17.71	18.02	18.56	19.57	16.76	17.29	17.60	18.13	19.15
8H	4H	16.63	17.21	17.45	18.04	19.05	16.27	16.85	17.09	17.68	18.69
	6H	17.27	17.75	18.12	18.62	19.63	16.91	17.39	17.76	18.26	19.27
	8H	17.50	17.92	18.35	18.79	19.82	17.13	17.56	17.98	18.42	19.45
	12H	17.64	18.02	18.50	18.87	19.96	17.26	17.63	18.11	18.49	19.57
12H	4H	16.63	17.15	17.47	18.00	19.02	16.28	16.80	17.11	17.65	18.66
	6H	17.30	17.73	18.16	18.60	19.63	16.95	17.38	17.81	18.25	19.27
	8H	17.56	17.94	18.42	18.79	19.88	17.20	17.58	18.06	18.44	19.52

END OF REPORT