

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923939

Luminaire Tested: DFN2DIP-TR4F0-120D070US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923939
REPORT IS A COMBINATION OF REPORTS P901959 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D070US940-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16773.1 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 177.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLLONL

Luminous Intensity Polar Plot

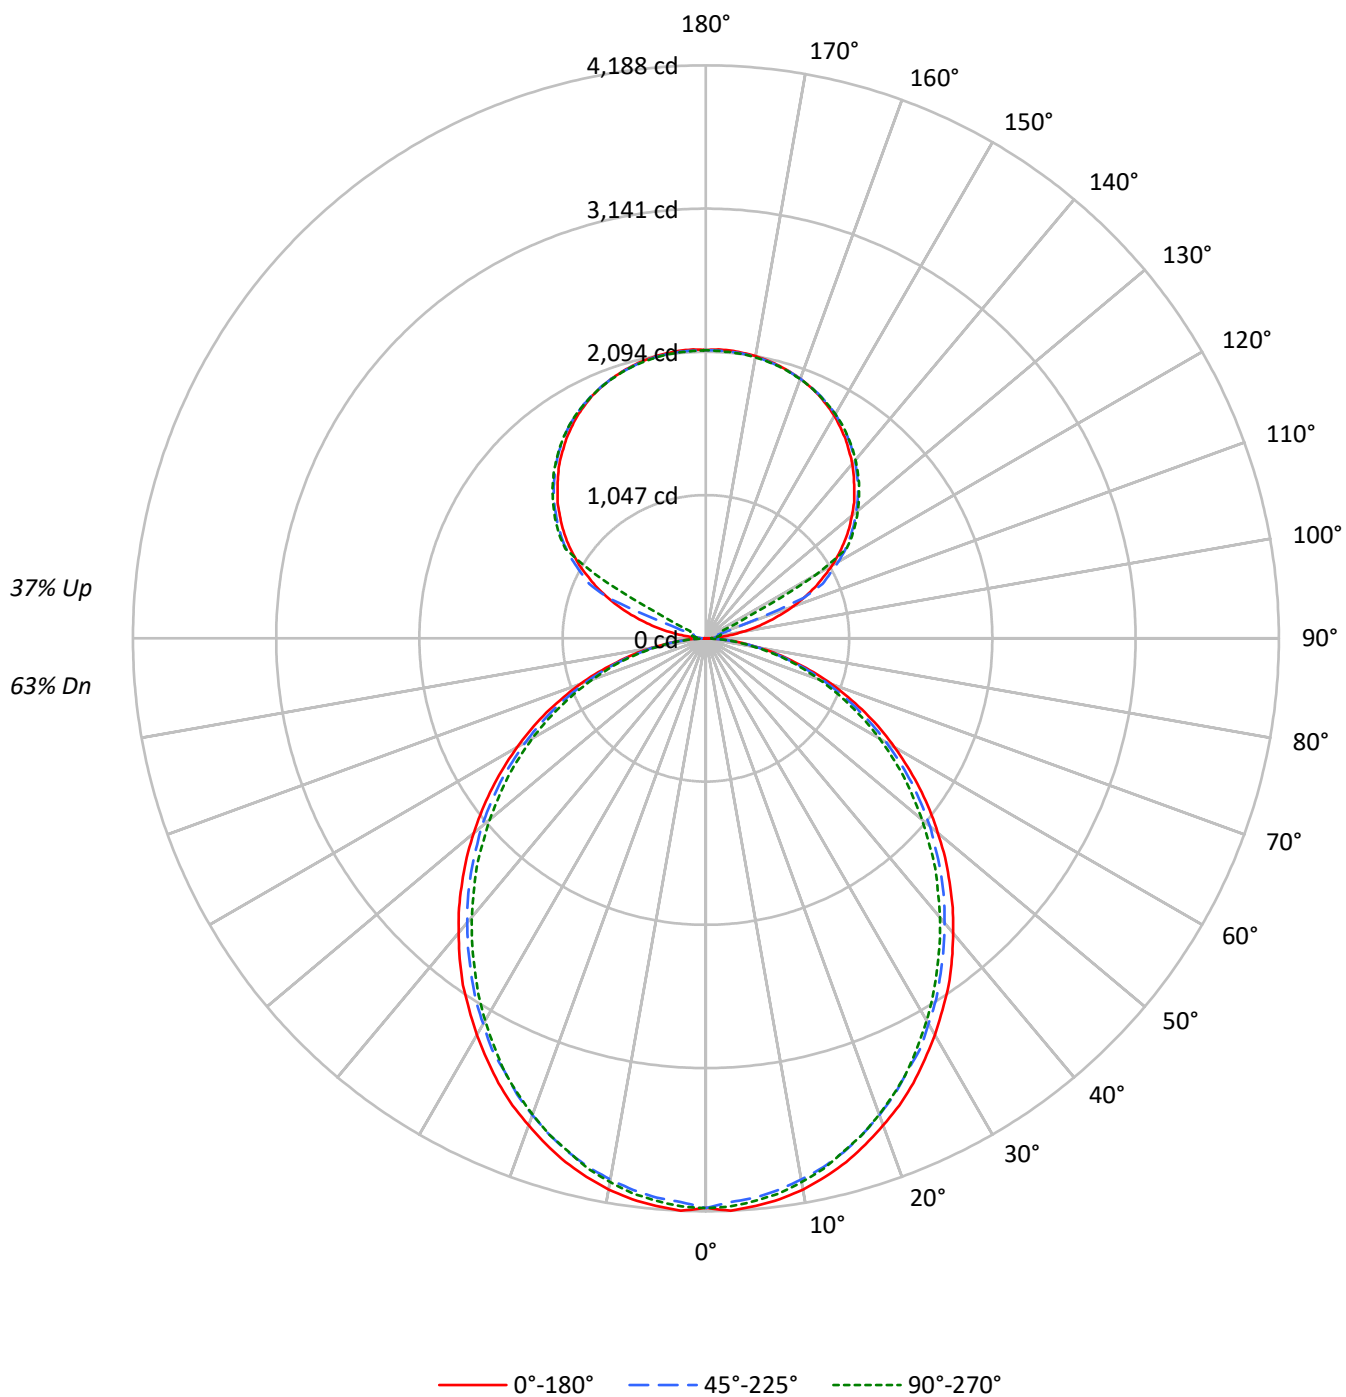

TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	96	92	89	94	91	87	84	80	77	75	70	68	66	60	59	58
2	92	84	78	73	86	79	74	69	70	66	62	61	58	55	53	51	49
3	84	74	67	61	78	70	63	58	62	56	52	54	50	47	47	44	41
4	77	66	57	51	72	62	55	49	55	49	44	48	44	40	42	39	36
5	70	59	50	44	66	55	48	42	49	43	38	43	39	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	34	39	34	30	34	31	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3308	3308	3308
5°	3313	3262	3283
10°	3286	3218	3239
15°	3238	3165	3169
20°	3173	3091	3098
25°	3108	3003	3016
30°	3026	2921	2911
35°	2949	2824	2801
40°	2854	2727	2695
45°	2760	2629	2587
50°	2656	2526	2463
55°	2548	2407	2348
60°	2425	2266	2216
65°	2292	2120	2061
70°	2122	1942	1894
75°	1886	1729	1740
80°	1603	1458	1446
85°	1160	989	958

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2760 cd/sqm

TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.9	2.3
10°-20°	1102.6	6.6
20°-30°	1620.4	9.7
30°-40°	1882.0	11.2
40°-50°	1879.7	11.2
50°-60°	1639.0	9.8
60°-70°	1211.6	7.2
70°-80°	685.5	4.1
80°-90°	184.6	1.1
90°-100°	69.5	0.4
100°-110°	259.0	1.5
110°-120°	686.8	4.1
120°-130°	1139.1	6.8
130°-140°	1209.9	7.2
140°-150°	1124.5	6.7
150°-160°	904.1	5.4
160°-170°	582.6	3.5
170°-180°	200.5	1.2
0°-30°	3114.9	18.6
0°-40°	4996.9	29.8
0°-60°	8515.5	50.8
0°-90°	10597.2	63.2
90°-120°	1015.2	6.1
90°-150°	4488.7	26.8
90°-180°	6176.0	36.8
0°-180°	16773.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4164	4164	4164	4164	4164	
5°	4164	4148	4104	4136	4128	395
15°	3964	3940	3888	3904	3884	1116
25°	3587	3555	3487	3495	3487	1651
35°	3095	3055	2991	2967	2947	1933
45°	2518	2490	2430	2386	2370	1944
55°	1906	1882	1834	1786	1766	1704
65°	1285	1261	1221	1185	1165	1271
75°	672	665	644	621	629	718
85°	164	160	156	144	140	183
90°	1	18	30	38	41	16
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4163.7	4163.7	4163.7	4163.7	4163.7
2.5°	4187.8	4167.9	4123.7	4163.7	4156.0
5°	4163.7	4147.9	4103.7	4135.6	4127.9
7.5°	4135.6	4111.8	4067.6	4099.9	4091.9
10°	4091.9	4063.8	4015.8	4047.7	4035.8
12.5°	4031.5	4007.7	3959.7	3979.7	3971.6
15°	3963.6	3939.8	3887.5	3903.6	3883.7
17.5°	3879.5	3855.7	3803.4	3823.4	3803.4
20°	3787.3	3763.5	3707.5	3719.3	3703.6
22.5°	3695.5	3659.4	3607.1	3607.1	3599.1
25°	3587.2	3555.3	3487.4	3495.1	3487.4
27.5°	3467.0	3439.0	3387.2	3375.2	3355.3
30°	3347.2	3314.9	3255.0	3243.2	3227.0
32.5°	3218.9	3195.2	3131.0	3106.8	3090.7
35°	3094.9	3055.0	2990.8	2966.6	2946.7
37.5°	2954.7	2918.7	2854.5	2826.5	2806.5
40°	2810.8	2778.5	2714.3	2678.6	2662.5
42.5°	2670.6	2638.3	2574.5	2534.2	2510.4
45°	2518.5	2490.5	2430.1	2386.4	2370.3
47.5°	2370.3	2342.2	2278.1	2233.9	2210.1
50°	2213.9	2194.0	2137.9	2081.8	2061.8
52.5°	2061.8	2033.8	1982.0	1937.8	1909.8
55°	1905.9	1881.8	1833.7	1785.7	1765.8
57.5°	1749.6	1729.7	1677.4	1629.4	1613.3
60°	1593.3	1577.6	1521.5	1477.4	1465.4
62.5°	1441.3	1413.2	1373.3	1333.4	1317.2
65°	1285.4	1261.1	1221.2	1185.1	1165.2
67.5°	1125.2	1104.8	1069.2	1041.2	1025.0
70°	977.0	960.8	924.7	896.7	881.0
72.5°	824.9	808.8	788.8	760.8	748.9
75°	672.4	664.8	644.3	620.6	628.7
77.5°	536.5	520.3	512.3	500.3	488.5
80°	400.6	396.3	388.3	376.4	368.3
82.5°	272.2	272.2	268.5	252.4	252.4
85°	164.0	160.2	156.3	144.0	140.2
87.5°	72.2	64.1	56.1	44.1	39.9
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4



TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P923939

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.56	13.55	13.39	14.41	15.48	12.13	13.12	12.96	13.98	15.05
	3H	14.23	15.12	15.08	15.99	17.08	13.75	14.65	14.60	15.51	16.61
	4H	14.82	15.66	15.68	16.54	17.64	14.35	15.19	15.21	16.06	17.17
	6H	15.23	16.00	16.10	16.89	18.01	14.75	15.53	15.63	16.41	17.53
	8H	15.34	16.08	16.22	16.98	18.10	14.86	15.60	15.75	16.50	17.62
	12H	15.39	16.09	16.28	16.99	18.13	14.91	15.61	15.80	16.51	17.65
4H	2H	13.04	13.88	13.90	14.75	15.86	12.69	13.53	13.56	14.41	15.51
	3H	14.91	15.62	15.79	16.52	17.65	14.52	15.22	15.40	16.13	17.25
	4H	15.63	16.27	16.52	17.18	18.33	15.23	15.87	16.12	16.77	17.92
	6H	16.15	16.71	17.06	17.64	18.79	15.75	16.30	16.65	17.23	18.38
	8H	16.31	16.83	17.22	17.75	18.91	15.90	16.41	16.81	17.33	18.50
	12H	16.39	16.85	17.32	17.79	18.96	15.97	16.43	16.89	17.37	18.54
8H	4H	15.84	16.36	16.75	17.28	18.44	15.48	16.00	16.39	16.92	18.08
	6H	16.48	16.91	17.41	17.87	19.03	16.11	16.54	17.05	17.51	18.67
	8H	16.70	17.08	17.64	18.03	19.21	16.33	16.71	17.28	17.66	18.84
	12H	16.84	17.17	17.79	18.12	19.35	16.45	16.79	17.40	17.73	18.96
12H	4H	15.83	16.30	16.76	17.24	18.41	15.48	15.95	16.41	16.89	18.06
	6H	16.51	16.89	17.45	17.84	19.02	16.16	16.54	17.10	17.49	18.67
	8H	16.76	17.09	17.71	18.04	19.27	16.40	16.73	17.35	17.68	18.91

END OF REPORT