

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926386

Luminaire Tested: DFN2DIP-TR4F0-040D090US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926386
REPORT IS A COMBINATION OF REPORTS P900459 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D090US950-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11376.4 lumens
Efficiency: N/A
Efficacy: 114.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 99.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

Luminous Intensity Polar Plot

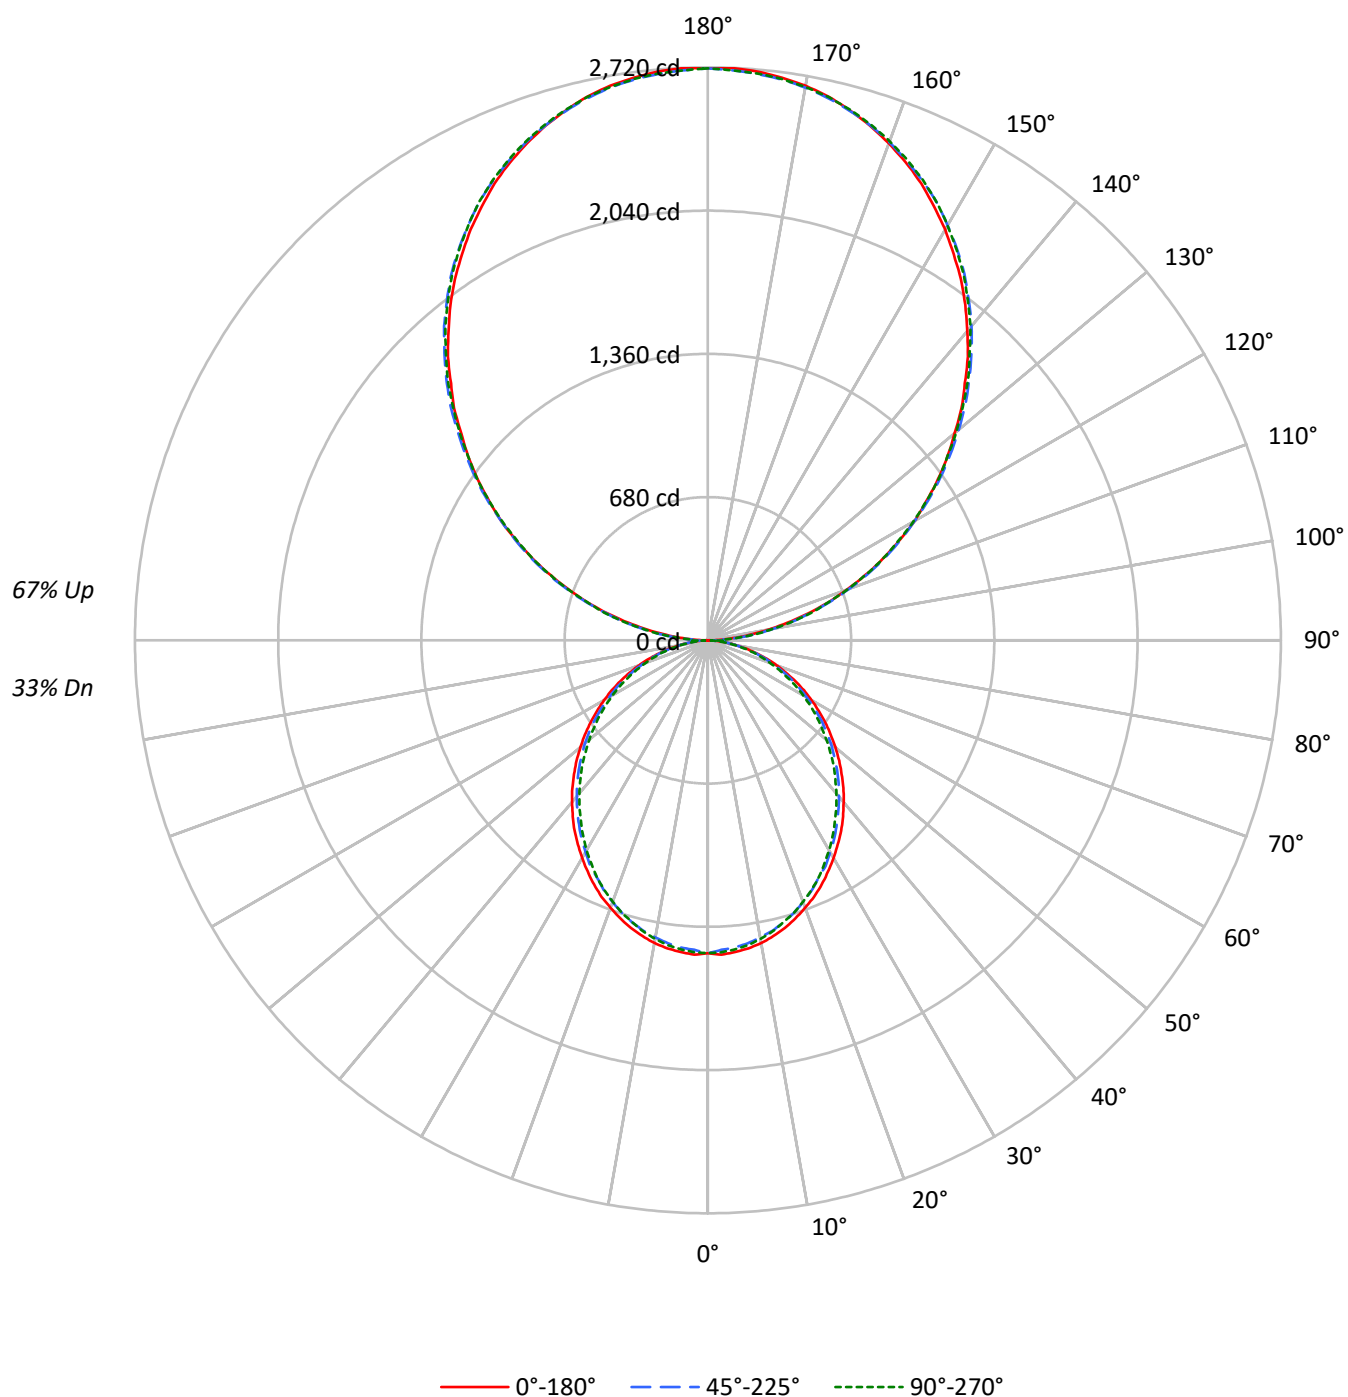

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	18	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1180	1180	1180
5°	1181	1163	1171
10°	1172	1147	1155
15°	1155	1129	1130
20°	1131	1102	1105
25°	1108	1071	1075
30°	1079	1042	1038
35°	1052	1007	999
40°	1018	972	961
45°	984	938	923
50°	947	901	878
55°	909	859	837
60°	865	808	790
65°	817	756	735
70°	757	693	676
75°	673	617	621
80°	571	520	516
85°	414	353	342

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2117 cd/sqm

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	139.8	1.2
10°-20°	393.2	3.5
20°-30°	577.9	5.1
30°-40°	671.2	5.9
40°-50°	670.3	5.9
50°-60°	584.5	5.1
60°-70°	432.1	3.8
70°-80°	244.5	2.1
80°-90°	72.2	0.6
90°-100°	168.0	1.5
100°-110°	533.9	4.7
110°-120°	913.7	8.0
120°-130°	1201.6	10.6
130°-140°	1348.7	11.9
140°-150°	1322.6	11.6
150°-160°	1109.5	9.8
160°-170°	735.8	6.5
170°-180°	257.2	2.3
0°-30°	1110.8	9.8
0°-40°	1782.0	15.7
0°-60°	3036.8	26.7
0°-90°	3785.5	33.3
90°-120°	1615.6	14.2
90°-150°	5488.5	48.2
90°-180°	7591.0	66.7
0°-180°	11376.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1485	1485	1485	1485	1485	
5°	1485	1479	1463	1475	1472	141
15°	1413	1405	1386	1392	1385	398
25°	1279	1268	1244	1246	1244	589
35°	1104	1090	1067	1058	1051	689
45°	898	888	867	851	845	693
55°	680	671	654	637	630	608
65°	458	450	436	423	416	453
75°	240	237	230	221	224	256
85°	58	57	56	51	50	65
90°	2	30	80	75	78	11
95°	120	142	146	146	142	133
105°	493	499	504	508	508	520
115°	917	930	926	924	917	907
125°	1334	1354	1348	1340	1338	1192
135°	1725	1750	1755	1753	1746	1333
145°	2094	2110	2124	2126	2117	1308
155°	2394	2401	2408	2420	2413	1102
165°	2605	2602	2602	2619	2607	735
175°	2710	2704	2699	2716	2702	258
180°	2716	2716	2716	2716	2716	

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1484.8	1484.8	1484.8	1484.8	1484.8
2.5°	1493.5	1486.3	1470.6	1484.8	1482.1
5°	1484.8	1479.2	1463.4	1474.8	1472.1
7.5°	1474.8	1466.3	1450.6	1462.1	1459.2
10°	1459.2	1449.2	1432.1	1443.5	1439.2
12.5°	1437.7	1429.2	1412.1	1419.3	1416.3
15°	1413.4	1405.0	1386.4	1392.1	1385.0
17.5°	1383.5	1375.0	1356.4	1363.5	1356.4
20°	1350.6	1342.1	1322.1	1326.3	1320.8
22.5°	1317.9	1305.0	1286.4	1286.4	1283.5
25°	1279.2	1267.9	1243.6	1246.4	1243.6
27.5°	1236.4	1226.4	1208.0	1203.7	1196.6
30°	1193.6	1182.2	1160.8	1156.5	1150.8
32.5°	1147.9	1139.5	1116.6	1108.0	1102.2
35°	1103.7	1089.5	1066.6	1058.0	1050.8
37.5°	1053.7	1040.8	1017.9	1008.0	1000.8
40°	1002.4	990.8	967.9	955.2	949.5
42.5°	952.4	940.8	918.1	903.7	895.2
45°	898.1	888.2	866.6	851.1	845.2
47.5°	845.2	835.2	812.4	796.7	788.2
50°	789.5	782.4	762.4	742.4	735.2
52.5°	735.2	725.3	706.8	691.1	681.1
55°	679.7	671.0	654.0	636.8	629.7
57.5°	623.9	616.9	598.2	581.1	575.4
60°	568.2	562.6	542.6	526.9	522.6
62.5°	514.0	504.0	489.8	475.5	469.7
65°	458.4	449.7	435.5	422.6	415.6
67.5°	401.3	394.0	381.3	371.3	365.6
70°	348.4	342.7	329.8	319.8	314.2
72.5°	294.2	288.4	281.3	271.3	267.0
75°	239.8	237.1	229.8	221.3	224.2
77.5°	191.3	185.6	182.7	178.4	174.2
80°	142.8	141.3	138.4	134.2	131.4
82.5°	97.1	97.1	95.8	90.0	90.0
85°	58.5	57.1	55.7	51.3	50.0
87.5°	25.8	22.9	20.0	15.7	14.2
90°	2.5	29.5	80.2	75.3	77.8
92.5°	50.8	68.8	71.3	73.6	73.6
95°	119.5	142.4	146.5	146.5	142.4
97.5°	198.9	220.2	229.2	229.2	229.2
100°	290.6	309.5	316.0	316.0	313.6
102.5°	387.2	401.2	410.1	412.6	410.1
105°	492.8	499.3	504.3	508.4	508.4
107.5°	597.6	607.4	607.4	609.0	597.6
110°	699.1	712.3	712.3	712.3	705.7

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	808.8	822.7	820.2	813.8	808.8
115°	916.9	930.0	925.9	923.5	916.9
117.5°	1024.1	1042.1	1030.7	1024.1	1017.5
120°	1132.2	1150.1	1132.2	1132.2	1124.8
122.5°	1230.4	1253.4	1241.9	1235.3	1230.4
125°	1333.6	1354.0	1347.5	1340.1	1337.7
127.5°	1434.2	1459.6	1450.7	1440.8	1434.2
130°	1528.4	1557.9	1553.8	1548.8	1539.9
132.5°	1634.0	1656.9	1658.5	1647.1	1640.6
135°	1724.8	1750.2	1755.2	1752.7	1746.2
137.5°	1826.3	1846.8	1851.0	1849.3	1839.5
140°	1915.6	1936.0	1947.5	1947.5	1938.5
142.5°	2007.3	2027.7	2034.3	2036.8	2027.7
145°	2094.1	2110.4	2123.5	2126.0	2117.0
147.5°	2171.9	2192.3	2202.1	2206.2	2197.3
150°	2252.1	2266.0	2275.0	2282.3	2275.0
152.5°	2323.3	2337.2	2348.7	2357.7	2348.7
155°	2394.5	2401.0	2408.5	2419.9	2412.6
157.5°	2455.9	2460.8	2464.9	2481.3	2469.8
160°	2510.7	2515.7	2518.2	2532.0	2522.2
162.5°	2561.5	2561.5	2564.0	2579.5	2568.1
165°	2604.9	2602.4	2602.4	2618.8	2607.4
167.5°	2644.2	2636.9	2636.9	2653.2	2641.7
170°	2673.7	2667.1	2664.7	2681.0	2667.1
172.5°	2694.1	2687.6	2685.1	2701.5	2687.6
175°	2710.5	2703.9	2699.1	2715.5	2701.5
177.5°	2719.5	2713.0	2708.0	2722.0	2708.0
180°	2715.5	2715.5	2715.5	2715.5	2715.5

TEST NUMBER: P926386

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.05	6.78	7.14	7.87	9.36	5.62	6.35	6.71	7.44	8.93
	3H	7.70	8.36	8.80	9.45	10.96	7.23	7.88	8.33	8.98	10.49
	4H	8.28	8.90	9.39	10.00	11.52	7.81	8.43	8.92	9.53	11.04
	6H	8.68	9.25	9.79	10.35	11.87	8.20	8.77	9.32	9.87	11.40
	8H	8.78	9.32	9.90	10.44	11.96	8.30	8.85	9.42	9.96	11.48
	12H	8.82	9.34	9.95	10.45	11.99	8.34	8.86	9.47	9.97	11.51
4H	2H	6.50	7.12	7.61	8.22	9.73	6.15	6.77	7.27	7.87	9.39
	3H	8.35	8.87	9.47	9.99	11.52	7.96	8.48	9.08	9.60	11.13
	4H	9.06	9.54	10.19	10.65	12.20	8.65	9.13	9.78	10.24	11.79
	6H	9.57	9.98	10.70	11.11	12.65	9.16	9.57	10.29	10.70	12.24
	8H	9.71	10.09	10.85	11.22	12.78	9.30	9.68	10.43	10.81	12.37
	12H	9.78	10.13	10.93	11.27	12.83	9.36	9.70	10.51	10.84	12.40
8H	4H	9.25	9.63	10.38	10.75	12.31	8.89	9.27	10.02	10.39	11.95
	6H	9.87	10.19	11.02	11.36	12.91	9.51	9.82	10.66	10.99	12.55
	8H	10.09	10.37	11.25	11.52	13.09	9.72	10.00	10.88	11.15	12.72
	12H	10.22	10.46	11.38	11.60	13.21	9.83	10.07	10.99	11.22	12.83
12H	4H	9.23	9.57	10.37	10.71	12.27	8.87	9.22	10.02	10.36	11.92
	6H	9.90	10.18	11.06	11.32	12.90	9.55	9.82	10.71	10.97	12.55
	8H	10.14	10.38	11.30	11.52	13.13	9.78	10.02	10.94	11.17	12.77

END OF REPORT