

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926404

Luminaire Tested: DFN2DIP-TR4F0-050D040US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926404
REPORT IS A COMBINATION OF REPORTS P900372 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D040US950-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7431.7 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 72.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

Luminous Intensity Polar Plot

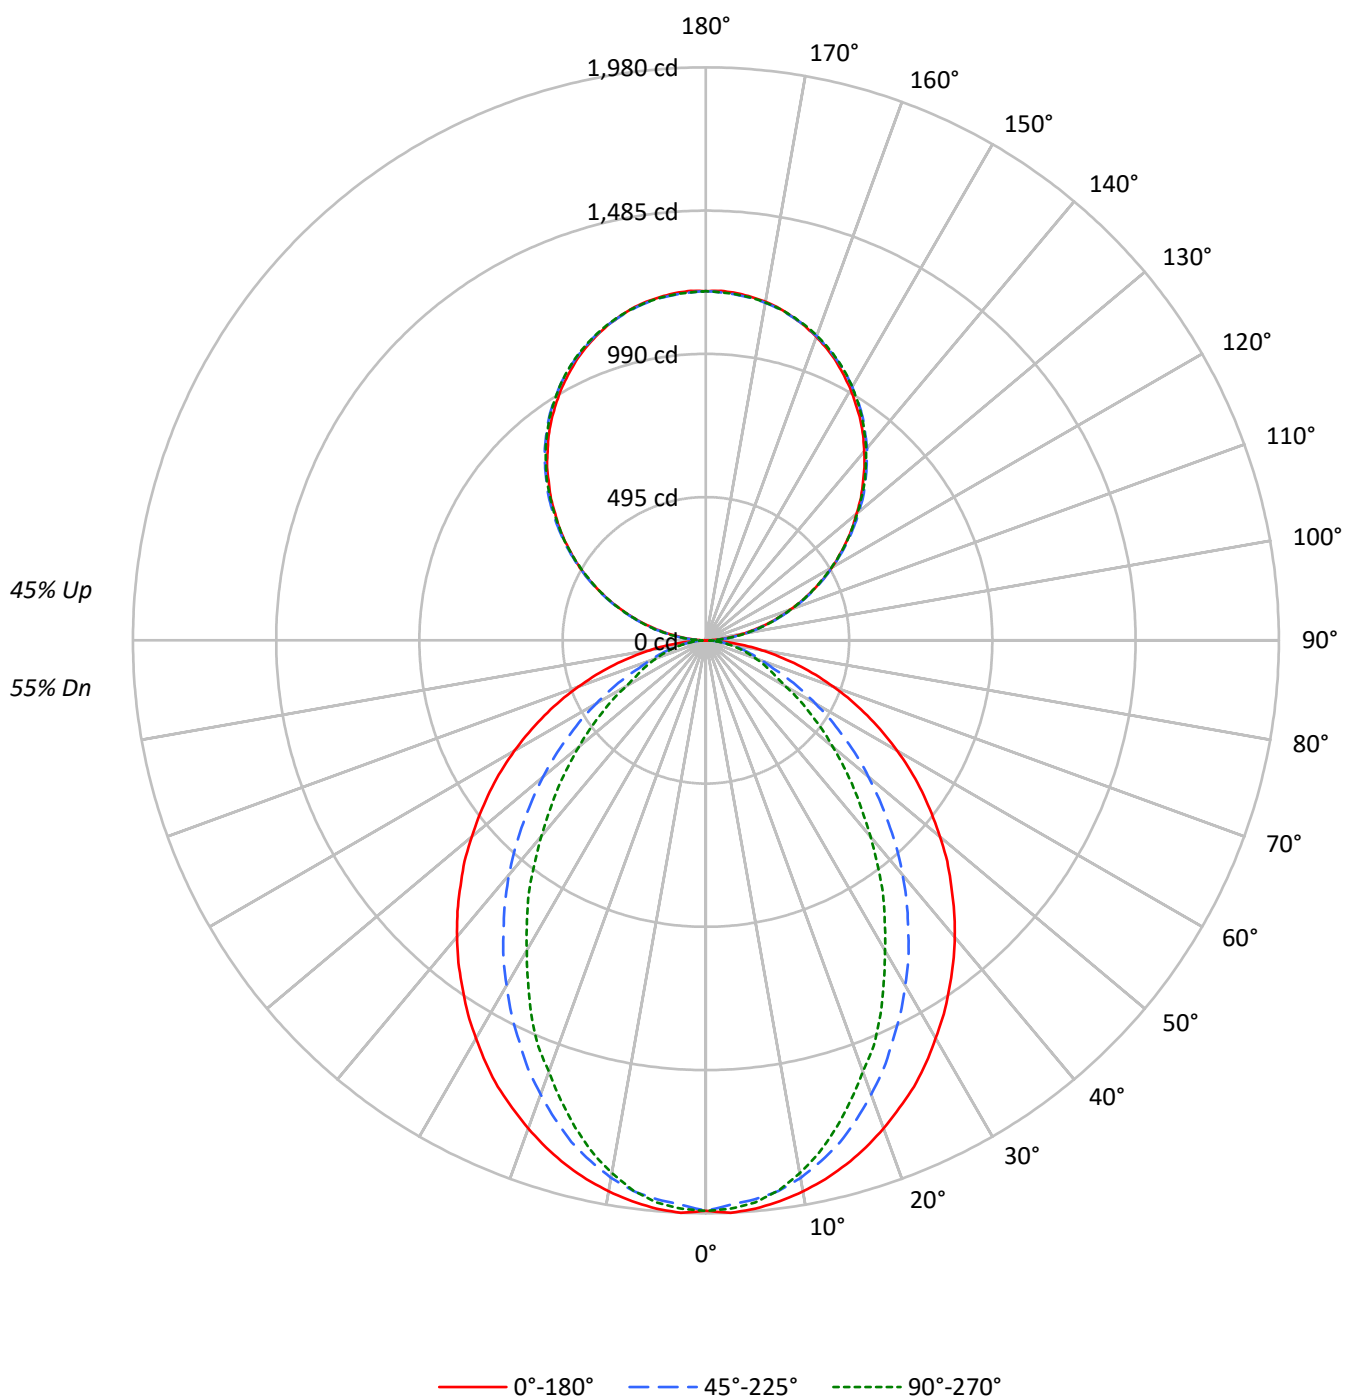

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1566	1566	1566
5°	1569	1541	1551
10°	1553	1511	1501
15°	1532	1461	1423
20°	1504	1392	1327
25°	1475	1315	1234
30°	1436	1236	1117
35°	1398	1151	1014
40°	1359	1063	896
45°	1314	965	789
50°	1267	867	684
55°	1219	761	584
60°	1162	651	480
65°	1098	539	432
70°	1019	435	391
75°	921	383	356
80°	778	321	308
85°	542	215	232

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1314 cd/sqm

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.5
10°-20°	507.2	6.8
20°-30°	712.1	9.6
30°-40°	776.3	10.4
40°-50°	713.5	9.6
50°-60°	560.3	7.5
60°-70°	364.7	4.9
70°-80°	187.7	2.5
80°-90°	51.4	0.7
90°-100°	74.7	1.0
100°-110°	237.3	3.2
110°-120°	406.1	5.5
120°-130°	534.0	7.2
130°-140°	599.4	8.1
140°-150°	587.8	7.9
150°-160°	493.1	6.6
160°-170°	327.0	4.4
170°-180°	114.3	1.5
0°-30°	1404.1	18.9
0°-40°	2180.4	29.3
0°-60°	3454.1	46.5
0°-90°	4058.0	54.6
90°-120°	718.0	9.7
90°-150°	2439.3	32.8
90°-180°	3374.0	45.4
0°-180°	7431.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	13	36	34	34	7
95°	53	63	65	65	63	59
105°	219	222	224	226	226	231
115°	408	413	412	410	408	403
125°	593	602	599	596	594	530
135°	767	778	780	779	776	593
145°	931	938	944	945	941	582
155°	1064	1067	1070	1076	1072	490
165°	1158	1157	1157	1164	1159	327
175°	1205	1202	1200	1207	1201	114
180°	1207	1207	1207	1207	1207	

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.0	13.1	35.7	33.5	34.5
92.5°	22.5	30.5	31.7	32.7	32.7
95°	53.1	63.3	65.2	65.2	63.3
97.5°	88.4	97.9	101.9	101.9	101.9
100°	129.2	137.6	140.4	140.4	139.4
102.5°	172.1	178.3	182.3	183.4	182.3
105°	219.0	221.9	224.1	225.9	225.9
107.5°	265.6	270.0	270.0	270.6	265.6
110°	310.7	316.5	316.5	316.5	313.7

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	359.5	365.7	364.5	361.7	359.5
115°	407.5	413.4	411.5	410.4	407.5
117.5°	455.2	463.2	458.1	455.2	452.3
120°	503.2	511.2	503.2	503.2	499.9
122.5°	546.8	557.0	552.0	549.0	546.8
125°	592.7	601.8	598.9	595.6	594.5
127.5°	637.5	648.7	644.7	640.3	637.5
130°	679.2	692.4	690.6	688.4	684.4
132.5°	726.2	736.4	737.2	732.0	729.1
135°	766.6	777.9	780.1	778.9	776.1
137.5°	811.8	820.8	822.6	821.9	817.6
140°	851.3	860.5	865.6	865.6	861.6
142.5°	892.2	901.2	904.1	905.3	901.2
145°	930.7	938.0	943.8	944.9	940.9
147.5°	965.3	974.3	978.7	980.5	976.5
150°	1000.9	1007.1	1011.1	1014.4	1011.1
152.5°	1032.6	1038.7	1043.9	1047.9	1043.9
155°	1064.2	1067.1	1070.4	1075.5	1072.2
157.5°	1091.6	1093.7	1095.5	1102.8	1097.7
160°	1115.9	1118.1	1119.1	1125.3	1121.0
162.5°	1138.4	1138.4	1139.6	1146.4	1141.4
165°	1157.8	1156.6	1156.6	1163.9	1158.8
167.5°	1175.2	1171.9	1171.9	1179.2	1174.1
170°	1188.3	1185.3	1184.3	1191.5	1185.3
172.5°	1197.4	1194.5	1193.4	1200.7	1194.5
175°	1204.7	1201.8	1199.6	1206.8	1200.7
177.5°	1208.7	1205.8	1203.6	1209.8	1203.6
180°	1206.8	1206.8	1206.8	1206.8	1206.8

TEST NUMBER: P926404

CATALOG NUMBER: DFN2DIP-TR4F0-050D040US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.12	9.99	10.04	10.93	12.13	5.09	5.96	6.02	6.90	8.11
	3H	10.80	11.58	11.74	12.52	13.75	6.29	7.06	7.22	8.01	9.24
	4H	11.41	12.14	12.36	13.09	14.34	6.74	7.47	7.69	8.42	9.66
	6H	11.83	12.51	12.79	13.47	14.72	7.06	7.74	8.02	8.69	9.95
	8H	11.96	12.60	12.93	13.58	14.83	7.15	7.80	8.12	8.77	10.02
	12H	12.02	12.64	13.00	13.60	14.88	7.20	7.81	8.17	8.78	10.05
4H	2H	9.14	9.88	10.10	10.83	12.07	5.69	6.43	6.65	7.38	8.62
	3H	10.98	11.59	11.94	12.57	13.82	7.05	7.66	8.01	8.64	9.89
	4H	11.67	12.23	12.64	13.20	14.48	7.60	8.15	8.57	9.13	10.41
	6H	12.19	12.66	13.17	13.66	14.94	8.02	8.50	9.01	9.50	10.77
	8H	12.36	12.81	13.35	13.80	15.09	8.15	8.60	9.14	9.59	10.88
	12H	12.46	12.86	13.46	13.87	15.17	8.22	8.62	9.22	9.63	10.92
8H	4H	11.64	12.09	12.63	13.08	14.37	7.88	8.33	8.87	9.32	10.61
	6H	12.21	12.58	13.22	13.61	14.90	8.40	8.77	9.41	9.80	11.09
	8H	12.42	12.75	13.44	13.77	15.08	8.59	8.92	9.61	9.94	11.25
	12H	12.56	12.85	13.59	13.86	15.22	8.71	9.00	9.74	10.01	11.37
12H	4H	11.59	12.00	12.60	13.00	14.30	7.89	8.29	8.89	9.30	10.59
	6H	12.18	12.51	13.20	13.53	14.84	8.45	8.78	9.47	9.80	11.10
	8H	12.40	12.69	13.43	13.71	15.06	8.66	8.95	9.69	9.96	11.32

END OF REPORT