

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926417

Luminaire Tested: DFN2DIP-TR4F0-050D070US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926417
REPORT IS A COMBINATION OF REPORTS P901946 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D070US950-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10665.7 lumens
Efficiency: N/A
Efficacy: 113.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 94.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLLONL

Luminous Intensity Polar Plot

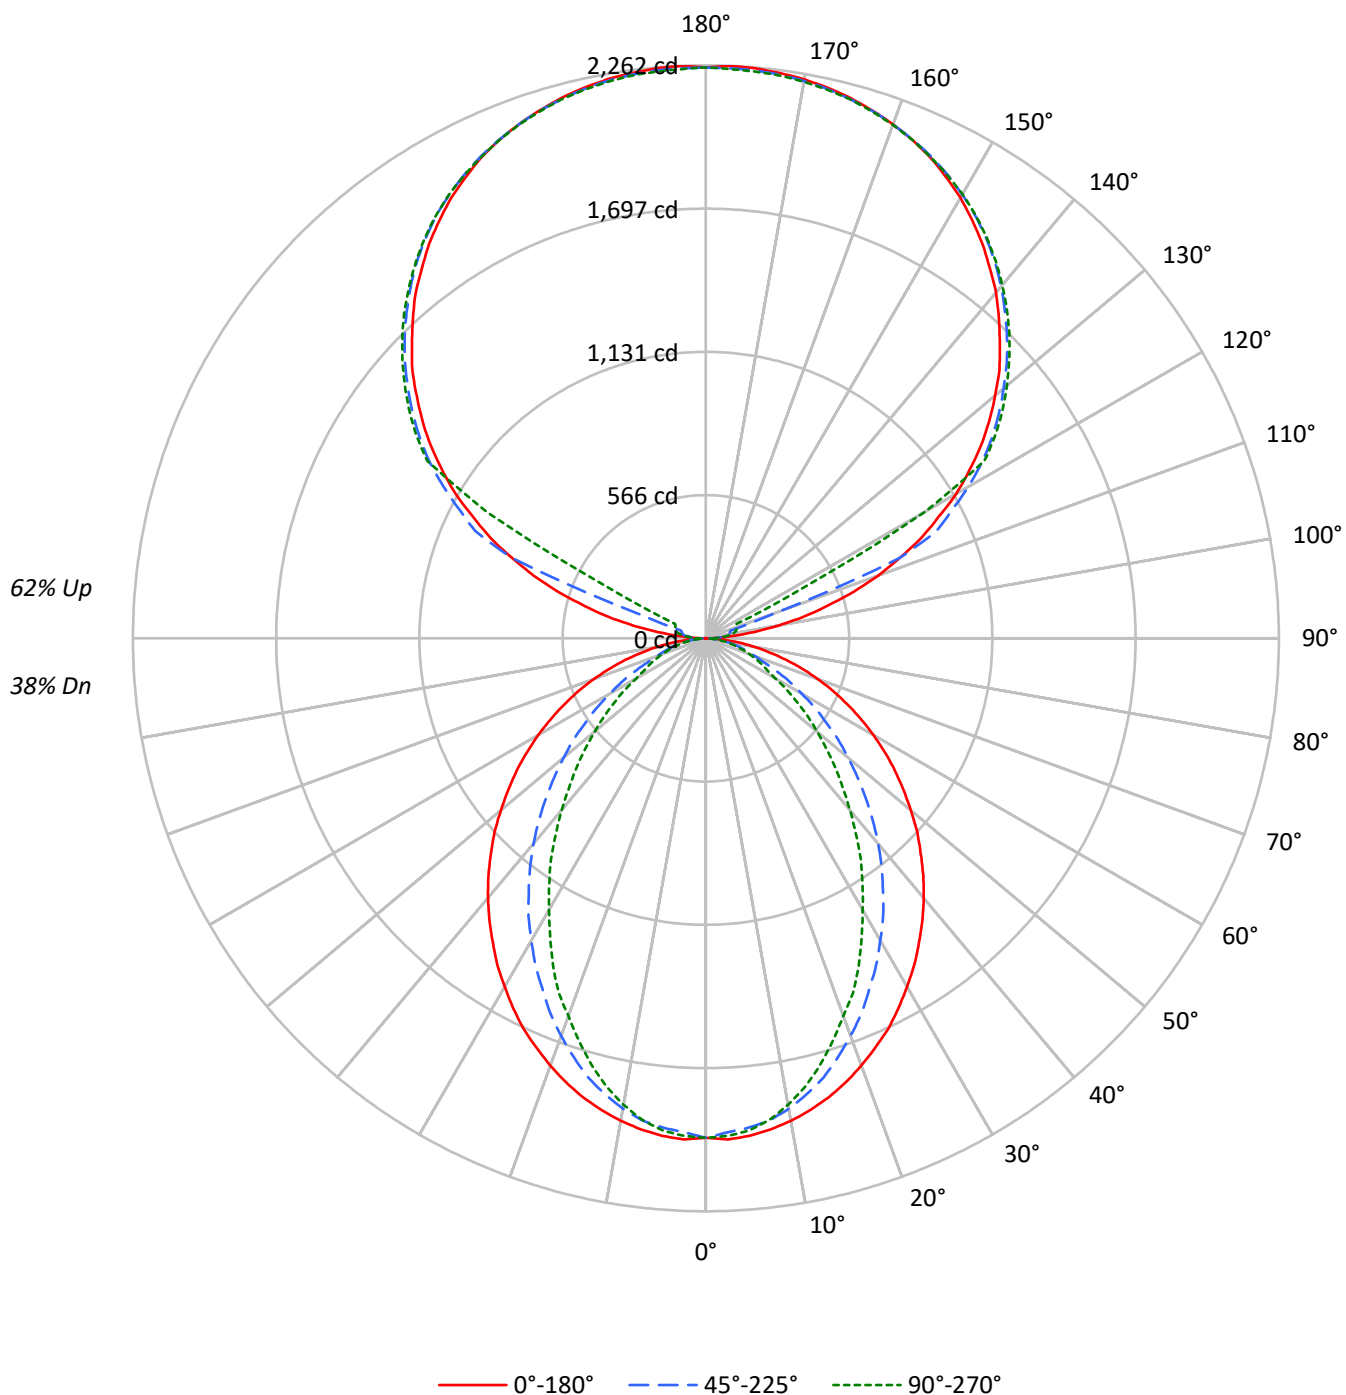

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	95	91	88	84	87	83	80	77	68	66	64	54	52	51	40	40	39
2	87	80	74	69	79	73	68	64	60	56	53	47	45	43	36	35	33
3	80	71	64	58	72	65	59	54	53	49	45	42	39	37	32	30	29
4	73	63	55	50	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	43	61	51	45	40	42	37	34	34	31	28	26	24	22
6	62	50	43	37	56	46	39	34	38	33	29	31	27	24	24	22	20
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	18
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	50	38	31	26	45	35	28	24	29	24	21	24	20	18	19	16	14
10	46	35	28	23	42	32	26	22	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1566	1566	1566
5°	1569	1541	1551
10°	1553	1511	1501
15°	1532	1461	1423
20°	1504	1392	1327
25°	1475	1315	1234
30°	1436	1236	1117
35°	1398	1151	1014
40°	1359	1063	896
45°	1314	965	789
50°	1267	867	684
55°	1219	761	584
60°	1162	651	480
65°	1098	539	432
70°	1019	435	391
75°	921	383	356
80°	778	321	308
85°	542	215	232

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1314 cd/sqm

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.7
10°-20°	507.2	4.8
20°-30°	712.1	6.7
30°-40°	776.3	7.3
40°-50°	713.5	6.7
50°-60°	560.3	5.3
60°-70°	364.7	3.4
70°-80°	187.7	1.8
80°-90°	51.9	0.5
90°-100°	74.3	0.7
100°-110°	277.0	2.6
110°-120°	734.8	6.9
120°-130°	1218.6	11.4
130°-140°	1294.5	12.1
140°-150°	1203.1	11.3
150°-160°	967.2	9.1
160°-170°	623.3	5.8
170°-180°	214.5	2.0
0°-30°	1404.1	13.2
0°-40°	2180.4	20.4
0°-60°	3454.1	32.4
0°-90°	4058.5	38.1
90°-120°	1086.1	10.2
90°-150°	4802.2	45.0
90°-180°	6607.0	61.9
0°-180°	10665.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	2	20	32	41	44	10
95°	106	52	64	72	70	125
105°	496	545	100	117	124	530
115°	938	965	1006	251	134	923
125°	1326	1347	1378	1390	1394	1182
135°	1641	1667	1681	1698	1694	1267
145°	1903	1902	1929	1941	1932	1190
155°	2096	2081	2100	2110	2097	966
165°	2208	2198	2203	2215	2203	624
175°	2259	2247	2250	2262	2246	215
180°	2254	2254	2254	2254	2254	

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.5	19.6	32.5	40.8	44.0
92.5°	40.8	34.2	39.1	42.5	44.0
95°	105.9	52.1	63.5	71.8	70.1
97.5°	190.7	57.1	83.1	88.1	89.7
100°	288.8	65.3	92.9	105.9	109.2
102.5°	396.2	393.1	96.3	114.1	119.1
105°	495.8	544.7	99.5	117.3	123.9
107.5°	611.5	652.2	102.8	120.7	127.3
110°	722.6	756.6	285.4	122.4	128.8

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	826.9	856.1	828.5	125.5	130.5
115°	937.7	965.4	1006.2	251.2	133.8
117.5°	1033.9	1066.5	1094.3	861.0	433.8
120°	1141.6	1166.0	1195.5	1215.0	994.8
122.5°	1232.8	1258.9	1291.7	1301.4	1303.1
125°	1325.8	1347.0	1378.1	1389.5	1394.3
127.5°	1410.6	1433.4	1458.0	1474.3	1475.8
130°	1490.5	1516.7	1534.5	1552.5	1551.0
132.5°	1572.1	1593.4	1611.2	1625.9	1624.4
135°	1640.6	1666.7	1681.3	1697.7	1694.5
137.5°	1712.2	1731.9	1748.3	1764.6	1759.7
140°	1782.4	1795.5	1813.4	1828.1	1819.9
142.5°	1841.2	1852.7	1873.8	1886.7	1878.6
145°	1903.2	1901.5	1929.2	1940.6	1932.5
147.5°	1956.8	1952.1	1979.7	1987.8	1981.5
150°	2009.1	1997.8	2023.9	2033.5	2025.4
152.5°	2053.1	2040.1	2064.6	2074.4	2063.0
155°	2095.6	2081.0	2100.5	2110.2	2097.3
157.5°	2129.8	2116.8	2131.5	2143.0	2129.8
160°	2159.3	2149.4	2159.3	2168.9	2157.5
162.5°	2185.2	2175.5	2183.6	2195.1	2180.4
165°	2208.0	2198.4	2203.2	2214.6	2203.2
167.5°	2226.1	2216.1	2221.2	2232.6	2218.0
170°	2240.8	2230.9	2234.2	2245.6	2230.9
172.5°	2250.5	2240.8	2244.1	2255.4	2240.8
175°	2258.6	2247.1	2250.5	2261.8	2245.6
177.5°	2261.8	2250.5	2252.2	2263.7	2248.9
180°	2253.7	2253.7	2253.7	2253.7	2253.7

TEST NUMBER: P926417

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.47	8.21	8.53	9.27	10.71	3.45	4.19	4.51	5.25	6.68
	3H	9.14	9.81	10.21	10.87	12.33	4.63	5.29	5.70	6.36	7.81
	4H	9.75	10.37	10.83	11.44	12.90	5.08	5.70	6.16	6.77	8.23
	6H	10.16	10.74	11.25	11.81	13.29	5.39	5.97	6.48	7.04	8.51
	8H	10.29	10.84	11.38	11.93	13.39	5.48	6.03	6.57	7.12	8.58
	12H	10.35	10.87	11.44	11.95	13.44	5.52	6.04	6.62	7.12	8.61
4H	2H	7.48	8.11	8.57	9.18	10.64	4.03	4.66	5.12	5.73	7.19
	3H	9.30	9.82	10.39	10.92	12.39	5.37	5.90	6.47	6.99	8.46
	4H	9.99	10.47	11.09	11.55	13.05	5.92	6.40	7.02	7.48	8.98
	6H	10.50	10.91	11.61	12.02	13.51	6.33	6.74	7.44	7.85	9.34
	8H	10.67	11.06	11.78	12.16	13.66	6.46	6.84	7.57	7.94	9.45
	12H	10.76	11.11	11.89	12.22	13.73	6.52	6.87	7.64	7.98	9.49
8H	4H	9.95	10.33	11.06	11.44	12.94	6.19	6.57	7.30	7.68	9.18
	6H	10.51	10.83	11.64	11.97	13.47	6.71	7.02	7.83	8.17	9.67
	8H	10.73	11.01	11.86	12.13	13.65	6.90	7.17	8.03	8.30	9.82
	12H	10.86	11.11	12.00	12.23	13.78	7.01	7.26	8.15	8.38	9.93
12H	4H	9.90	10.24	11.02	11.36	12.87	6.19	6.54	7.32	7.65	9.16
	6H	10.49	10.76	11.62	11.89	13.41	6.76	7.03	7.89	8.16	9.68
	8H	10.70	10.95	11.84	12.07	13.63	6.96	7.21	8.10	8.33	9.88

END OF REPORT