

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926427

Luminaire Tested: DFN2DIP-TR4F0-050D100US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926427
REPORT IS A COMBINATION OF REPORTS P901999 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D100US950-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14166.9 lumens
Efficiency: N/A
Efficacy: 119.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 118.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLLONL

Luminous Intensity Polar Plot

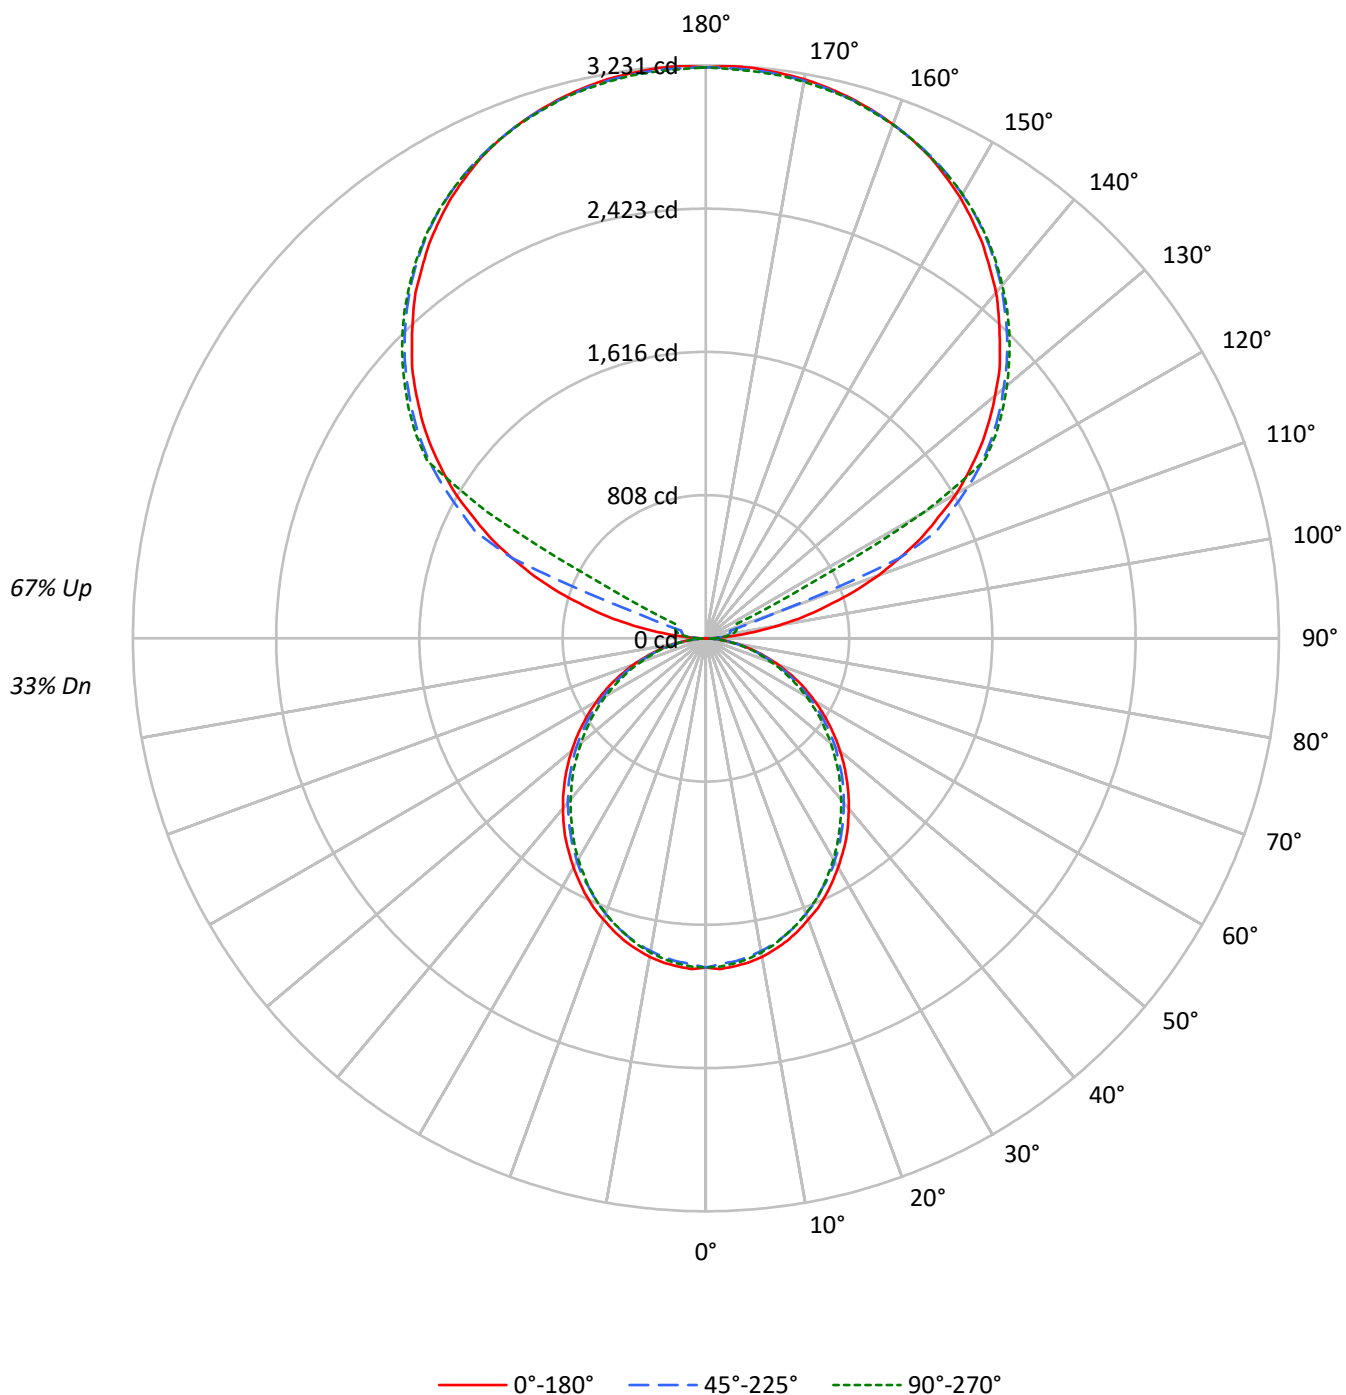

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1474	1474	1474
5°	1477	1454	1464
10°	1465	1434	1444
15°	1443	1411	1413
20°	1414	1378	1381
25°	1385	1339	1344
30°	1349	1302	1298
35°	1315	1259	1248
40°	1272	1216	1201
45°	1230	1172	1153
50°	1184	1126	1098
55°	1136	1073	1047
60°	1081	1010	988
65°	1022	945	919
70°	946	866	845
75°	841	771	776
80°	715	650	645
85°	517	440	427

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1709 cd/sqm

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.7	1.2
10°-20°	491.5	3.5
20°-30°	722.3	5.1
30°-40°	838.9	5.9
40°-50°	837.9	5.9
50°-60°	730.6	5.2
60°-70°	540.1	3.8
70°-80°	305.6	2.2
80°-90°	86.3	0.6
90°-100°	106.2	0.7
100°-110°	395.8	2.8
110°-120°	1049.6	7.4
120°-130°	1740.9	12.3
130°-140°	1849.2	13.1
140°-150°	1718.7	12.1
150°-160°	1381.8	9.8
160°-170°	890.4	6.3
170°-180°	306.5	2.2
0°-30°	1388.5	9.8
0°-40°	2227.5	15.7
0°-60°	3796.0	26.8
0°-90°	4728.0	33.4
90°-120°	1551.6	11.0
90°-150°	6860.4	48.4
90°-180°	9439.0	66.6
0°-180°	14166.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1856	1856	1856	1856	1856	
5°	1856	1849	1829	1844	1840	176
15°	1767	1756	1733	1740	1731	498
25°	1599	1585	1554	1558	1554	736
35°	1380	1362	1333	1322	1314	862
45°	1123	1110	1083	1064	1057	866
55°	850	839	817	796	787	760
65°	573	562	544	528	519	567
75°	300	296	287	277	280	320
85°	73	71	70	64	62	82
90°	2	28	46	58	63	13
95°	151	74	91	103	100	179
105°	708	778	142	168	177	757
115°	1340	1379	1438	359	191	1319
125°	1894	1924	1969	1985	1992	1689
135°	2344	2381	2402	2425	2421	1810
145°	2719	2716	2756	2772	2761	1700
155°	2994	2973	3001	3015	2996	1380
165°	3154	3140	3147	3164	3147	891
175°	3226	3210	3215	3231	3208	307
180°	3220	3220	3220	3220	3220	

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1856.0	1856.0	1856.0	1856.0	1856.0
2.5°	1866.8	1857.9	1838.3	1856.0	1852.7
5°	1856.0	1849.0	1829.3	1843.5	1840.2
7.5°	1843.5	1832.9	1813.3	1827.7	1824.0
10°	1824.0	1811.6	1790.2	1804.3	1799.1
12.5°	1797.1	1786.6	1765.2	1774.1	1770.4
15°	1766.8	1756.2	1732.9	1740.2	1731.2
17.5°	1729.3	1718.7	1695.4	1704.3	1695.4
20°	1688.3	1677.7	1652.7	1658.0	1651.0
22.5°	1647.4	1631.2	1608.0	1608.0	1604.3
25°	1599.1	1584.9	1554.5	1558.0	1554.5
27.5°	1545.5	1533.0	1509.9	1504.6	1495.7
30°	1492.1	1477.7	1451.0	1445.7	1438.5
32.5°	1434.9	1424.3	1395.7	1384.9	1377.8
35°	1379.6	1361.8	1333.2	1322.4	1313.6
37.5°	1317.1	1301.1	1272.4	1259.9	1251.1
40°	1253.0	1238.6	1210.0	1194.0	1186.9
42.5°	1190.5	1176.1	1147.7	1129.6	1119.0
45°	1122.7	1110.2	1083.3	1063.8	1056.6
47.5°	1056.6	1044.1	1015.5	995.8	985.2
50°	986.9	978.0	953.0	928.1	919.1
52.5°	919.1	906.6	883.5	863.8	851.3
55°	849.6	838.9	817.4	796.0	787.1
57.5°	779.9	771.0	747.7	726.4	719.1
60°	710.3	703.3	678.3	658.5	653.3
62.5°	642.5	630.0	612.2	594.3	587.2
65°	573.0	562.2	544.4	528.3	519.4
67.5°	501.6	492.6	476.6	464.1	456.9
70°	435.5	428.3	412.2	399.7	392.8
72.5°	367.8	360.5	351.6	339.1	333.8
75°	299.7	296.3	287.2	276.7	280.3
77.5°	239.2	231.9	228.4	223.0	217.8
80°	178.6	176.7	173.1	167.8	164.2
82.5°	121.3	121.3	119.6	112.5	112.5
85°	73.1	71.4	69.6	64.2	62.5
87.5°	32.1	28.6	25.0	19.7	17.8
90°	2.2	28.0	46.5	58.4	62.8
92.5°	58.4	48.9	55.9	60.6	62.8
95°	151.3	74.4	90.7	102.7	100.2
97.5°	272.5	81.6	118.7	125.8	128.1
100°	412.5	93.2	132.8	151.3	156.1
102.5°	566.0	561.6	137.5	162.9	170.1
105°	708.2	778.2	142.2	167.6	177.1
107.5°	873.7	931.8	146.9	172.4	181.7
110°	1032.1	1080.9	407.7	174.9	183.9

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1181.2	1223.0	1183.5	179.3	186.5
115°	1339.5	1379.1	1437.5	358.8	191.2
117.5°	1477.0	1523.5	1563.3	1230.0	619.7
120°	1630.9	1665.7	1707.8	1735.7	1421.2
122.5°	1761.2	1798.5	1845.2	1859.1	1861.5
125°	1894.0	1924.4	1968.7	1985.0	1991.9
127.5°	2015.1	2047.8	2082.9	2106.1	2108.3
130°	2129.3	2166.7	2192.2	2217.9	2215.7
132.5°	2245.8	2276.2	2301.7	2322.7	2320.5
135°	2343.8	2381.1	2401.9	2425.4	2420.7
137.5°	2446.2	2474.1	2497.6	2520.8	2513.9
140°	2546.2	2565.1	2590.5	2611.6	2599.9
142.5°	2630.4	2646.7	2676.8	2695.3	2683.8
145°	2718.9	2716.4	2756.0	2772.3	2760.7
147.5°	2795.5	2788.6	2828.1	2839.8	2830.7
150°	2870.2	2853.9	2891.3	2905.1	2893.5
152.5°	2933.0	2914.5	2949.4	2963.4	2947.1
155°	2993.7	2972.9	3000.8	3014.6	2996.1
157.5°	3042.6	3024.1	3045.1	3061.4	3042.6
160°	3084.7	3070.5	3084.7	3098.5	3082.2
162.5°	3121.7	3107.8	3119.5	3135.8	3114.8
165°	3154.3	3140.5	3147.4	3163.8	3147.4
167.5°	3180.1	3165.9	3173.2	3189.5	3168.4
170°	3201.1	3187.0	3191.7	3208.0	3187.0
172.5°	3214.9	3201.1	3205.8	3222.1	3201.1
175°	3226.5	3210.2	3214.9	3231.3	3208.0
177.5°	3231.3	3214.9	3217.5	3233.8	3212.7
180°	3219.7	3219.7	3219.7	3219.7	3219.7

TEST NUMBER: P926427

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.84	7.57	7.93	8.66	10.15	6.41	7.14	7.50	8.23	9.72
	3H	8.49	9.15	9.59	10.24	11.75	8.02	8.67	9.12	9.77	11.28
	4H	9.07	9.69	10.18	10.79	12.30	8.60	9.22	9.71	10.32	11.83
	6H	9.47	10.04	10.58	11.14	12.66	8.99	9.56	10.11	10.66	12.19
	8H	9.57	10.11	10.69	11.23	12.75	9.09	9.64	10.21	10.75	12.27
	12H	9.61	10.13	10.74	11.24	12.78	9.13	9.65	10.26	10.76	12.30
4H	2H	7.29	7.91	8.40	9.01	10.52	6.94	7.56	8.06	8.66	10.17
	3H	9.14	9.66	10.26	10.78	12.31	8.75	9.27	9.87	10.39	11.92
	4H	9.85	10.33	10.98	11.44	12.99	9.45	9.92	10.57	11.03	12.58
	6H	10.36	10.77	11.49	11.90	13.44	9.95	10.36	11.08	11.49	13.03
	8H	10.50	10.89	11.64	12.01	13.57	10.09	10.47	11.22	11.60	13.16
	12H	10.57	10.92	11.72	12.06	13.62	10.15	10.50	11.30	11.63	13.19
8H	4H	10.04	10.42	11.17	11.54	13.10	9.68	10.06	10.81	11.18	12.74
	6H	10.66	10.98	11.81	12.15	13.70	10.30	10.61	11.45	11.78	13.34
	8H	10.88	11.16	12.04	12.31	13.88	10.51	10.79	11.67	11.94	13.51
	12H	11.01	11.25	12.17	12.39	14.00	10.62	10.86	11.79	12.01	13.62
12H	4H	10.02	10.36	11.16	11.50	13.06	9.66	10.01	10.81	11.15	12.71
	6H	10.69	10.97	11.85	12.12	13.69	10.34	10.61	11.50	11.76	13.34
	8H	10.93	11.17	12.09	12.31	13.92	10.57	10.81	11.73	11.96	13.56

END OF REPORT