

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926436

Luminaire Tested: DFN2DIP-TR4F0-050D120US950-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926436
REPORT IS A COMBINATION OF REPORTS P900516 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D120US950-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14186.0 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 133.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

Luminous Intensity Polar Plot

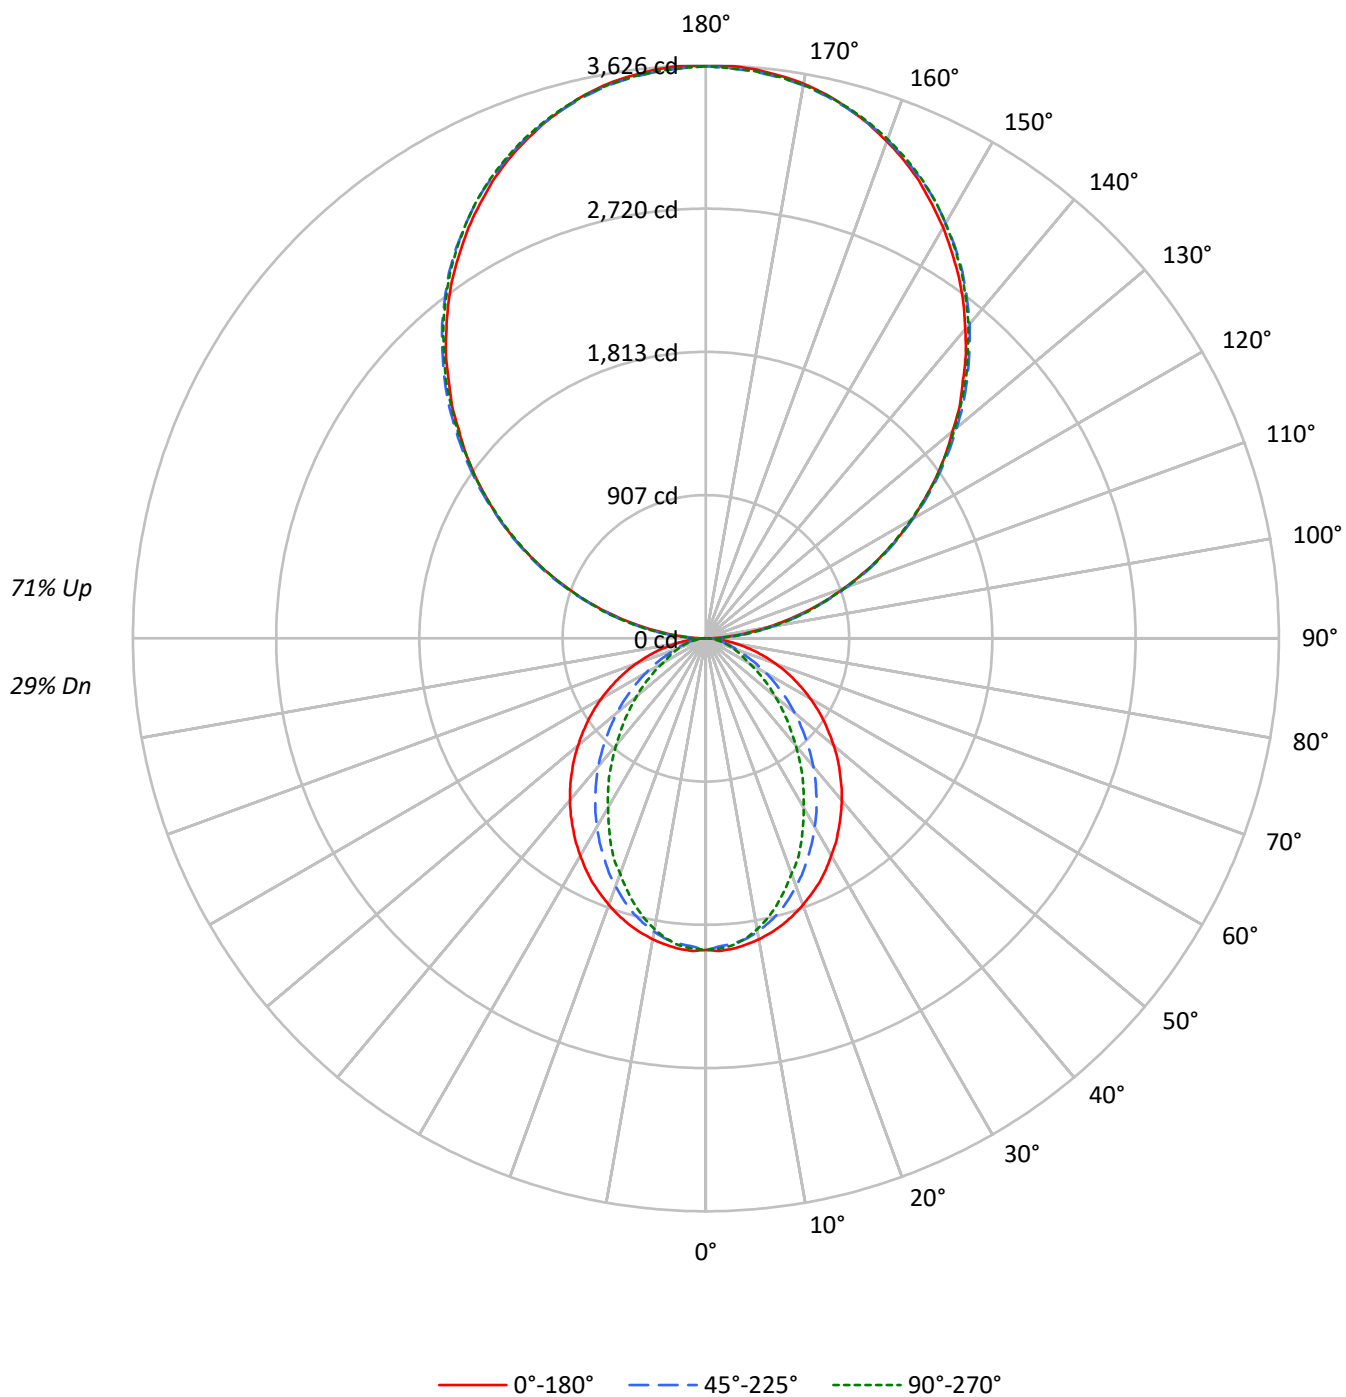

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	53	53	53	37	37	37
1	93	89	86	82	83	80	77	74	63	61	59	47	46	45	33	32	31
2	85	78	72	68	76	70	65	61	55	52	49	42	40	38	29	28	27
3	78	69	62	56	69	62	56	51	49	45	42	37	34	32	26	24	23
4	71	61	54	48	64	55	49	44	44	39	36	33	30	28	23	22	20
5	65	54	47	41	58	49	42	38	39	34	31	30	27	24	21	19	18
6	60	49	41	36	54	44	37	33	35	30	27	27	24	21	19	17	16
7	56	44	36	31	50	40	33	29	32	27	24	25	21	19	18	16	14
8	52	40	32	27	46	36	30	25	29	24	21	22	19	17	16	14	13
9	48	36	29	24	43	33	27	22	27	22	19	21	17	15	15	13	11
10	45	33	26	22	40	30	24	20	24	20	17	19	16	14	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1566	1566	1566
5°	1569	1541	1551
10°	1553	1511	1501
15°	1532	1461	1423
20°	1504	1392	1327
25°	1475	1315	1234
30°	1436	1236	1117
35°	1398	1151	1014
40°	1359	1063	896
45°	1314	965	789
50°	1267	867	684
55°	1219	761	584
60°	1162	651	480
65°	1098	539	432
70°	1019	435	391
75°	921	383	356
80°	778	321	308
85°	542	215	232

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2822 cd/sqm

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.3
10°-20°	507.2	3.6
20°-30°	712.1	5.0
30°-40°	776.3	5.5
40°-50°	713.5	5.0
50°-60°	560.3	3.9
60°-70°	364.7	2.6
70°-80°	187.7	1.3
80°-90°	58.2	0.4
90°-100°	224.0	1.6
100°-110°	711.8	5.0
110°-120°	1218.2	8.6
120°-130°	1602.1	11.3
130°-140°	1798.3	12.7
140°-150°	1763.5	12.4
150°-160°	1479.3	10.4
160°-170°	981.0	6.9
170°-180°	342.9	2.4
0°-30°	1404.1	9.9
0°-40°	2180.4	15.4
0°-60°	3454.1	24.3
0°-90°	4064.8	28.7
90°-120°	2154.1	15.2
90°-150°	7318.0	51.6
90°-180°	10121.0	71.3
0°-180°	14186.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	3	39	107	100	104	14
95°	159	190	195	195	190	177
105°	657	666	672	678	678	693
115°	1222	1240	1234	1231	1222	1209
125°	1778	1805	1797	1787	1784	1589
135°	2300	2334	2340	2337	2328	1778
145°	2792	2814	2831	2835	2823	1745
155°	3193	3201	3211	3226	3217	1470
165°	3473	3470	3470	3492	3476	980
175°	3614	3605	3599	3620	3602	343
180°	3620	3620	3620	3620	3620	

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	3.2	39.3	106.9	100.5	103.7
92.5°	67.6	91.7	94.9	98.3	98.3
95°	159.3	189.9	195.4	195.4	189.9
97.5°	265.2	293.6	305.7	305.7	305.7
100°	387.5	412.6	421.3	421.3	418.0
102.5°	516.3	534.8	546.8	550.2	546.8
105°	657.1	665.8	672.4	677.8	677.8
107.5°	796.8	809.9	809.9	812.0	796.8
110°	932.2	949.6	949.6	949.6	940.9

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1078.4	1097.0	1093.7	1085.0	1078.4
115°	1222.5	1240.0	1234.5	1231.2	1222.5
117.5°	1365.5	1389.5	1374.2	1365.5	1356.8
120°	1509.6	1533.6	1509.6	1509.6	1499.8
122.5°	1640.6	1671.1	1655.9	1647.1	1640.6
125°	1778.1	1805.3	1796.7	1786.8	1783.5
127.5°	1912.4	1946.2	1934.1	1921.1	1912.4
130°	2037.8	2077.1	2071.7	2065.1	2053.1
132.5°	2178.6	2209.3	2211.4	2196.1	2187.4
135°	2299.8	2333.7	2340.3	2336.9	2328.2
137.5°	2435.2	2462.5	2467.9	2465.7	2452.6
140°	2554.1	2581.4	2596.7	2596.7	2584.7
142.5°	2676.4	2703.7	2712.4	2715.7	2703.7
145°	2792.1	2813.9	2831.4	2834.7	2822.7
147.5°	2895.8	2923.1	2936.2	2941.7	2929.6
150°	3002.8	3021.3	3033.3	3043.2	3033.3
152.5°	3097.7	3116.2	3131.6	3143.6	3131.6
155°	3192.7	3201.4	3211.3	3226.5	3216.7
157.5°	3274.6	3281.1	3286.5	3308.4	3293.1
160°	3347.7	3354.3	3357.5	3376.1	3362.9
162.5°	3415.3	3415.3	3418.7	3439.4	3424.1
165°	3473.2	3470.0	3470.0	3491.7	3476.5
167.5°	3525.6	3515.8	3515.8	3537.6	3522.4
170°	3564.9	3556.1	3552.9	3574.7	3556.1
172.5°	3592.2	3583.4	3580.2	3602.0	3583.4
175°	3614.0	3605.3	3598.8	3620.5	3602.0
177.5°	3626.1	3617.3	3610.7	3629.3	3610.7
180°	3620.5	3620.5	3620.5	3620.5	3620.5

TEST NUMBER: P926436

CATALOG NUMBER: DFN2DIP-TR4F0-050D120US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.28	6.96	7.40	8.07	9.62	2.25	2.93	3.38	4.05	5.60
	3H	7.94	8.55	9.08	9.68	11.24	3.43	4.04	4.56	5.16	6.73
	4H	8.54	9.12	9.69	10.25	11.82	3.87	4.45	5.02	5.58	7.14
	6H	8.96	9.49	10.11	10.62	12.20	4.19	4.72	5.34	5.84	7.43
	8H	9.08	9.59	10.23	10.73	12.30	4.27	4.78	5.43	5.92	7.49
	12H	9.14	9.62	10.29	10.75	12.35	4.31	4.79	5.47	5.93	7.52
4H	2H	6.28	6.86	7.43	7.98	9.55	2.83	3.41	3.98	4.53	6.10
	3H	8.09	8.57	9.25	9.72	11.31	4.16	4.65	5.32	5.80	7.38
	4H	8.78	9.22	9.94	10.36	11.96	4.71	5.15	5.87	6.29	7.89
	6H	9.28	9.66	10.45	10.83	12.42	5.12	5.50	6.28	6.66	8.25
	8H	9.46	9.81	10.62	10.96	12.57	5.24	5.60	6.41	6.75	8.36
	12H	9.55	9.87	10.72	11.03	12.64	5.30	5.62	6.48	6.79	8.40
8H	4H	8.74	9.09	9.90	10.24	11.85	4.98	5.33	6.14	6.48	8.09
	6H	9.30	9.59	10.48	10.78	12.39	5.49	5.78	6.67	6.98	8.58
	8H	9.51	9.77	10.70	10.94	12.56	5.68	5.93	6.87	7.11	8.73
	12H	9.64	9.87	10.83	11.04	12.70	5.79	6.02	6.98	7.19	8.85
12H	4H	8.68	9.00	9.86	10.17	11.78	4.97	5.29	6.15	6.46	8.07
	6H	9.27	9.52	10.46	10.70	12.32	5.54	5.79	6.73	6.97	8.59
	8H	9.48	9.71	10.68	10.88	12.54	5.74	5.97	6.93	7.14	8.80

END OF REPORT