

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926439

Luminaire Tested: DFN2DIP-TR4F0-060D040US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926439
REPORT IS A COMBINATION OF REPORTS P901893 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D040US950-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9444.6 lumens
Efficiency: N/A
Efficacy: 112.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

Luminous Intensity Polar Plot

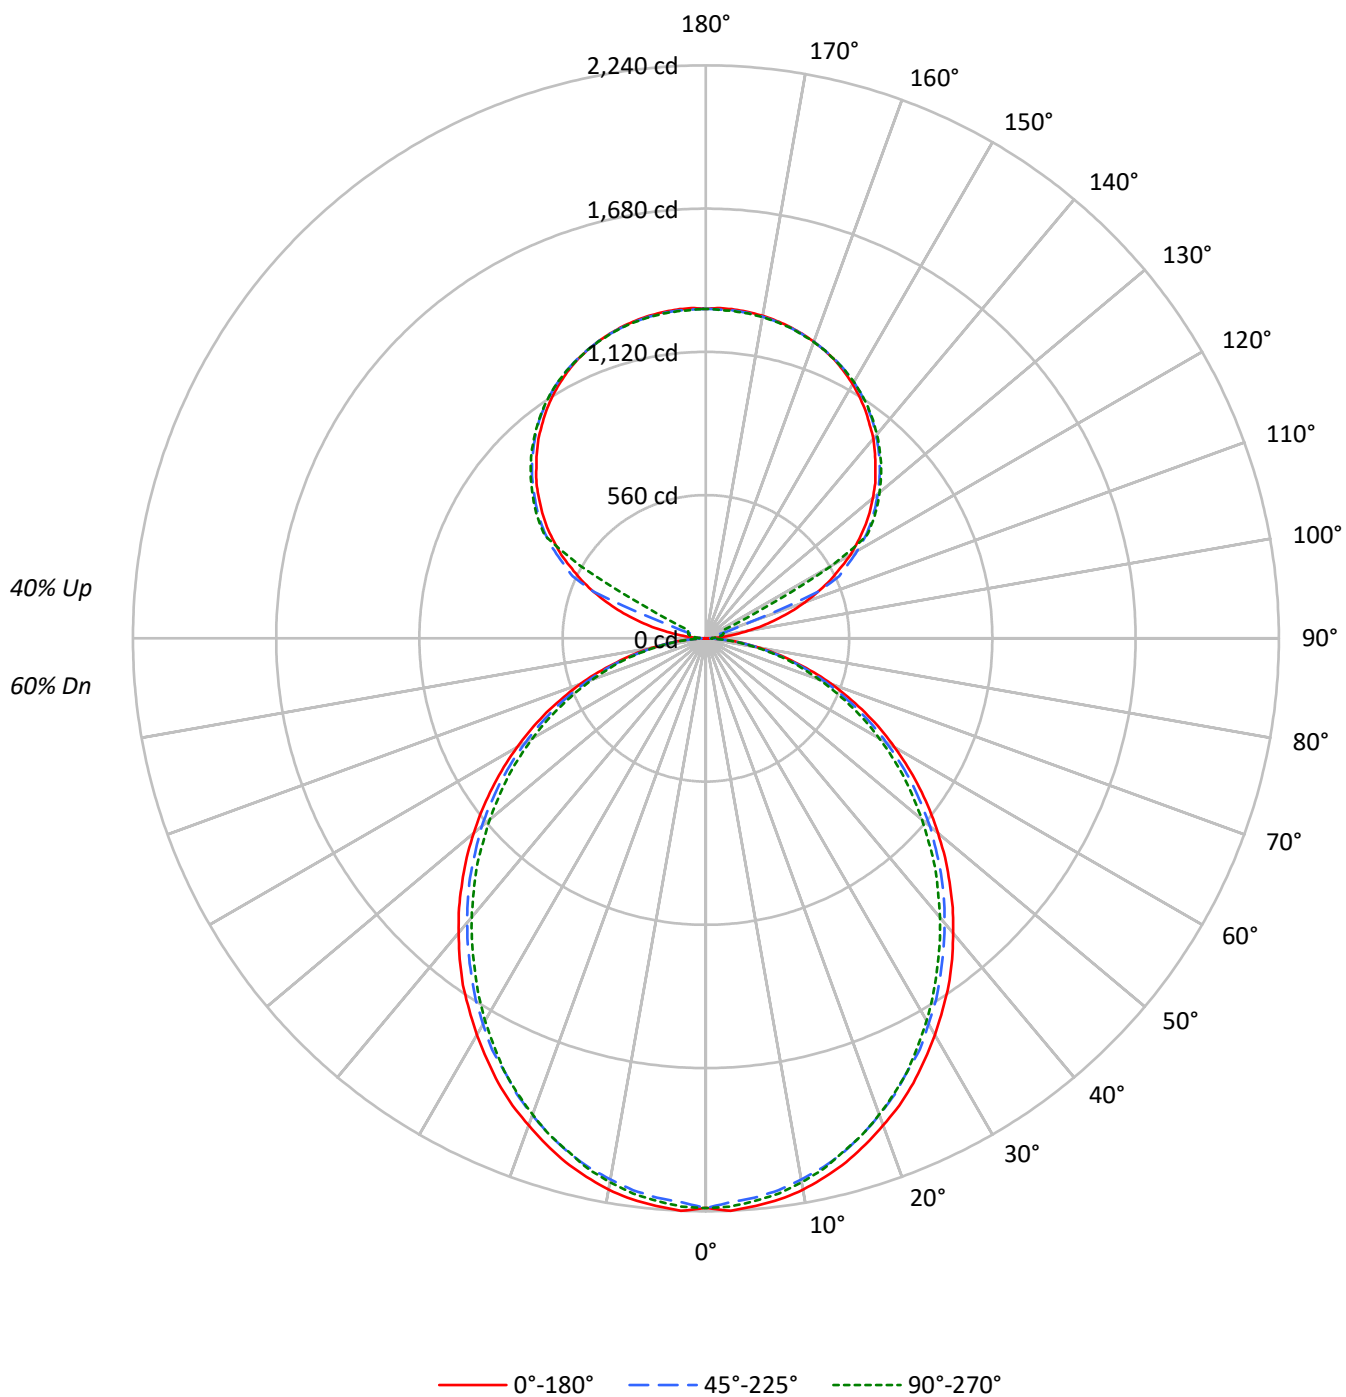

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1769	1769	1769
5°	1772	1745	1756
10°	1758	1721	1733
15°	1732	1693	1695
20°	1697	1653	1657
25°	1662	1606	1613
30°	1619	1563	1557
35°	1578	1511	1498
40°	1527	1459	1442
45°	1476	1406	1384
50°	1421	1351	1317
55°	1363	1288	1256
60°	1297	1212	1186
65°	1226	1134	1102
70°	1135	1039	1013
75°	1009	925	931
80°	857	780	773
85°	620	529	513

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1476 cd/sqm

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.2
10°-20°	589.8	6.2
20°-30°	866.8	9.2
30°-40°	1006.7	10.7
40°-50°	1005.5	10.6
50°-60°	876.7	9.3
60°-70°	648.1	6.9
70°-80°	366.7	3.9
80°-90°	99.1	1.0
90°-100°	42.5	0.4
100°-110°	158.3	1.7
110°-120°	419.9	4.4
120°-130°	696.4	7.4
130°-140°	739.7	7.8
140°-150°	687.5	7.3
150°-160°	552.7	5.9
160°-170°	356.1	3.8
170°-180°	122.6	1.3
0°-30°	1666.2	17.6
0°-40°	2673.0	28.3
0°-60°	4555.2	48.2
0°-90°	5669.0	60.0
90°-120°	620.6	6.6
90°-150°	2744.1	29.1
90°-180°	3776.0	40.0
0°-180°	9444.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	11	19	23	25	9
95°	60	30	36	41	40	72
105°	283	311	57	67	71	303
115°	536	552	575	144	76	527
125°	758	770	787	794	797	676
135°	938	952	961	970	968	724
145°	1088	1087	1102	1109	1104	680
155°	1198	1189	1200	1206	1198	552
165°	1262	1256	1259	1266	1259	356
175°	1291	1284	1286	1292	1283	123
180°	1288	1288	1288	1288	1288	

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	0.9	11.2	18.6	23.4	25.1
92.5°	23.4	19.6	22.3	24.2	25.1
95°	60.5	29.8	36.3	41.0	40.1
97.5°	109.0	32.6	47.5	50.4	51.2
100°	164.9	37.3	53.1	60.5	62.4
102.5°	226.4	224.7	55.0	65.2	68.0
105°	283.2	311.3	56.9	67.1	70.8
107.5°	349.5	372.7	58.8	69.0	72.7
110°	412.9	432.4	163.1	69.9	73.6

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	472.5	489.2	473.4	71.7	74.6
115°	535.8	551.6	575.0	143.5	76.5
117.5°	590.8	609.4	625.3	492.0	247.8
120°	652.3	666.3	683.1	694.3	568.5
122.5°	704.4	719.4	738.1	743.6	744.6
125°	757.6	769.8	787.4	794.0	796.8
127.5°	806.0	819.1	833.1	842.5	843.3
130°	851.7	866.7	876.8	887.1	886.3
132.5°	898.3	910.5	920.7	929.1	928.2
135°	937.5	952.5	960.8	970.1	968.3
137.5°	978.4	989.6	999.0	1008.3	1005.5
140°	1018.5	1026.0	1036.2	1044.6	1040.0
142.5°	1052.2	1058.7	1070.8	1078.1	1073.5
145°	1087.6	1086.6	1102.3	1108.9	1104.3
147.5°	1118.2	1115.4	1131.3	1135.9	1132.3
150°	1148.0	1141.6	1156.5	1162.1	1157.4
152.5°	1173.2	1165.8	1179.7	1185.3	1178.9
155°	1197.5	1189.2	1200.3	1205.9	1198.4
157.5°	1217.0	1209.6	1218.1	1224.6	1217.0
160°	1233.8	1228.2	1233.8	1239.3	1232.9
162.5°	1248.7	1243.2	1247.8	1254.3	1245.9
165°	1261.8	1256.2	1259.0	1265.5	1259.0
167.5°	1272.1	1266.3	1269.3	1275.8	1267.4
170°	1280.5	1274.8	1276.6	1283.2	1274.8
172.5°	1286.0	1280.5	1282.4	1288.9	1280.5
175°	1290.6	1284.1	1286.0	1292.5	1283.2
177.5°	1292.5	1286.0	1286.9	1293.5	1285.1
180°	1287.9	1287.9	1287.9	1287.9	1287.9

TEST NUMBER: P926439

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.13	11.09	10.99	11.97	13.09	9.70	10.65	10.56	11.54	12.66
	3H	11.79	12.65	12.67	13.55	14.70	11.32	12.18	12.20	13.08	14.23
	4H	12.39	13.20	13.28	14.10	15.26	11.91	12.73	12.81	13.63	14.79
	6H	12.79	13.54	13.70	14.45	15.62	12.32	13.07	13.22	13.98	15.14
	8H	12.90	13.61	13.81	14.54	15.71	12.42	13.14	13.34	14.07	15.23
	12H	12.95	13.63	13.87	14.55	15.75	12.47	13.15	13.39	14.07	15.27
4H	2H	10.60	11.41	11.50	12.32	13.47	10.26	11.07	11.15	11.97	13.13
	3H	12.47	13.15	13.38	14.09	15.26	12.08	12.76	12.99	13.70	14.87
	4H	13.19	13.81	14.11	14.74	15.94	12.79	13.41	13.71	14.34	15.53
	6H	13.71	14.25	14.65	15.20	16.40	13.30	13.84	14.24	14.79	15.99
	8H	13.87	14.37	14.80	15.31	16.52	13.45	13.95	14.39	14.90	16.11
	12H	13.94	14.39	14.90	15.36	16.58	13.52	13.97	14.48	14.94	16.15
8H	4H	13.40	13.90	14.33	14.84	16.06	13.04	13.54	13.97	14.48	15.70
	6H	14.03	14.45	15.00	15.44	16.65	13.67	14.08	14.63	15.07	16.28
	8H	14.25	14.62	15.23	15.60	16.83	13.89	14.25	14.86	15.23	16.46
	12H	14.39	14.71	15.37	15.69	16.96	14.01	14.33	14.98	15.30	16.58
12H	4H	13.39	13.84	14.34	14.80	16.02	13.04	13.49	13.99	14.45	15.67
	6H	14.06	14.43	15.04	15.41	16.64	13.71	14.08	14.68	15.06	16.29
	8H	14.31	14.63	15.29	15.60	16.88	13.95	14.28	14.93	15.25	16.52