

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926558

Luminaire Tested: DFN2DIP-TR4F0-090D070US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926558
REPORT IS A COMBINATION OF REPORTS P900433 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D070US950-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14410.2 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 139.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

Luminous Intensity Polar Plot

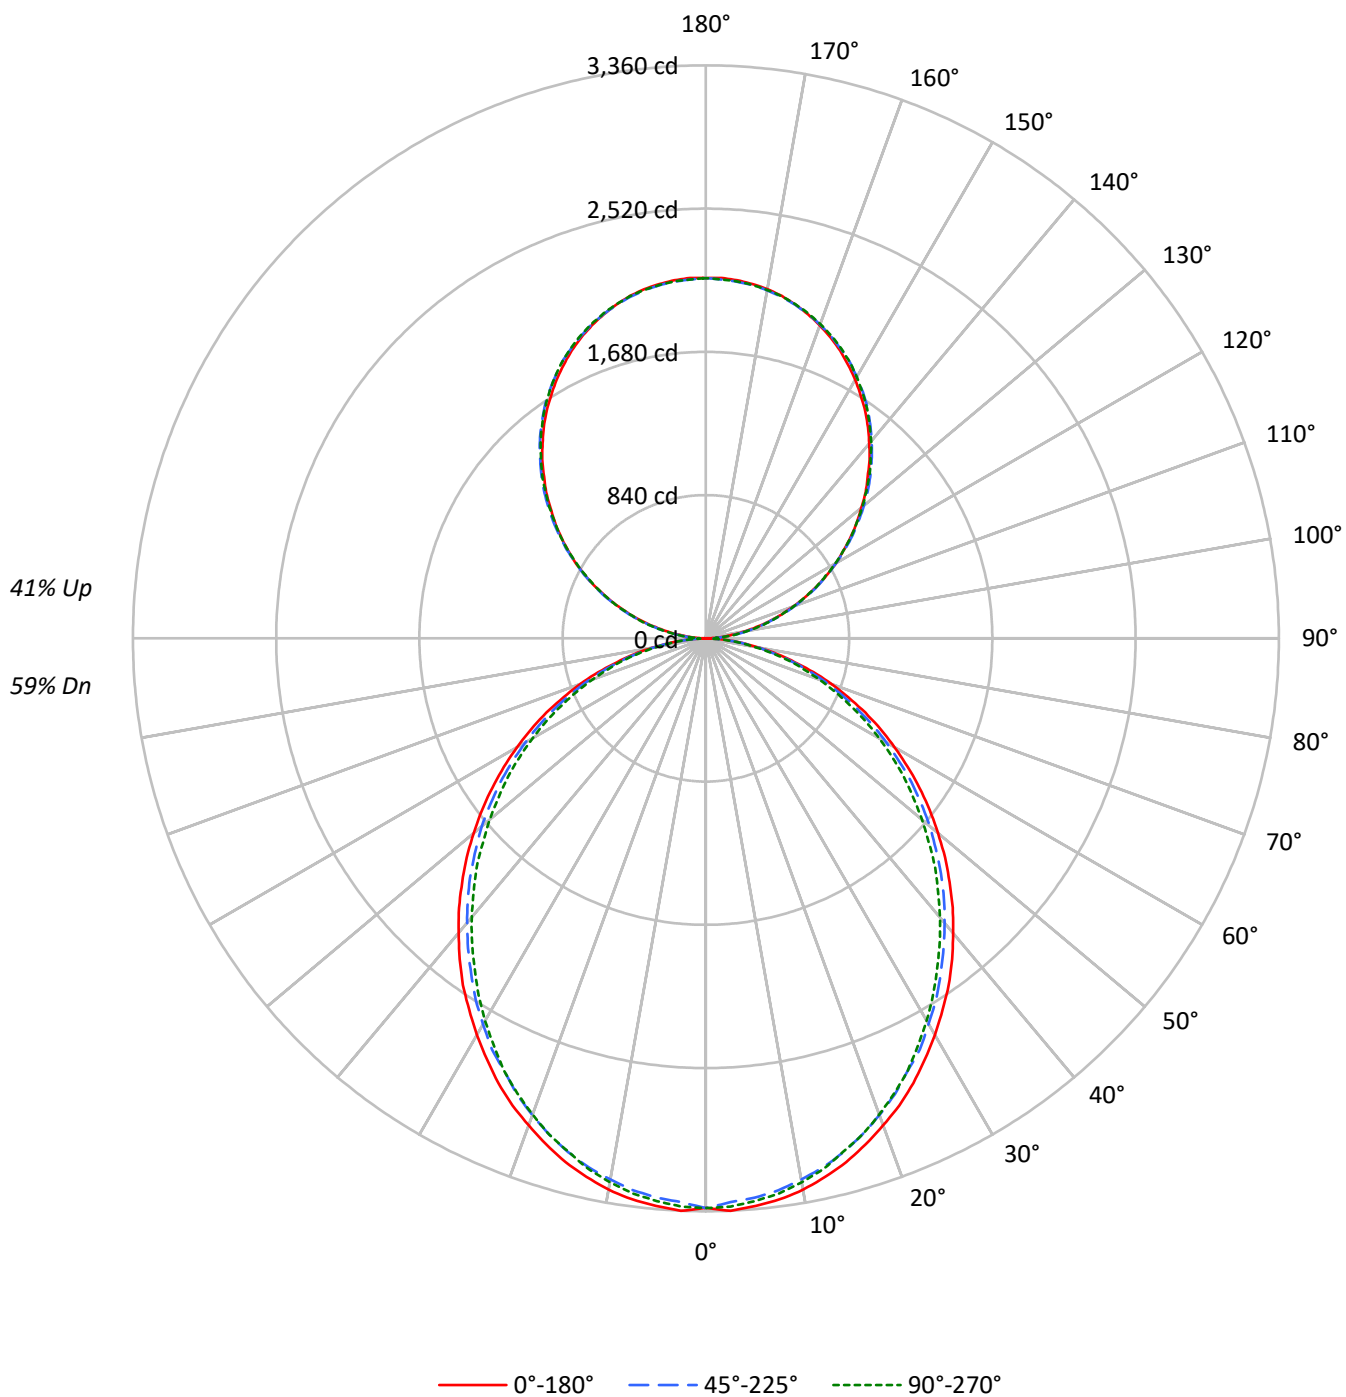

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	78	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	73	68	68	64	60	59	56	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	42	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	33	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2654	2654	2654
5°	2658	2617	2635
10°	2637	2582	2599
15°	2598	2539	2543
20°	2546	2480	2486
25°	2494	2410	2420
30°	2428	2344	2336
35°	2367	2266	2247
40°	2290	2188	2163
45°	2214	2109	2076
50°	2131	2027	1976
55°	2044	1932	1884
60°	1946	1818	1778
65°	1839	1701	1654
70°	1703	1559	1520
75°	1513	1388	1396
80°	1286	1170	1160
85°	931	794	769

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2214 cd/sqm

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	2.2
10°-20°	884.7	6.1
20°-30°	1300.2	9.0
30°-40°	1510.1	10.5
40°-50°	1508.2	10.5
50°-60°	1315.1	9.1
60°-70°	972.2	6.7
70°-80°	550.0	3.8
80°-90°	151.2	1.0
90°-100°	130.7	0.9
100°-110°	415.3	2.9
110°-120°	710.6	4.9
120°-130°	934.6	6.5
130°-140°	1049.0	7.3
140°-150°	1028.7	7.1
150°-160°	862.9	6.0
160°-170°	572.3	4.0
170°-180°	200.0	1.4
0°-30°	2499.3	17.3
0°-40°	4009.4	27.8
0°-60°	6832.8	47.4
0°-90°	8506.2	59.0
90°-120°	1256.6	8.7
90°-150°	4268.9	29.6
90°-180°	5904.0	41.0
0°-180°	14410.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	2	23	62	59	60	14
95°	93	111	114	114	111	103
105°	383	388	392	395	395	405
115°	713	723	720	718	713	705
125°	1037	1053	1048	1042	1040	927
135°	1342	1361	1365	1363	1358	1037
145°	1629	1642	1652	1654	1647	1018
155°	1862	1868	1873	1882	1876	857
165°	2026	2024	2024	2037	2028	572
175°	2108	2103	2099	2112	2101	200
180°	2112	2112	2112	2112	2112	

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	1.9	22.9	62.4	58.6	60.5
92.5°	39.5	53.5	55.4	57.3	57.3
95°	92.9	110.8	114.0	114.0	110.8
97.5°	154.7	171.2	178.3	178.3	178.3
100°	226.0	240.7	245.8	245.8	243.8
102.5°	301.2	312.0	319.0	320.9	319.0
105°	383.3	388.4	392.2	395.4	395.4
107.5°	464.8	472.4	472.4	473.8	464.8
110°	543.8	554.0	554.0	554.0	548.8

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	629.1	639.9	638.0	632.9	629.1
115°	713.1	723.3	720.2	718.3	713.1
117.5°	796.5	810.5	801.6	796.5	791.4
120°	880.5	894.6	880.5	880.5	874.8
122.5°	957.0	974.8	965.9	960.8	957.0
125°	1037.2	1053.1	1048.1	1042.3	1040.4
127.5°	1115.5	1135.3	1128.3	1120.7	1115.5
130°	1188.8	1211.7	1208.5	1204.7	1197.7
132.5°	1270.9	1288.8	1290.0	1281.1	1276.0
135°	1341.6	1361.3	1365.2	1363.2	1358.1
137.5°	1420.5	1436.4	1439.6	1438.3	1430.7
140°	1490.0	1505.9	1514.8	1514.8	1507.8
142.5°	1561.2	1577.2	1582.2	1584.1	1577.2
145°	1628.8	1641.5	1651.7	1653.6	1646.6
147.5°	1689.2	1705.2	1712.8	1716.0	1709.0
150°	1751.6	1762.4	1769.5	1775.2	1769.5
152.5°	1807.0	1817.8	1826.7	1833.8	1826.7
155°	1862.4	1867.5	1873.3	1882.1	1876.4
157.5°	1910.2	1914.0	1917.2	1929.9	1921.0
160°	1952.8	1956.7	1958.6	1969.3	1961.7
162.5°	1992.3	1992.3	1994.2	2006.3	1997.4
165°	2026.0	2024.1	2024.1	2036.9	2027.9
167.5°	2056.6	2050.9	2050.9	2063.6	2054.7
170°	2079.5	2074.5	2072.6	2085.3	2074.5
172.5°	2095.5	2090.3	2088.4	2101.2	2090.3
175°	2108.1	2103.1	2099.3	2112.0	2101.2
177.5°	2115.2	2110.1	2106.2	2117.1	2106.2
180°	2112.0	2112.0	2112.0	2112.0	2112.0

TEST NUMBER: P926558

CATALOG NUMBER: DFN2DIP-TR4F0-090D070US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.45	12.40	12.33	13.30	14.43	11.02	11.97	11.89	12.87	14.00
	3H	13.12	13.97	14.01	14.88	16.04	12.65	13.50	13.53	14.40	15.56
	4H	13.71	14.51	14.61	15.43	16.60	13.24	14.04	14.14	14.95	16.12
	6H	14.11	14.86	15.03	15.77	16.96	13.64	14.38	14.55	15.30	16.48
	8H	14.22	14.93	15.14	15.86	17.05	13.75	14.45	14.67	15.39	16.57
	12H	14.27	14.94	15.20	15.87	17.08	13.79	14.46	14.72	15.39	16.60
4H	2H	11.92	12.73	12.83	13.64	14.81	11.58	12.38	12.49	13.30	14.47
	3H	13.80	14.47	14.72	15.41	16.60	13.40	14.08	14.32	15.02	16.21
	4H	14.51	15.13	15.44	16.07	17.28	14.11	14.72	15.04	15.66	16.87
	6H	15.03	15.56	15.98	16.53	17.74	14.63	15.15	15.57	16.12	17.33
	8H	15.19	15.68	16.13	16.64	17.86	14.77	15.27	15.72	16.22	17.45
	12H	15.26	15.71	16.23	16.68	17.91	14.84	15.29	15.81	16.26	17.49
8H	4H	14.72	15.21	15.66	16.17	17.39	14.36	14.85	15.30	15.81	17.03
	6H	15.35	15.76	16.33	16.76	17.98	14.99	15.40	15.96	16.40	17.62
	8H	15.57	15.94	16.56	16.92	18.17	15.21	15.57	16.19	16.55	17.80
	12H	15.71	16.03	16.70	17.01	18.30	15.33	15.64	16.31	16.62	17.92
12H	4H	14.71	15.15	15.67	16.13	17.36	14.36	14.80	15.32	15.78	17.01
	6H	15.38	15.75	16.36	16.73	17.98	15.03	15.40	16.01	16.38	17.62
	8H	15.63	15.95	16.61	16.93	18.22	15.27	15.59	16.26	16.57	17.86

END OF REPORT