

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926601

Luminaire Tested: DFN2DIP-TR4F0-100D080US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926601
REPORT IS A COMBINATION OF REPORTS P901974 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D080US950-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15664.7 lumens
Efficiency: N/A
Efficacy: 97.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 160.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLLONL

Luminous Intensity Polar Plot

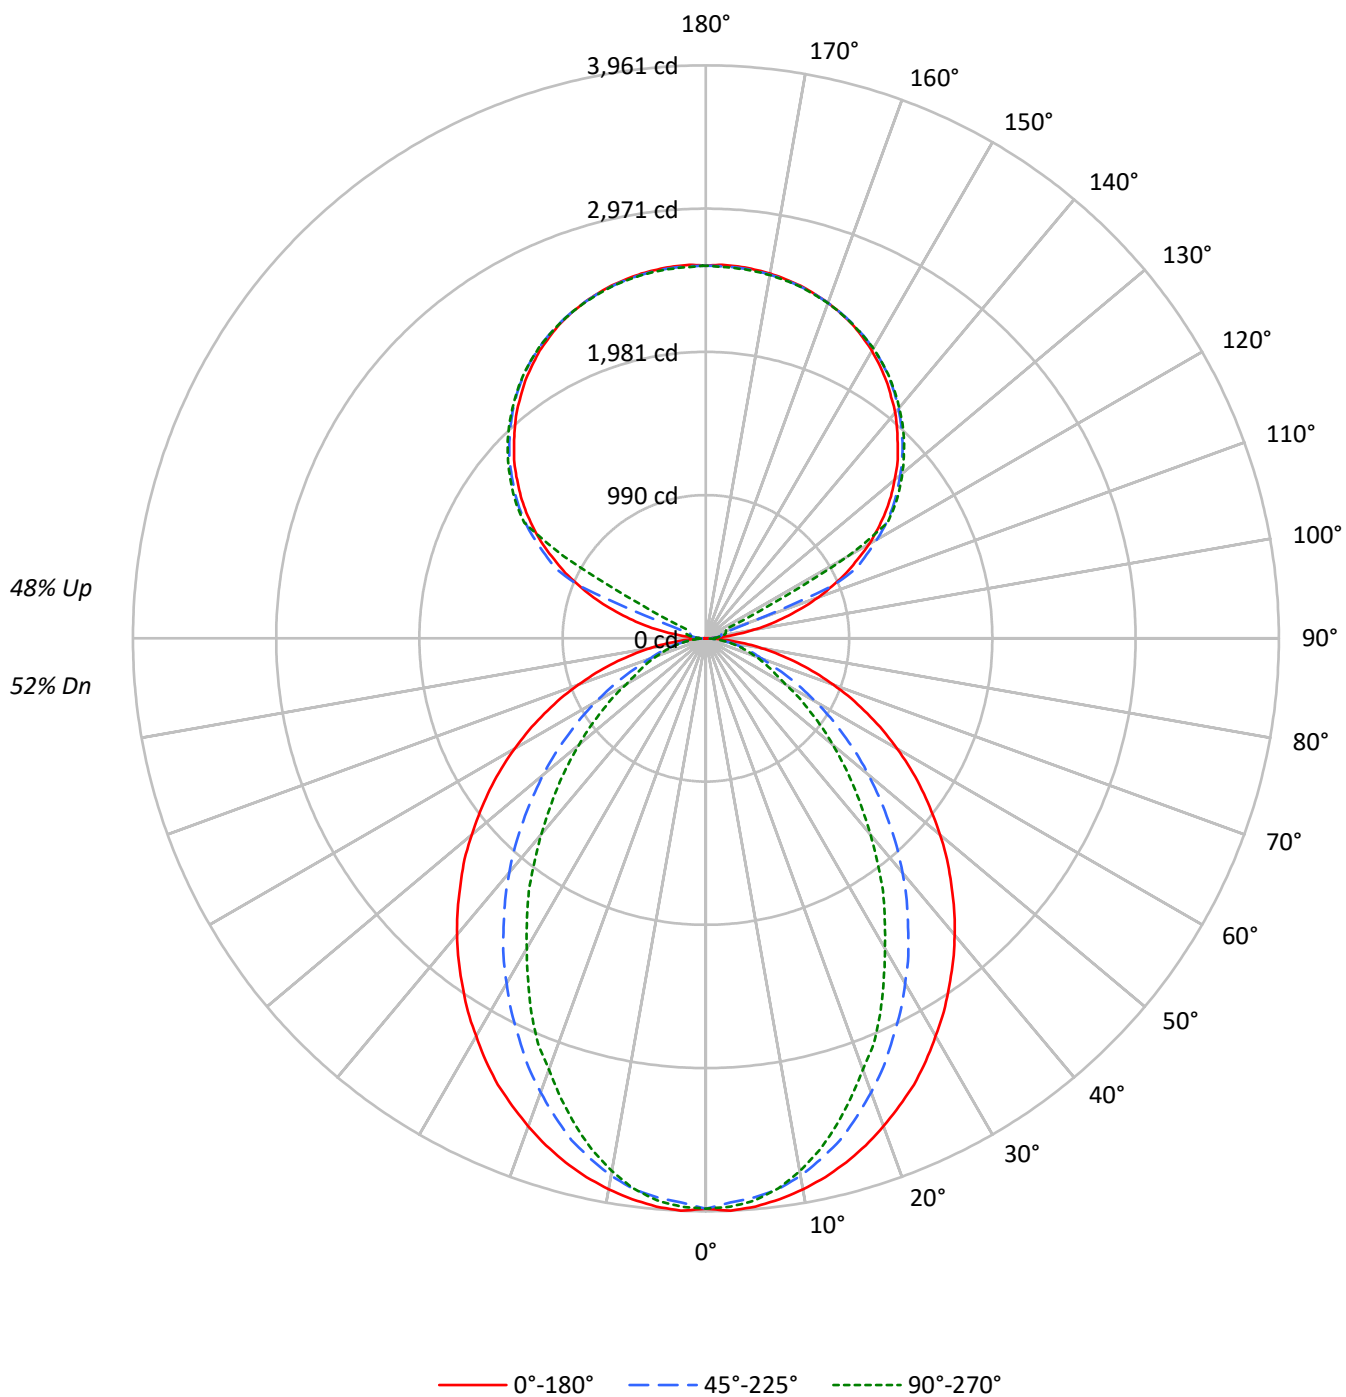

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	99	99	99	99	84	84	84	70	70	70	58	58	58
1	99	95	91	87	91	88	84	82	75	72	70	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	46	44	43
3	83	74	66	61	76	68	62	57	59	54	50	50	46	43	41	39	37
4	76	65	58	52	70	61	54	49	52	47	43	45	41	38	37	35	32
5	70	59	51	45	64	55	48	42	47	42	38	40	36	33	34	31	28
6	65	53	45	39	60	49	42	37	43	37	33	37	32	29	31	28	25
7	60	48	40	35	55	45	38	33	39	33	29	33	29	26	28	25	23
8	56	44	36	31	51	41	34	29	36	30	26	31	26	23	26	23	20
9	52	40	32	28	48	37	31	26	33	27	24	28	24	21	24	21	19
10	48	37	30	25	45	34	28	24	30	25	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3132	3132	3132
5°	3137	3083	3102
10°	3106	3022	3001
15°	3064	2922	2845
20°	3007	2784	2653
25°	2949	2630	2469
30°	2871	2472	2234
35°	2795	2302	2028
40°	2718	2126	1792
45°	2628	1930	1577
50°	2534	1733	1368
55°	2437	1522	1167
60°	2325	1302	961
65°	2195	1078	865
70°	2038	869	782
75°	1841	766	711
80°	1556	642	617
85°	1084	428	463

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2628 cd/sqm

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.5	2.4
10°-20°	1014.4	6.5
20°-30°	1424.2	9.1
30°-40°	1552.5	9.9
40°-50°	1426.9	9.1
50°-60°	1120.6	7.2
60°-70°	729.4	4.7
70°-80°	375.5	2.4
80°-90°	100.4	0.6
90°-100°	84.9	0.5
100°-110°	316.6	2.0
110°-120°	839.7	5.4
120°-130°	1392.7	8.9
130°-140°	1479.4	9.4
140°-150°	1374.9	8.8
150°-160°	1105.4	7.1
160°-170°	712.3	4.5
170°-180°	245.2	1.6
0°-30°	2808.2	17.9
0°-40°	4360.7	27.8
0°-60°	6908.2	44.1
0°-90°	8113.5	51.8
90°-120°	1241.3	7.9
90°-150°	5488.3	35.0
90°-180°	7551.0	48.2
0°-180°	15664.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3943	3943	3943	3943	3943	
5°	3943	3925	3878	3911	3900	374
15°	3750	3711	3590	3522	3486	1057
25°	3404	3290	3054	2908	2854	1566
35°	2933	2751	2437	2212	2134	1836
45°	2398	2159	1784	1531	1445	1852
55°	1823	1545	1160	946	878	1629
65°	1231	942	621	500	489	1221
75°	656	407	285	260	257	694
85°	153	78	68	68	68	176
90°	2	22	37	47	50	15
95°	121	60	73	82	80	143
105°	567	623	114	134	142	605
115°	1072	1103	1150	287	153	1055
125°	1515	1540	1575	1588	1594	1351
135°	1875	1905	1922	1940	1936	1448
145°	2175	2173	2205	2218	2208	1360
155°	2395	2378	2401	2412	2397	1104
165°	2524	2512	2518	2531	2518	713
175°	2581	2568	2572	2585	2566	246
180°	2576	2576	2576	2576	2576	

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3942.9	3942.9	3942.9	3942.9	3942.9
2.5°	3960.6	3942.9	3903.5	3939.4	3932.3
5°	3942.9	3925.0	3878.5	3910.7	3900.0
7.5°	3910.7	3889.5	3839.5	3853.5	3835.7
10°	3867.9	3842.9	3771.7	3760.8	3739.6
12.5°	3814.6	3782.3	3685.8	3664.6	3625.2
15°	3750.2	3710.8	3589.6	3521.9	3486.3
17.5°	3675.2	3618.0	3468.2	3389.8	3332.6
20°	3589.6	3518.1	3339.8	3250.9	3172.0
22.5°	3496.9	3414.7	3207.6	3086.6	3033.1
25°	3404.2	3289.9	3054.3	2908.2	2854.5
27.5°	3293.6	3172.0	2911.6	2743.9	2661.8
30°	3175.9	3039.9	2754.5	2572.8	2476.3
32.5°	3061.6	2897.2	2605.0	2390.7	2301.3
35°	2933.2	2751.1	2437.3	2212.4	2133.6
37.5°	2808.3	2611.8	2280.2	2033.7	1944.7
40°	2676.2	2462.3	2115.9	1862.6	1769.9
42.5°	2540.6	2312.3	1952.0	1687.7	1598.7
45°	2397.9	2158.6	1784.3	1530.6	1445.0
47.5°	2262.4	2009.1	1623.7	1370.0	1291.7
50°	2112.4	1859.2	1466.6	1220.2	1145.6
52.5°	1965.9	1698.3	1316.7	1081.2	1013.4
55°	1823.2	1545.0	1159.6	945.7	877.9
57.5°	1677.1	1391.6	1020.7	820.7	763.6
60°	1527.2	1241.7	874.2	692.4	635.3
62.5°	1381.0	1095.6	749.2	578.1	549.7
65°	1231.1	941.9	620.9	499.7	488.7
67.5°	1088.4	799.2	499.7	438.7	428.2
70°	938.4	660.3	413.7	378.2	363.9
72.5°	795.7	531.5	346.0	317.6	310.4
75°	656.4	406.6	285.4	260.4	257.0
77.5°	517.5	288.9	224.9	210.5	203.3
80°	388.8	207.1	171.1	157.1	157.1
82.5°	271.0	139.3	117.7	110.6	110.6
85°	153.3	78.3	67.7	67.7	67.7
87.5°	57.1	28.4	28.4	25.0	25.0
90°	1.8	22.3	37.2	46.7	50.3
92.5°	46.7	39.2	44.7	48.5	50.3
95°	121.1	59.5	72.6	82.1	80.1
97.5°	218.0	65.3	94.9	100.7	102.5
100°	330.0	74.6	106.3	121.1	124.8
102.5°	452.9	449.2	110.0	130.3	136.1
105°	566.6	622.6	113.7	134.1	141.7
107.5°	698.9	745.4	117.5	137.9	145.4
110°	825.8	864.7	326.3	139.9	147.2

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	945.0	978.4	946.8	143.4	149.2
115°	1071.6	1103.3	1150.0	287.1	152.9
117.5°	1181.6	1218.8	1250.7	984.0	495.8
120°	1304.7	1332.5	1366.2	1388.5	1136.9
122.5°	1408.9	1438.8	1476.2	1487.3	1489.3
125°	1515.1	1539.5	1574.9	1587.9	1593.5
127.5°	1612.1	1638.2	1666.4	1684.9	1686.7
130°	1703.5	1733.3	1753.7	1774.3	1772.5
132.5°	1796.7	1821.0	1841.4	1858.2	1856.4
135°	1875.0	1904.9	1921.5	1940.3	1936.5
137.5°	1956.9	1979.3	1998.1	2016.7	2011.1
140°	2037.0	2052.1	2072.5	2089.3	2079.9
142.5°	2104.3	2117.3	2141.4	2156.3	2147.0
145°	2175.1	2173.1	2204.8	2217.9	2208.5
147.5°	2236.5	2230.9	2262.5	2271.9	2264.5
150°	2296.2	2283.1	2313.0	2324.0	2314.8
152.5°	2346.5	2331.6	2359.4	2370.8	2357.7
155°	2394.9	2378.3	2400.6	2411.7	2396.9
157.5°	2434.0	2419.2	2436.0	2449.1	2434.0
160°	2467.7	2456.5	2467.7	2478.8	2465.7
162.5°	2497.4	2486.3	2495.6	2508.6	2491.8
165°	2523.5	2512.5	2518.0	2531.0	2518.0
167.5°	2544.0	2532.8	2538.5	2551.6	2534.8
170°	2560.9	2549.6	2553.4	2566.5	2549.6
172.5°	2572.0	2560.9	2564.6	2577.7	2560.9
175°	2581.2	2568.2	2572.0	2585.0	2566.5
177.5°	2585.0	2572.0	2573.9	2587.0	2570.2
180°	2575.7	2575.7	2575.7	2575.7	2575.7

TEST NUMBER: P926601

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.28	12.12	12.22	13.08	14.33	7.25	8.09	8.20	9.05	10.30
	3H	12.95	13.71	13.91	14.68	15.95	8.44	9.20	9.40	10.16	11.44
	4H	13.56	14.28	14.54	15.25	16.53	8.89	9.61	9.87	10.58	11.86
	6H	13.99	14.64	14.97	15.62	16.91	9.21	9.87	10.20	10.85	12.14
	8H	14.11	14.74	15.10	15.73	17.02	9.31	9.93	10.30	10.93	12.21
	12H	14.17	14.77	15.17	15.76	17.07	9.35	9.94	10.35	10.93	12.25
4H	2H	11.30	12.01	12.28	12.98	14.26	7.85	8.56	8.83	9.53	10.81
	3H	13.13	13.72	14.11	14.72	16.02	9.20	9.79	10.19	10.79	12.09
	4H	13.82	14.36	14.82	15.36	16.67	9.75	10.29	10.74	11.29	12.60
	6H	14.33	14.80	15.34	15.82	17.13	10.17	10.63	11.18	11.65	12.97
	8H	14.51	14.94	15.52	15.96	17.29	10.30	10.73	11.31	11.75	13.08
	12H	14.61	15.00	15.63	16.03	17.36	10.36	10.76	11.39	11.79	13.12
8H	4H	13.79	14.22	14.80	15.23	16.56	10.03	10.46	11.04	11.48	12.81
	6H	14.35	14.71	15.39	15.77	17.09	10.55	10.91	11.58	11.96	13.29
	8H	14.57	14.89	15.61	15.93	17.27	10.74	11.06	11.78	12.10	13.44
	12H	14.71	14.99	15.75	16.02	17.41	10.86	11.14	11.91	12.17	13.56
12H	4H	13.74	14.13	14.77	15.16	16.50	10.03	10.43	11.06	11.45	12.79
	6H	14.33	14.65	15.37	15.69	17.03	10.60	10.91	11.64	11.95	13.30
	8H	14.55	14.83	15.60	15.86	17.25	10.81	11.09	11.86	12.12	13.51

END OF REPORT