

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926662

Luminaire Tested: DFN2DIP-TR4F0-120D060US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926662
REPORT IS A COMBINATION OF REPORTS P900421 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D060US950-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16399.3 lumens
Efficiency: N/A
Efficacy: 96.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

Luminous Intensity Polar Plot

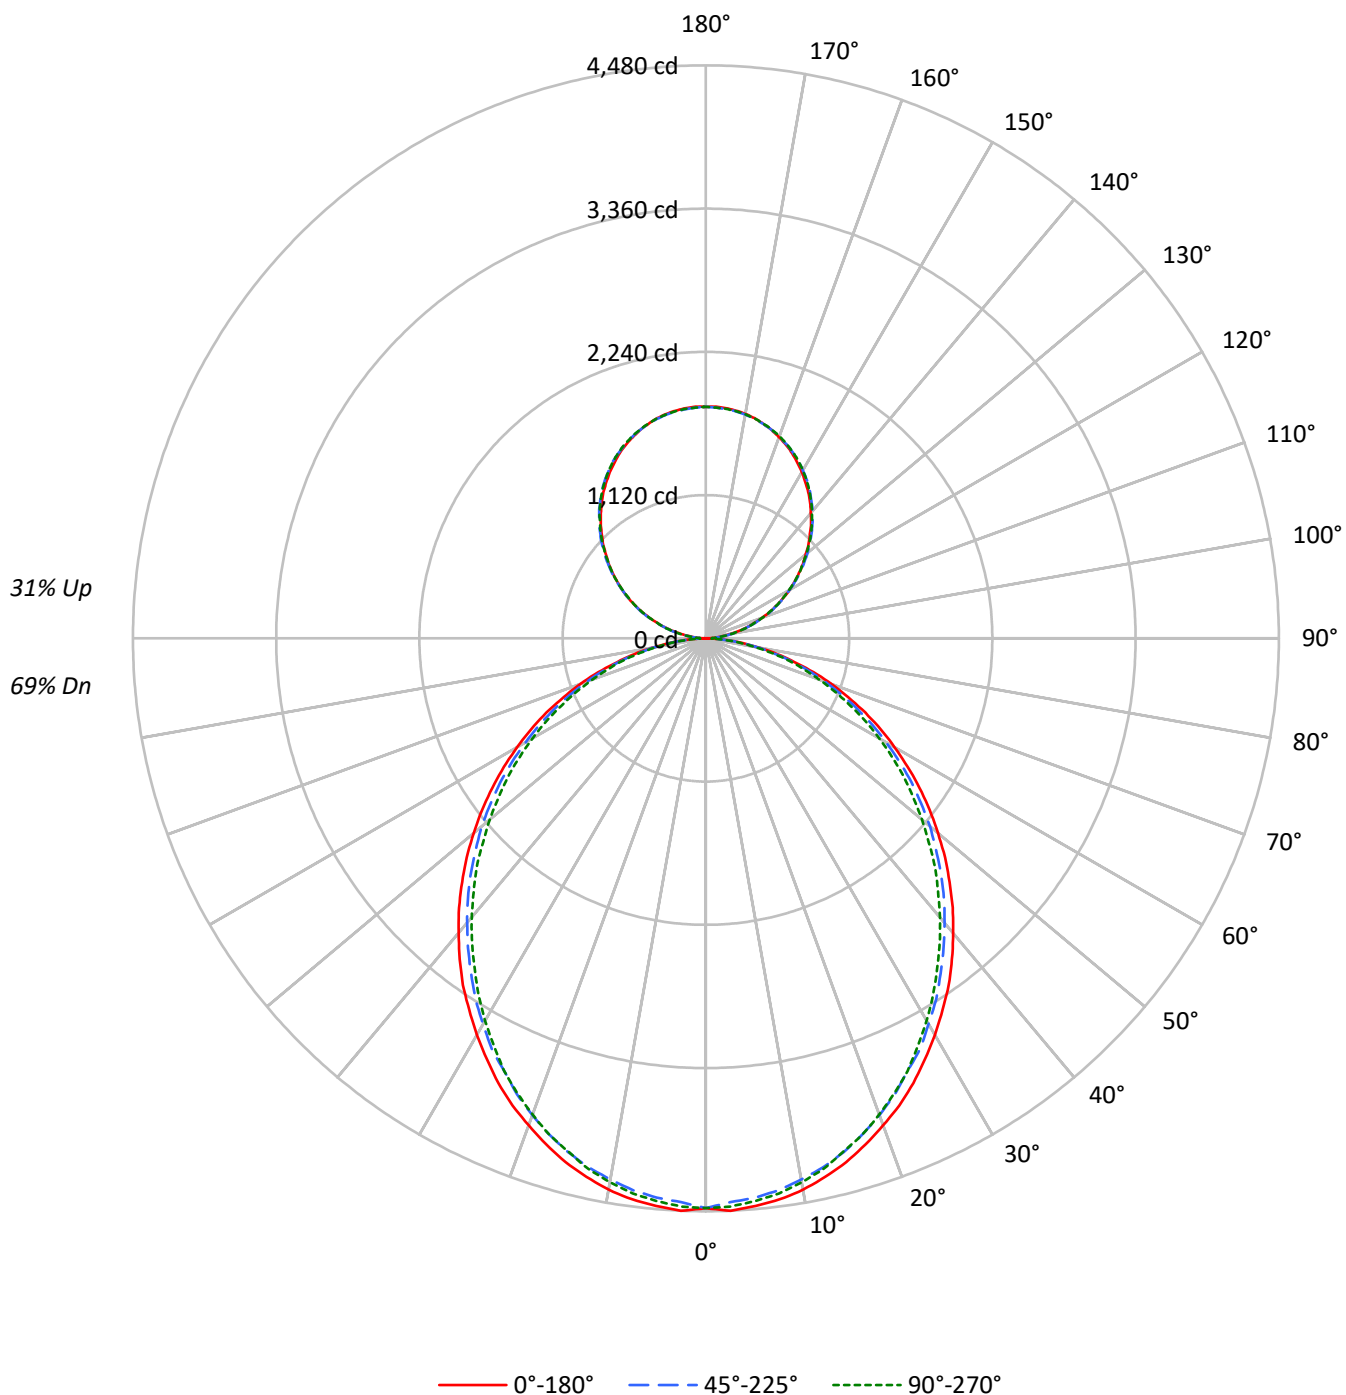

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	35	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3539	3539	3539
5°	3544	3489	3513
10°	3516	3442	3465
15°	3464	3386	3391
20°	3394	3307	3315
25°	3325	3213	3227
30°	3238	3125	3115
35°	3155	3022	2996
40°	3054	2917	2883
45°	2953	2813	2768
50°	2842	2703	2635
55°	2726	2576	2512
60°	2595	2425	2371
65°	2452	2269	2205
70°	2270	2078	2027
75°	2018	1850	1862
80°	1715	1560	1547
85°	1240	1058	1025

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2953 cd/sqm

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	419.3	2.6
10°-20°	1179.6	7.2
20°-30°	1733.6	10.6
30°-40°	2013.5	12.3
40°-50°	2011.0	12.3
50°-60°	1753.5	10.7
60°-70°	1296.2	7.9
70°-80°	733.4	4.5
80°-90°	198.7	1.2
90°-100°	112.0	0.7
100°-110°	355.9	2.2
110°-120°	609.1	3.7
120°-130°	801.1	4.9
130°-140°	899.2	5.5
140°-150°	881.7	5.4
150°-160°	739.6	4.5
160°-170°	490.5	3.0
170°-180°	171.4	1.0
0°-30°	3332.5	20.3
0°-40°	5345.9	32.6
0°-60°	9110.4	55.6
0°-90°	11338.7	69.1
90°-120°	1077.0	6.6
90°-150°	3659.0	22.3
90°-180°	5061.0	30.9
0°-180°	16399.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4454	4454	4454	4454	4454	
5°	4454	4438	4390	4424	4416	423
15°	4240	4215	4159	4176	4155	1194
25°	3838	3804	3731	3739	3731	1766
35°	3311	3268	3200	3174	3152	2068
45°	2694	2664	2600	2553	2536	2079
55°	2039	2013	1962	1910	1889	1823
65°	1375	1349	1306	1268	1247	1360
75°	719	711	689	664	673	768
85°	175	171	167	154	150	196
90°	2	20	54	50	52	16
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4454.5	4454.5	4454.5	4454.5	4454.5
2.5°	4480.4	4459.0	4411.8	4454.5	4446.3
5°	4454.5	4437.6	4390.4	4424.5	4416.3
7.5°	4424.5	4399.0	4351.8	4386.3	4377.7
10°	4377.7	4347.7	4296.3	4330.4	4317.7
12.5°	4313.1	4287.7	4236.3	4257.7	4249.0
15°	4240.4	4215.0	4159.1	4176.3	4155.0
17.5°	4150.5	4125.0	4069.1	4090.5	4069.1
20°	4051.8	4026.4	3966.4	3979.1	3962.3
22.5°	3953.7	3915.0	3859.1	3859.1	3850.5
25°	3837.8	3803.7	3731.0	3739.2	3731.0
27.5°	3709.2	3679.2	3623.8	3611.0	3589.7
30°	3581.0	3546.5	3482.4	3469.7	3452.4
32.5°	3443.7	3418.4	3349.7	3323.8	3306.6
35°	3311.0	3268.4	3199.7	3173.9	3152.5
37.5°	3161.1	3122.5	3053.8	3023.9	3002.5
40°	3007.1	2972.6	2903.9	2865.7	2848.5
42.5°	2857.1	2822.6	2754.4	2711.3	2685.8
45°	2694.4	2664.4	2599.8	2553.1	2535.8
47.5°	2535.8	2505.8	2437.2	2390.0	2364.5
50°	2368.6	2347.2	2287.2	2227.2	2205.8
52.5°	2205.8	2175.9	2120.5	2073.1	2043.2
55°	2039.1	2013.2	1961.8	1910.5	1889.1
57.5°	1871.8	1850.5	1794.6	1743.2	1726.0
60°	1704.6	1687.8	1627.8	1580.6	1567.8
62.5°	1542.0	1511.9	1469.3	1426.5	1409.2
65°	1375.2	1349.2	1306.5	1267.9	1246.6
67.5°	1203.9	1182.0	1143.8	1113.9	1096.6
70°	1045.2	1027.9	989.3	959.3	942.6
72.5°	882.5	865.3	843.9	814.0	801.2
75°	719.4	711.2	689.4	664.0	672.6
77.5°	573.9	556.7	548.1	535.3	522.6
80°	428.5	424.0	415.4	402.7	394.0
82.5°	291.3	291.3	287.2	270.0	270.0
85°	175.4	171.3	167.2	154.1	150.0
87.5°	77.3	68.6	60.0	47.2	42.7
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P926662

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.26	14.32	14.03	15.12	16.09	12.83	13.89	13.60	14.69	15.66
	3H	14.94	15.89	15.72	16.70	17.70	14.46	15.42	15.25	16.22	17.22
	4H	15.53	16.43	16.34	17.25	18.26	15.06	15.96	15.86	16.78	17.79
	6H	15.94	16.78	16.76	17.60	18.62	15.47	16.30	16.28	17.12	18.15
	8H	16.05	16.85	16.88	17.69	18.71	15.58	16.37	16.40	17.21	18.24
	12H	16.11	16.86	16.94	17.70	18.75	15.63	16.38	16.46	17.22	18.27
4H	2H	13.75	14.65	14.55	15.46	16.47	13.40	14.30	14.21	15.12	16.13
	3H	15.63	16.38	16.45	17.23	18.26	15.24	15.99	16.06	16.84	17.87
	4H	16.35	17.04	17.19	17.89	18.94	15.95	16.63	16.78	17.48	18.53
	6H	16.88	17.47	17.73	18.34	19.40	16.47	17.06	17.32	17.93	18.99
	8H	17.03	17.59	17.89	18.45	19.52	16.62	17.18	17.48	18.04	19.11
	12H	17.12	17.62	17.99	18.50	19.58	16.69	17.19	17.57	18.08	19.16
8H	4H	16.57	17.12	17.42	17.99	19.06	16.21	16.76	17.06	17.63	18.70
	6H	17.20	17.67	18.09	18.57	19.64	16.84	17.30	17.72	18.21	19.28
	8H	17.43	17.84	18.32	18.74	19.83	17.06	17.47	17.95	18.37	19.46
	12H	17.57	17.93	18.46	18.82	19.96	17.18	17.54	18.08	18.44	19.58
12H	4H	16.56	17.06	17.43	17.95	19.02	16.21	16.71	17.08	17.59	18.67
	6H	17.24	17.65	18.13	18.55	19.64	16.89	17.29	17.78	18.20	19.28
	8H	17.49	17.85	18.38	18.74	19.88	17.13	17.49	18.03	18.38	19.53

END OF REPORT