

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926669

Luminaire Tested: DFN2DIP-TR4F0-120D070US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926669
REPORT IS A COMBINATION OF REPORTS P901960 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D070US950-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16342.0 lumens
Efficiency: N/A
Efficacy: 91.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 177.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLLONL

Luminous Intensity Polar Plot

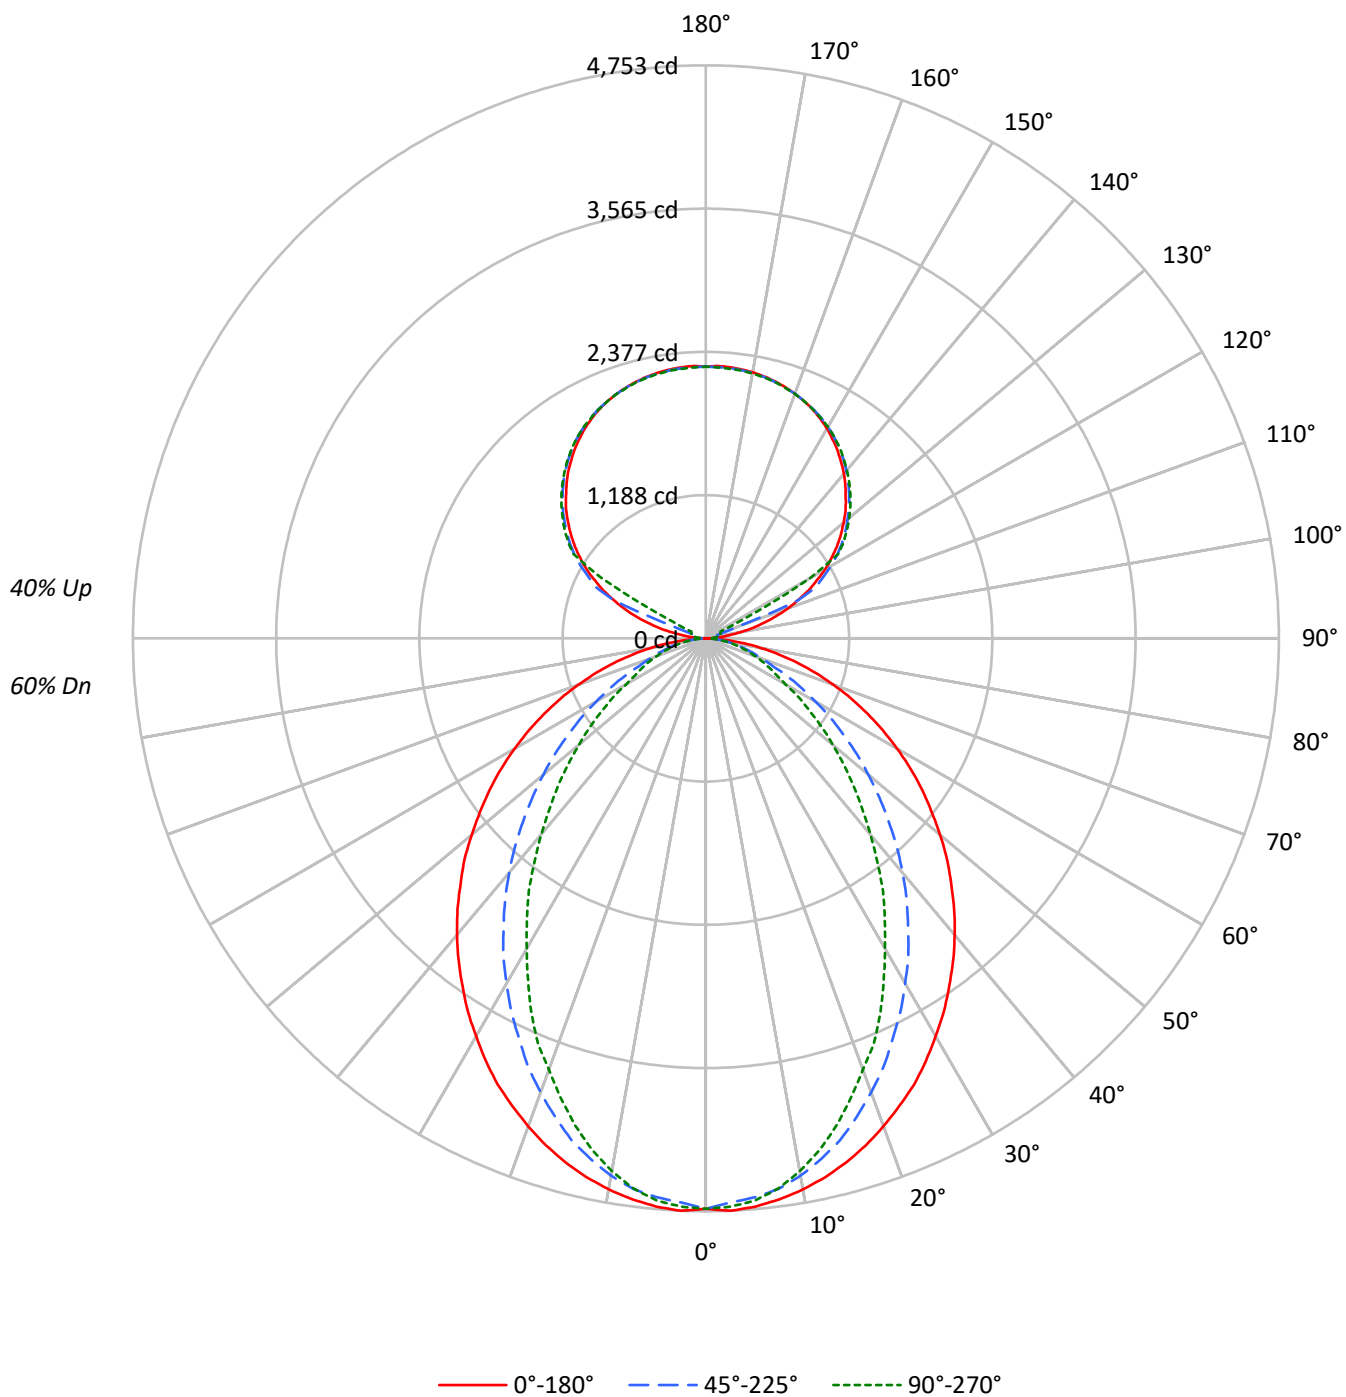

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	89	89	89	76	76	76	65	65	65
1	101	96	93	89	94	90	87	84	79	76	74	68	66	65	58	57	56
2	92	85	79	74	86	80	74	70	70	66	62	60	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	50	47	47	44	42
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	67	56	49	44	50	44	40	44	39	36	38	35	32
6	66	54	46	40	62	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3759	3759	3759
5°	3765	3699	3723
10°	3728	3627	3601
15°	3676	3507	3414
20°	3609	3341	3184
25°	3539	3156	2962
30°	3446	2966	2681
35°	3354	2762	2433
40°	3261	2551	2150
45°	3153	2316	1893
50°	3041	2080	1642
55°	2925	1827	1401
60°	2790	1562	1153
65°	2634	1294	1038
70°	2446	1043	939
75°	2209	919	854
80°	1867	771	740
85°	1301	515	556

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3153 cd/sqm

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	443.4	2.7
10°-20°	1217.3	7.4
20°-30°	1709.1	10.5
30°-40°	1863.0	11.4
40°-50°	1712.3	10.5
50°-60°	1344.7	8.2
60°-70°	875.3	5.4
70°-80°	450.6	2.8
80°-90°	119.0	0.7
90°-100°	74.3	0.5
100°-110°	277.0	1.7
110°-120°	734.8	4.5
120°-130°	1218.6	7.5
130°-140°	1294.5	7.9
140°-150°	1203.1	7.4
150°-160°	967.2	5.9
160°-170°	623.3	3.8
170°-180°	214.5	1.3
0°-30°	3369.8	20.6
0°-40°	5232.8	32.0
0°-60°	8289.9	50.7
0°-90°	9734.8	59.6
90°-120°	1086.1	6.6
90°-150°	4802.2	29.4
90°-180°	6607.0	40.4
0°-180°	16342.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4732	4732	4732	4732	4732	
5°	4732	4710	4654	4693	4680	449
15°	4500	4453	4308	4226	4184	1268
25°	4085	3948	3665	3490	3425	1879
35°	3520	3301	2925	2655	2560	2203
45°	2878	2590	2141	1837	1734	2222
55°	2188	1854	1392	1135	1054	1955
65°	1477	1130	745	600	586	1465
75°	788	488	343	312	308	833
85°	184	94	81	81	81	211
90°	2	20	32	41	44	15
95°	106	52	64	72	70	125
105°	496	545	100	117	124	530
115°	938	965	1006	251	134	923
125°	1326	1347	1378	1390	1394	1182
135°	1641	1667	1681	1698	1694	1267
145°	1903	1902	1929	1941	1932	1190
155°	2096	2081	2100	2110	2097	966
165°	2208	2198	2203	2215	2203	624
175°	2259	2247	2250	2262	2246	215
180°	2254	2254	2254	2254	2254	

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4731.5	4731.5	4731.5	4731.5	4731.5
2.5°	4752.8	4731.5	4684.2	4727.4	4718.7
5°	4731.5	4710.1	4654.2	4692.8	4680.1
7.5°	4692.8	4667.3	4607.4	4624.2	4602.9
10°	4641.5	4611.5	4526.1	4512.9	4487.5
12.5°	4577.4	4538.8	4422.9	4397.6	4350.3
15°	4500.2	4453.0	4307.6	4226.2	4183.6
17.5°	4410.2	4341.7	4161.7	4067.8	3999.2
20°	4307.6	4221.7	4007.8	3901.0	3806.5
22.5°	4196.3	4097.7	3849.2	3703.8	3639.8
25°	4085.0	3947.7	3665.2	3489.8	3425.3
27.5°	3952.3	3806.5	3493.9	3292.7	3194.1
30°	3811.0	3648.0	3305.4	3087.3	2971.5
32.5°	3673.9	3476.7	3126.0	2868.9	2761.6
35°	3519.9	3301.3	2924.7	2654.9	2560.3
37.5°	3369.9	3134.2	2736.2	2440.4	2333.7
40°	3211.4	2954.7	2539.1	2235.1	2123.8
42.5°	3048.7	2774.8	2342.4	2025.2	1918.5
45°	2877.5	2590.4	2141.1	1836.7	1734.0
47.5°	2714.8	2410.9	1948.4	1644.1	1550.1
50°	2535.0	2231.0	1759.9	1464.2	1374.7
52.5°	2359.1	2037.9	1580.0	1297.4	1216.2
55°	2187.9	1854.0	1391.5	1134.8	1053.5
57.5°	2012.5	1670.0	1224.7	984.9	916.3
60°	1832.6	1490.1	1048.9	830.9	762.3
62.5°	1657.3	1314.7	899.0	693.7	659.6
65°	1477.4	1130.3	745.1	599.7	586.5
67.5°	1306.1	959.0	599.7	526.5	513.8
70°	1126.2	792.3	496.6	453.8	436.6
72.5°	955.0	637.8	415.2	381.1	372.5
75°	787.7	487.9	342.6	312.5	308.4
77.5°	621.1	346.6	269.9	252.6	243.9
80°	466.6	248.5	205.3	188.5	188.5
82.5°	325.3	167.1	141.3	132.6	132.6
85°	184.0	94.1	81.3	81.3	81.3
87.5°	68.6	34.1	34.1	30.0	30.0
90°	1.5	19.6	32.5	40.8	44.0
92.5°	40.8	34.2	39.1	42.5	44.0
95°	105.9	52.1	63.5	71.8	70.1
97.5°	190.7	57.1	83.1	88.1	89.7
100°	288.8	65.3	92.9	105.9	109.2
102.5°	396.2	393.1	96.3	114.1	119.1
105°	495.8	544.7	99.5	117.3	123.9
107.5°	611.5	652.2	102.8	120.7	127.3
110°	722.6	756.6	285.4	122.4	128.8

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	826.9	856.1	828.5	125.5	130.5
115°	937.7	965.4	1006.2	251.2	133.8
117.5°	1033.9	1066.5	1094.3	861.0	433.8
120°	1141.6	1166.0	1195.5	1215.0	994.8
122.5°	1232.8	1258.9	1291.7	1301.4	1303.1
125°	1325.8	1347.0	1378.1	1389.5	1394.3
127.5°	1410.6	1433.4	1458.0	1474.3	1475.8
130°	1490.5	1516.7	1534.5	1552.5	1551.0
132.5°	1572.1	1593.4	1611.2	1625.9	1624.4
135°	1640.6	1666.7	1681.3	1697.7	1694.5
137.5°	1712.2	1731.9	1748.3	1764.6	1759.7
140°	1782.4	1795.5	1813.4	1828.1	1819.9
142.5°	1841.2	1852.7	1873.8	1886.7	1878.6
145°	1903.2	1901.5	1929.2	1940.6	1932.5
147.5°	1956.8	1952.1	1979.7	1987.8	1981.5
150°	2009.1	1997.8	2023.9	2033.5	2025.4
152.5°	2053.1	2040.1	2064.6	2074.4	2063.0
155°	2095.6	2081.0	2100.5	2110.2	2097.3
157.5°	2129.8	2116.8	2131.5	2143.0	2129.8
160°	2159.3	2149.4	2159.3	2168.9	2157.5
162.5°	2185.2	2175.5	2183.6	2195.1	2180.4
165°	2208.0	2198.4	2203.2	2214.6	2203.2
167.5°	2226.1	2216.1	2221.2	2232.6	2218.0
170°	2240.8	2230.9	2234.2	2245.6	2230.9
172.5°	2250.5	2240.8	2244.1	2255.4	2240.8
175°	2258.6	2247.1	2250.5	2261.8	2245.6
177.5°	2261.8	2250.5	2252.2	2263.7	2248.9
180°	2253.7	2253.7	2253.7	2253.7	2253.7

TEST NUMBER: P926669

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.59	13.51	13.47	14.40	15.53	8.57	9.48	9.44	10.37	11.50
	3H	14.28	15.09	15.17	16.00	17.15	9.76	10.58	10.65	11.48	12.64
	4H	14.89	15.66	15.79	16.57	17.74	10.22	10.99	11.12	11.90	13.06
	6H	15.31	16.02	16.23	16.94	18.12	10.54	11.25	11.46	12.17	13.35
	8H	15.44	16.12	16.37	17.05	18.23	10.64	11.31	11.56	12.24	13.42
	12H	15.51	16.15	16.44	17.08	18.28	10.68	11.33	11.61	12.25	13.45
4H	2H	12.62	13.39	13.53	14.30	15.47	9.17	9.94	10.08	10.85	12.02
	3H	14.46	15.10	15.38	16.04	17.22	10.53	11.17	11.45	12.11	13.29
	4H	15.15	15.74	16.08	16.67	17.88	11.08	11.67	12.01	12.60	13.81
	6H	15.67	16.18	16.62	17.13	18.34	11.51	12.01	12.45	12.97	14.18
	8H	15.85	16.32	16.80	17.27	18.49	11.64	12.11	12.58	13.06	14.28
	12H	15.95	16.37	16.91	17.34	18.57	11.71	12.13	12.67	13.10	14.33
8H	4H	15.13	15.60	16.07	16.55	17.77	11.37	11.84	12.32	12.79	14.01
	6H	15.70	16.08	16.67	17.08	18.30	11.89	12.28	12.86	13.27	14.49
	8H	15.91	16.26	16.90	17.24	18.48	12.08	12.42	13.06	13.41	14.65
	12H	16.05	16.36	17.04	17.33	18.62	12.21	12.51	13.19	13.48	14.77
12H	4H	15.08	15.51	16.05	16.48	17.70	11.38	11.80	12.34	12.77	14.00
	6H	15.67	16.01	16.65	17.00	18.24	11.94	12.28	12.92	13.27	14.50
	8H	15.90	16.20	16.88	17.17	18.46	12.15	12.46	13.14	13.43	14.72

END OF REPORT