

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916242

Luminaire Tested: DFN2DIP-HX3F0-060D060US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916242
REPORT IS A COMBINATION OF REPORTS P899249 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D060US930-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9172.1 lumens
Efficiency: N/A
Efficacy: 89.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFLL

Luminous Intensity Polar Plot

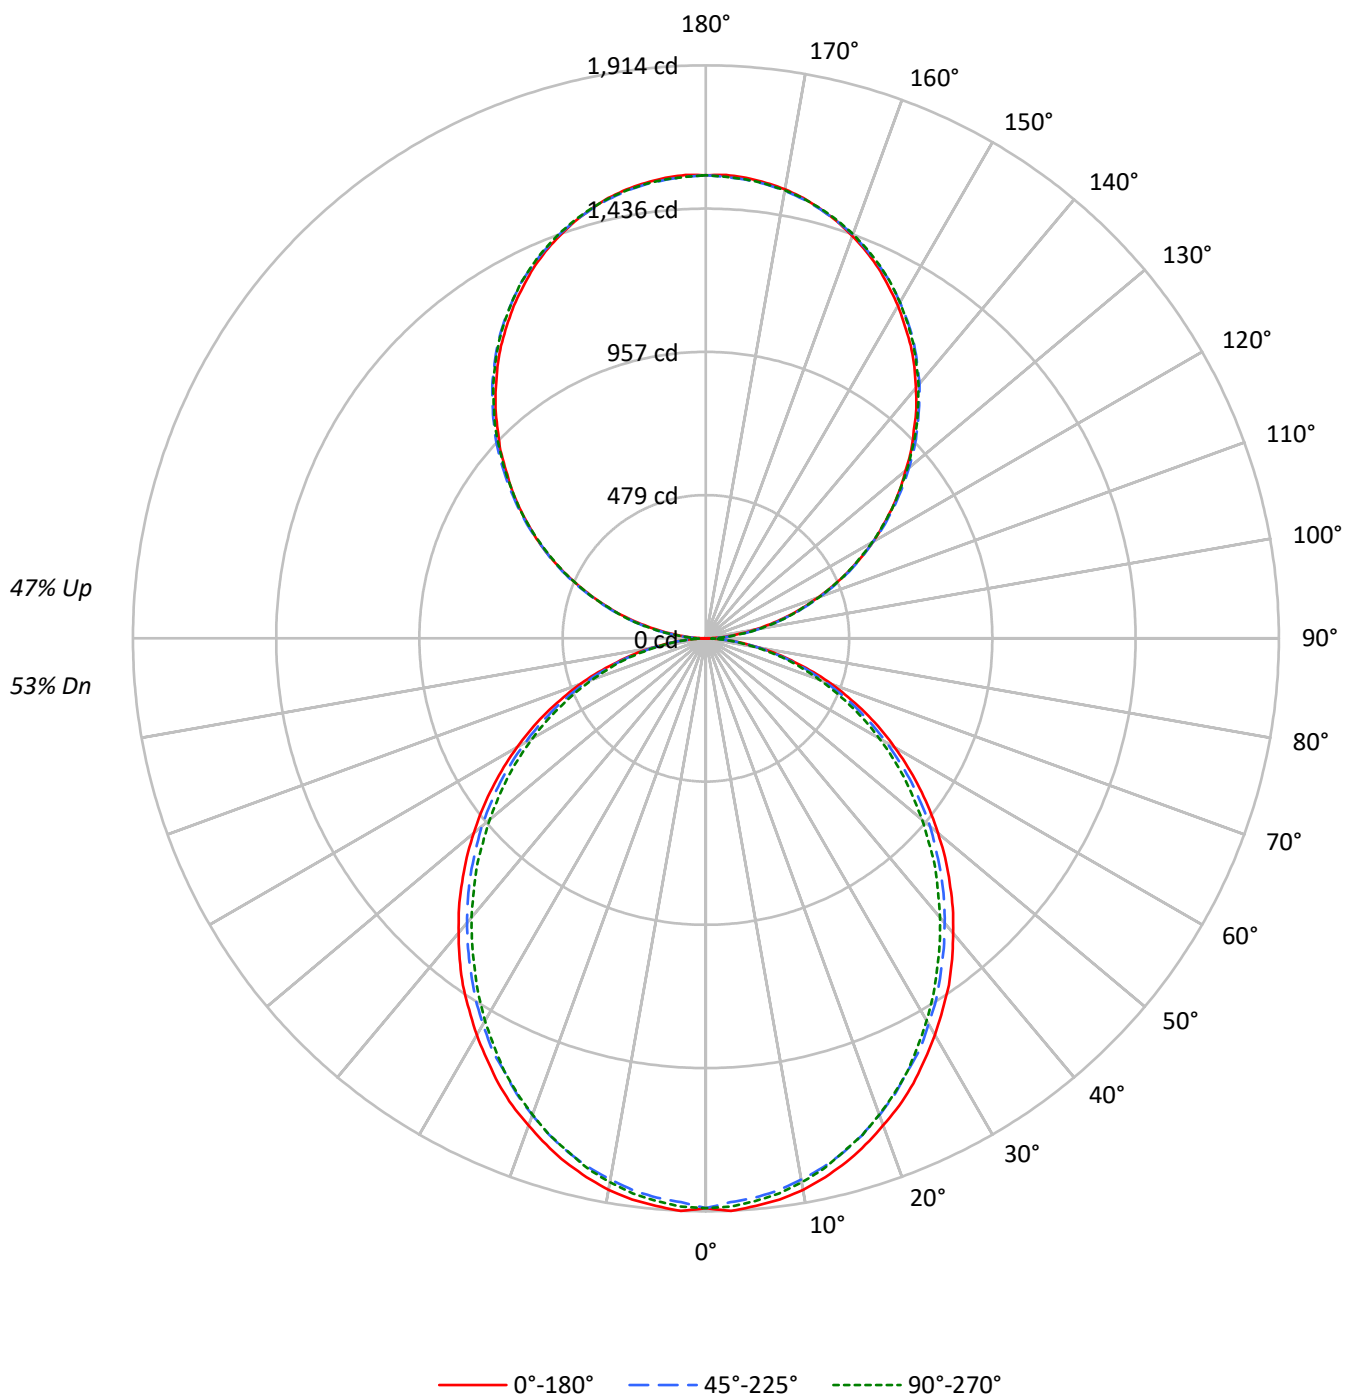

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2205	2205	2205
5°	2207	2173	2188
10°	2188	2142	2157
15°	2155	2105	2109
20°	2111	2054	2061
25°	2067	1994	2005
30°	2011	1938	1934
35°	1959	1872	1859
40°	1894	1806	1788
45°	1830	1739	1715
50°	1760	1669	1630
55°	1686	1588	1552
60°	1603	1491	1463
65°	1512	1391	1357
70°	1395	1269	1244
75°	1235	1123	1137
80°	1041	937	936
85°	738	620	607

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1830 cd/sqm

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	2.0
10°-20°	504.1	5.5
20°-30°	740.8	8.1
30°-40°	860.4	9.4
40°-50°	859.3	9.4
50°-60°	749.3	8.2
60°-70°	553.9	6.0
70°-80°	313.4	3.4
80°-90°	87.1	0.9
90°-100°	95.7	1.0
100°-110°	304.2	3.3
110°-120°	520.6	5.7
120°-130°	684.6	7.5
130°-140°	768.4	8.4
140°-150°	753.5	8.2
150°-160°	632.1	6.9
160°-170°	419.2	4.6
170°-180°	146.5	1.6
0°-30°	1424.0	15.5
0°-40°	2284.3	24.9
0°-60°	3892.9	42.4
0°-90°	4847.3	52.8
90°-120°	920.5	10.0
90°-150°	3127.0	34.1
90°-180°	4325.0	47.2
0°-180°	9172.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	1	17	46	43	44	9
95°	68	81	84	84	81	76
105°	281	284	287	290	290	296
115°	522	530	528	526	522	517
125°	760	771	768	764	762	679
135°	983	997	1000	999	995	760
145°	1193	1202	1210	1211	1206	745
155°	1364	1368	1372	1379	1374	628
165°	1484	1483	1483	1492	1486	419
175°	1544	1541	1538	1547	1539	147
180°	1547	1547	1547	1547	1547	

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	1.4	16.8	45.7	42.9	44.3
92.5°	28.9	39.2	40.6	42.0	42.0
95°	68.1	81.1	83.5	83.5	81.1
97.5°	113.3	125.5	130.6	130.6	130.6
100°	165.6	176.3	180.0	180.0	178.6
102.5°	220.6	228.5	233.7	235.1	233.7
105°	280.8	284.5	287.3	289.7	289.7
107.5°	340.5	346.1	346.1	347.0	340.5
110°	398.4	405.8	405.8	405.8	402.0

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	460.8	468.7	467.3	463.6	460.8
115°	522.4	529.9	527.5	526.1	522.4
117.5°	583.5	593.8	587.2	583.5	579.8
120°	645.1	655.3	645.1	645.1	640.8
122.5°	701.0	714.0	707.5	703.8	701.0
125°	759.8	771.4	767.7	763.5	762.1
127.5°	817.2	831.6	826.5	820.9	817.2
130°	870.8	887.6	885.3	882.5	877.3
132.5°	931.0	944.0	944.9	938.4	934.7
135°	982.8	997.2	1000.0	998.6	994.8
137.5°	1040.6	1052.2	1054.6	1053.6	1048.1
140°	1091.4	1103.1	1109.6	1109.6	1104.5
142.5°	1143.6	1155.3	1159.0	1160.4	1155.3
145°	1193.1	1202.4	1209.9	1211.3	1206.2
147.5°	1237.4	1249.0	1254.7	1256.9	1251.8
150°	1283.1	1291.0	1296.2	1300.3	1296.2
152.5°	1323.6	1331.6	1338.1	1343.3	1338.1
155°	1364.2	1368.0	1372.1	1378.8	1374.5
157.5°	1399.2	1402.1	1404.4	1413.7	1407.2
160°	1430.5	1433.3	1434.7	1442.6	1437.0
162.5°	1459.4	1459.4	1460.8	1469.7	1463.1
165°	1484.1	1482.7	1482.7	1492.1	1485.6
167.5°	1506.5	1502.4	1502.4	1511.6	1505.1
170°	1523.3	1519.6	1518.2	1527.5	1519.6
172.5°	1535.0	1531.2	1529.8	1539.1	1531.2
175°	1544.3	1540.6	1537.7	1547.1	1539.1
177.5°	1549.4	1545.7	1542.9	1550.8	1542.9
180°	1547.1	1547.1	1547.1	1547.1	1547.1

TEST NUMBER: P916242

CATALOG NUMBER: DFN2DIP-HX3F0-060D060US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.23	11.12	11.17	12.07	13.30	9.80	10.69	10.74	11.64	12.87
	3H	11.89	12.68	12.83	13.64	14.90	11.42	12.22	12.36	13.17	14.43
	4H	12.47	13.23	13.43	14.19	15.45	12.00	12.76	12.96	13.72	14.98
	6H	12.87	13.56	13.84	14.53	15.81	12.40	13.09	13.37	14.06	15.34
	8H	12.97	13.63	13.95	14.62	15.89	12.50	13.16	13.48	14.15	15.42
	12H	13.02	13.65	14.00	14.62	15.92	12.54	13.17	13.52	14.15	15.45
4H	2H	10.70	11.45	11.66	12.41	13.68	10.35	11.11	11.32	12.07	13.33
	3H	12.56	13.18	13.53	14.18	15.45	12.17	12.79	13.14	13.79	15.06
	4H	13.26	13.84	14.25	14.83	16.13	12.86	13.44	13.85	14.42	15.72
	6H	13.77	14.27	14.77	15.28	16.58	13.37	13.86	14.36	14.87	16.17
	8H	13.92	14.38	14.92	15.39	16.70	13.51	13.98	14.51	14.98	16.29
	12H	13.99	14.41	15.01	15.43	16.75	13.57	13.99	14.59	15.01	16.33
8H	4H	13.46	13.92	14.46	14.93	16.24	13.10	13.57	14.10	14.57	15.88
	6H	14.08	14.47	15.10	15.51	16.82	13.72	14.11	14.75	15.15	16.46
	8H	14.30	14.64	15.33	15.67	17.00	13.93	14.27	14.96	15.30	16.63
	12H	14.43	14.72	15.46	15.75	17.12	14.05	14.34	15.08	15.37	16.74
12H	4H	13.45	13.86	14.46	14.88	16.20	13.10	13.51	14.11	14.53	15.85
	6H	14.11	14.45	15.14	15.48	16.81	13.76	14.10	14.79	15.13	16.46
	8H	14.35	14.65	15.38	15.67	17.05	14.00	14.29	15.03	15.32	16.69