

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918930

Luminaire Tested: DFN2DIP-HX3F0-040D080US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918930
REPORT IS A COMBINATION OF REPORTS P899273 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-040D080US935-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9505.4 lumens
Efficiency: N/A
Efficacy: 99.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 95.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

Luminous Intensity Polar Plot

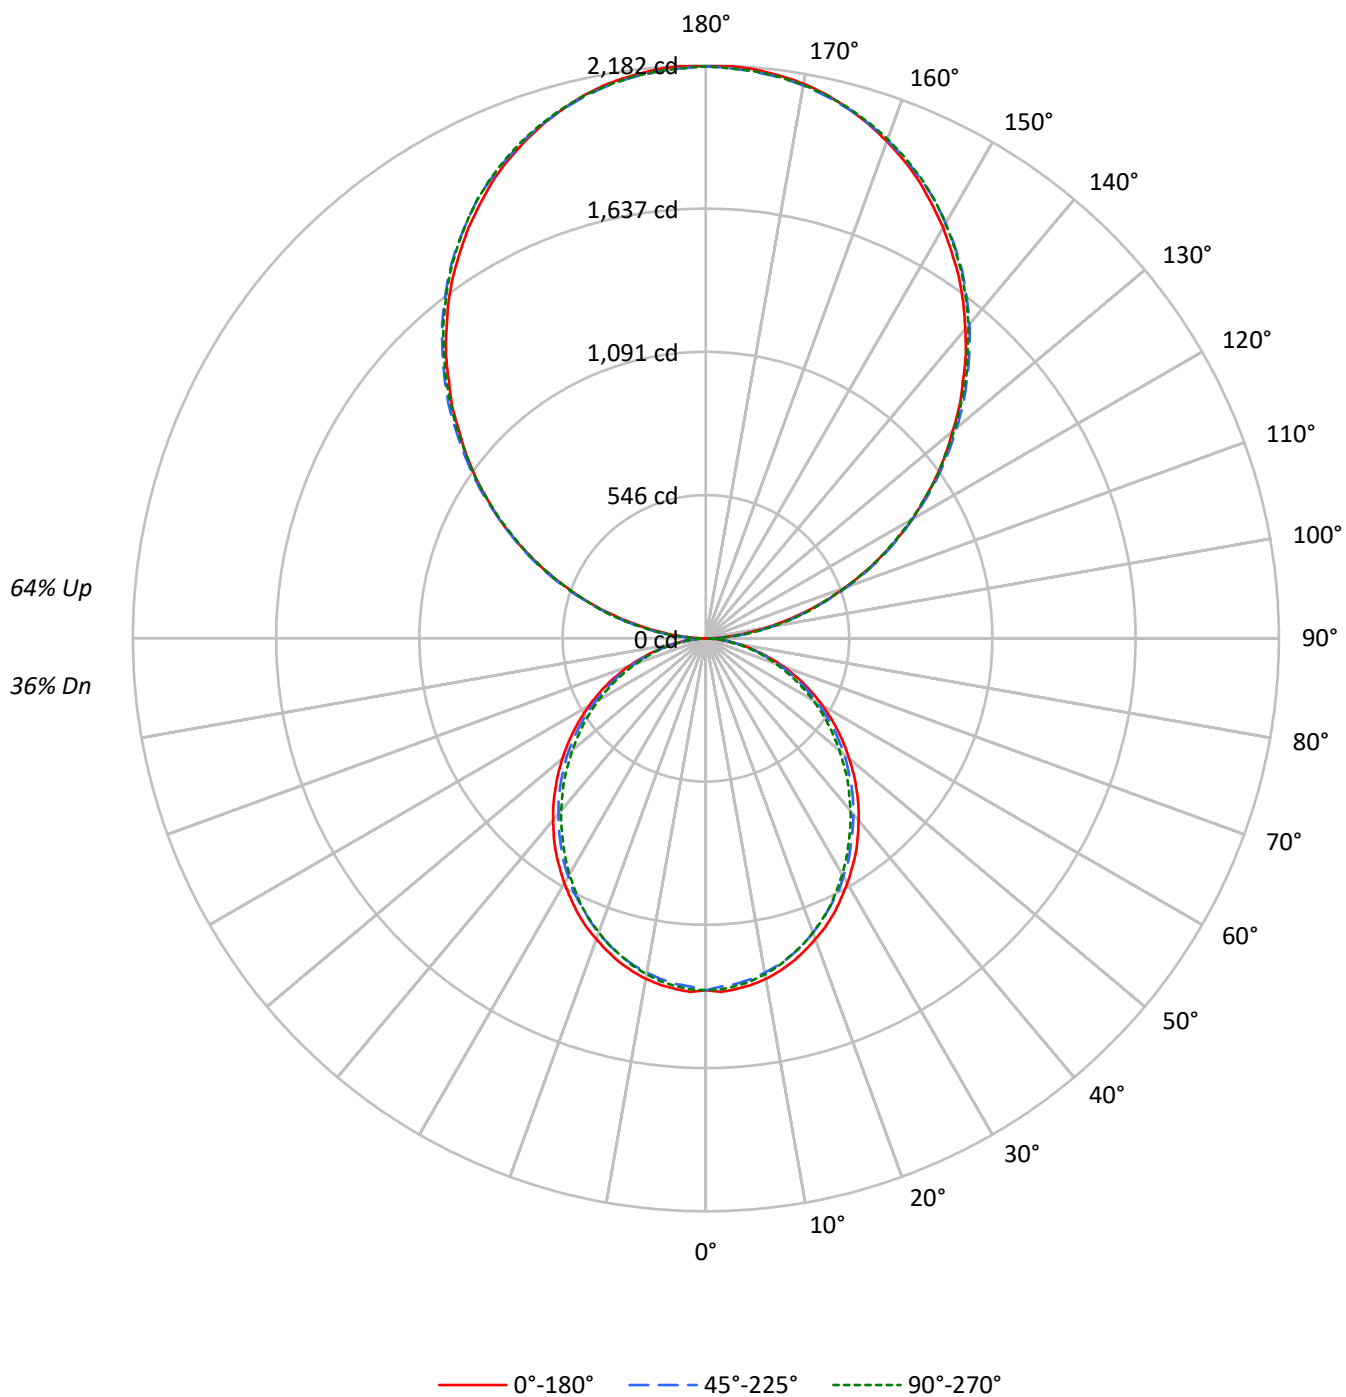

TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1552	1552	1552
5°	1554	1530	1540
10°	1541	1508	1518
15°	1517	1482	1485
20°	1486	1446	1451
25°	1455	1404	1411
30°	1416	1365	1361
35°	1379	1318	1309
40°	1334	1271	1259
45°	1288	1224	1207
50°	1239	1175	1148
55°	1187	1118	1093
60°	1128	1050	1030
65°	1064	979	956
70°	982	894	875
75°	870	791	800
80°	733	659	659
85°	520	436	427

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2050 cd/sqm

TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.1	1.3
10°-20°	354.9	3.7
20°-30°	521.5	5.5
30°-40°	605.7	6.4
40°-50°	605.0	6.4
50°-60°	527.5	5.5
60°-70°	389.9	4.1
70°-80°	220.6	2.3
80°-90°	64.4	0.7
90°-100°	134.8	1.4
100°-110°	428.3	4.5
110°-120°	733.0	7.7
120°-130°	964.0	10.1
130°-140°	1082.0	11.4
140°-150°	1061.0	11.2
150°-160°	890.1	9.4
160°-170°	590.3	6.2
170°-180°	206.3	2.2
0°-30°	1002.5	10.5
0°-40°	1608.3	16.9
0°-60°	2740.7	28.8
0°-90°	3415.7	35.9
90°-120°	1296.1	13.6
90°-150°	4403.1	46.3
90°-180°	6090.0	64.1
0°-180°	9505.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1340	1340	1340	1340	1340	
5°	1340	1335	1321	1331	1329	127
15°	1276	1268	1251	1256	1250	359
25°	1154	1144	1122	1125	1122	531
35°	996	983	963	955	948	622
45°	810	802	782	768	763	626
55°	614	606	590	575	568	548
65°	414	406	393	381	375	409
75°	216	214	207	200	202	231
85°	53	52	50	46	45	59
90°	2	24	64	60	62	9
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1340.1	1340.1	1340.1	1340.1	1340.1
2.5°	1347.9	1341.4	1327.2	1340.1	1337.6
5°	1340.1	1335.0	1320.8	1331.0	1328.6
7.5°	1331.0	1323.4	1309.1	1319.6	1317.0
10°	1317.0	1307.9	1292.5	1302.8	1298.9
12.5°	1297.5	1289.9	1274.4	1280.9	1278.2
15°	1275.7	1268.0	1251.2	1256.4	1250.0
17.5°	1248.6	1241.0	1224.2	1230.5	1224.2
20°	1218.9	1211.3	1193.3	1197.0	1192.1
22.5°	1189.4	1177.8	1161.0	1161.0	1158.4
25°	1154.5	1144.3	1122.4	1124.9	1122.4
27.5°	1115.9	1106.8	1090.2	1086.3	1079.9
30°	1077.3	1066.9	1047.7	1043.8	1038.6
32.5°	1036.0	1028.4	1007.7	1000.0	994.7
35°	996.1	983.3	962.6	954.8	948.4
37.5°	951.0	939.3	918.7	909.7	903.3
40°	904.7	894.2	873.6	862.1	857.0
42.5°	859.5	849.1	828.6	815.6	808.0
45°	810.5	801.6	782.1	768.1	762.8
47.5°	762.8	753.8	733.2	719.0	711.4
50°	712.6	706.1	688.1	670.0	663.6
52.5°	663.6	654.6	637.9	623.7	614.7
55°	613.5	605.6	590.2	574.7	568.3
57.5°	563.1	556.7	539.8	524.4	519.3
60°	512.8	507.7	489.7	475.5	471.7
62.5°	463.9	454.9	442.0	429.1	424.0
65°	413.7	405.9	393.0	381.4	375.1
67.5°	362.1	355.6	344.1	335.1	329.9
70°	314.4	309.3	297.6	288.6	283.5
72.5°	265.5	260.3	253.9	244.9	241.0
75°	216.5	214.0	207.4	199.8	202.3
77.5°	172.6	167.5	164.9	161.0	157.2
80°	128.9	127.5	124.9	121.1	118.6
82.5°	87.6	87.6	86.4	81.2	81.2
85°	52.8	51.6	50.3	46.3	45.1
87.5°	23.2	20.7	18.1	14.2	12.8
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4



TEST NUMBER: P918930

CATALOG NUMBER: DFN2DIP-HX3F0-040D080US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.29	8.04	8.36	9.11	10.57	6.86	7.61	7.93	8.68	10.14
	3H	8.94	9.61	10.01	10.69	12.16	8.47	9.14	9.55	10.22	11.69
	4H	9.51	10.15	10.60	11.23	12.71	9.04	9.68	10.13	10.76	12.24
	6H	9.90	10.49	11.00	11.57	13.07	9.43	10.02	10.53	11.10	12.60
	8H	10.00	10.56	11.10	11.66	13.15	9.53	10.09	10.63	11.19	12.68
	12H	10.04	10.57	11.15	11.66	13.18	9.57	10.09	10.67	11.19	12.70
4H	2H	7.74	8.37	8.83	9.45	10.94	7.39	8.03	8.49	9.11	10.59
	3H	9.58	10.11	10.69	11.22	12.72	9.19	9.72	10.30	10.83	12.33
	4H	10.29	10.77	11.39	11.87	13.39	9.88	10.37	10.99	11.47	12.99
	6H	10.79	11.21	11.90	12.33	13.84	10.38	10.80	11.50	11.92	13.43
	8H	10.93	11.32	12.05	12.43	13.96	10.52	10.91	11.64	12.03	13.55
	12H	10.99	11.35	12.13	12.47	14.00	10.58	10.93	11.71	12.06	13.59
8H	4H	10.47	10.86	11.59	11.97	13.50	10.11	10.50	11.23	11.62	13.14
	6H	11.09	11.41	12.22	12.57	14.09	10.73	11.05	11.87	12.21	13.73
	8H	11.30	11.58	12.45	12.72	14.26	10.94	11.22	12.08	12.36	13.90
	12H	11.42	11.67	12.57	12.80	14.38	11.04	11.29	12.19	12.42	14.00
12H	4H	10.45	10.80	11.58	11.93	13.46	10.10	10.45	11.23	11.58	13.11
	6H	11.12	11.40	12.26	12.53	14.08	10.77	11.05	11.91	12.18	13.73
	8H	11.35	11.59	12.49	12.73	14.30	10.99	11.24	12.14	12.37	13.95

END OF REPORT