

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919026

Luminaire Tested: DFN2DIP-HX3F0-080D080US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919026
REPORT IS A COMBINATION OF REPORTS P899281 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D080US935-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12915.0 lumens
Efficiency: N/A
Efficacy: 91.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 141.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFLL

Luminous Intensity Polar Plot

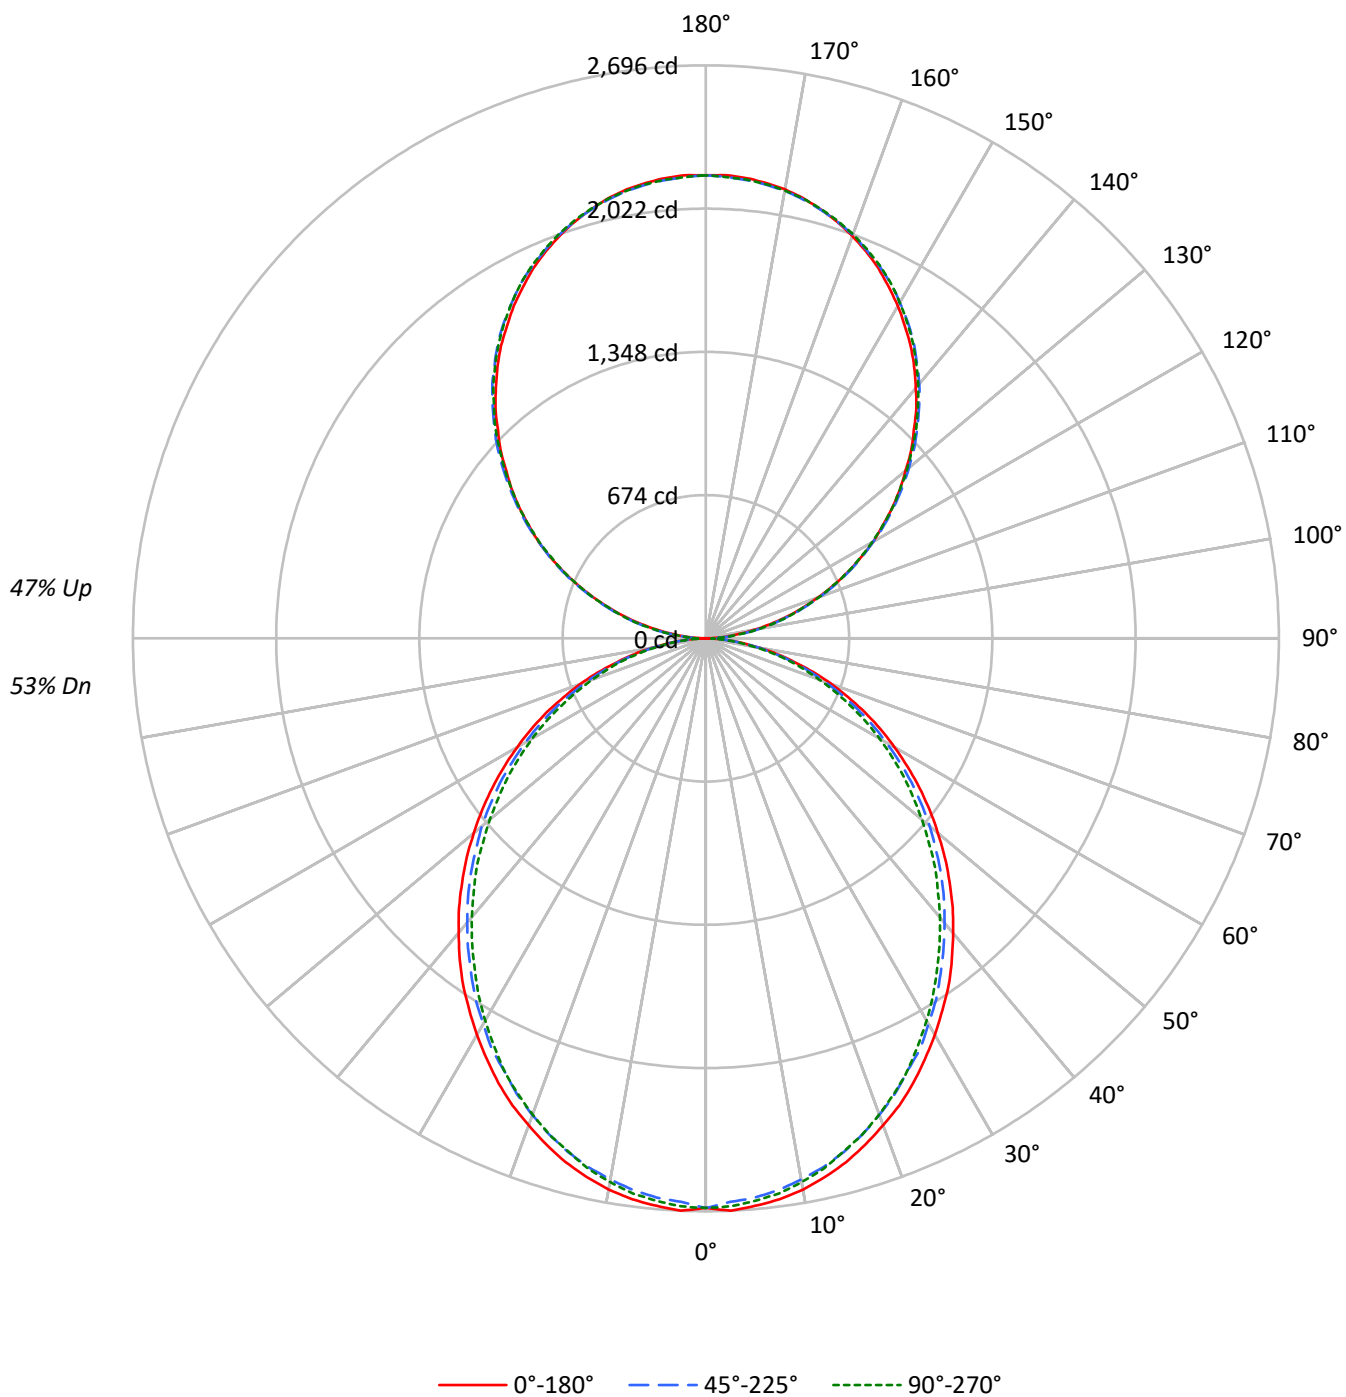

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3104	3104	3104
5°	3108	3059	3080
10°	3082	3016	3037
15°	3035	2964	2970
20°	2972	2893	2902
25°	2910	2808	2823
30°	2832	2729	2723
35°	2758	2637	2618
40°	2668	2543	2517
45°	2577	2449	2414
50°	2478	2350	2295
55°	2374	2235	2185
60°	2257	2100	2060
65°	2128	1959	1911
70°	1965	1788	1751
75°	1739	1582	1601
80°	1466	1319	1318
85°	1040	874	854

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2577 cd/sqm

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	2.0
10°-20°	709.8	5.5
20°-30°	1043.1	8.1
30°-40°	1211.4	9.4
40°-50°	1209.9	9.4
50°-60°	1055.0	8.2
60°-70°	779.9	6.0
70°-80°	441.2	3.4
80°-90°	122.7	0.9
90°-100°	134.8	1.0
100°-110°	428.3	3.3
110°-120°	733.0	5.7
120°-130°	964.0	7.5
130°-140°	1082.0	8.4
140°-150°	1061.0	8.2
150°-160°	890.1	6.9
160°-170°	590.3	4.6
170°-180°	206.3	1.6
0°-30°	2005.1	15.5
0°-40°	3216.5	24.9
0°-60°	5481.5	42.4
0°-90°	6825.3	52.8
90°-120°	1296.1	10.0
90°-150°	4403.1	34.1
90°-180°	6090.0	47.2
0°-180°	12915.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	24	64	60	62	12
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P919026

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.42	12.31	12.35	13.26	14.49	10.99	11.88	11.93	12.83	14.06
	3H	13.08	13.87	14.02	14.83	16.09	12.61	13.40	13.55	14.36	15.62
	4H	13.66	14.41	14.62	15.38	16.64	13.19	13.95	14.15	14.91	16.17
	6H	14.06	14.75	15.03	15.72	16.99	13.59	14.28	14.55	15.25	16.52
	8H	14.16	14.82	15.13	15.81	17.08	13.69	14.35	14.66	15.34	16.61
	12H	14.20	14.83	15.19	15.81	17.11	13.73	14.36	14.71	15.34	16.64
4H	2H	11.88	12.64	12.85	13.60	14.86	11.54	12.30	12.51	13.26	14.52
	3H	13.74	14.37	14.72	15.37	16.64	13.35	13.98	14.33	14.98	16.25
	4H	14.45	15.03	15.44	16.01	17.32	14.05	14.63	15.03	15.61	16.91
	6H	14.96	15.46	15.96	16.47	17.77	14.56	15.05	15.55	16.06	17.36
	8H	15.11	15.57	16.11	16.58	17.89	14.70	15.16	15.70	16.17	17.48
	12H	15.18	15.60	16.19	16.62	17.94	14.76	15.18	15.78	16.20	17.52
8H	4H	14.65	15.11	15.64	16.12	17.43	14.29	14.75	15.29	15.76	17.07
	6H	15.27	15.65	16.29	16.70	18.01	14.91	15.30	15.93	16.34	17.65
	8H	15.49	15.83	16.52	16.86	18.19	15.12	15.46	16.15	16.49	17.82
	12H	15.62	15.91	16.65	16.94	18.31	15.24	15.53	16.27	16.56	17.93
12H	4H	14.63	15.05	15.65	16.07	17.39	14.29	14.70	15.30	15.72	17.04
	6H	15.30	15.64	16.33	16.67	18.00	14.95	15.29	15.98	16.32	17.65
	8H	15.54	15.84	16.57	16.86	18.24	15.18	15.48	16.22	16.51	17.88

END OF REPORT