

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924442

Luminaire Tested: DFN2DIP-HX3F0-070D040US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924442
REPORT IS A COMBINATION OF REPORTS P899223 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D040US950-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9988.4 lumens
Efficiency: N/A
Efficacy: 101.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 98.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFLL

Luminous Intensity Polar Plot

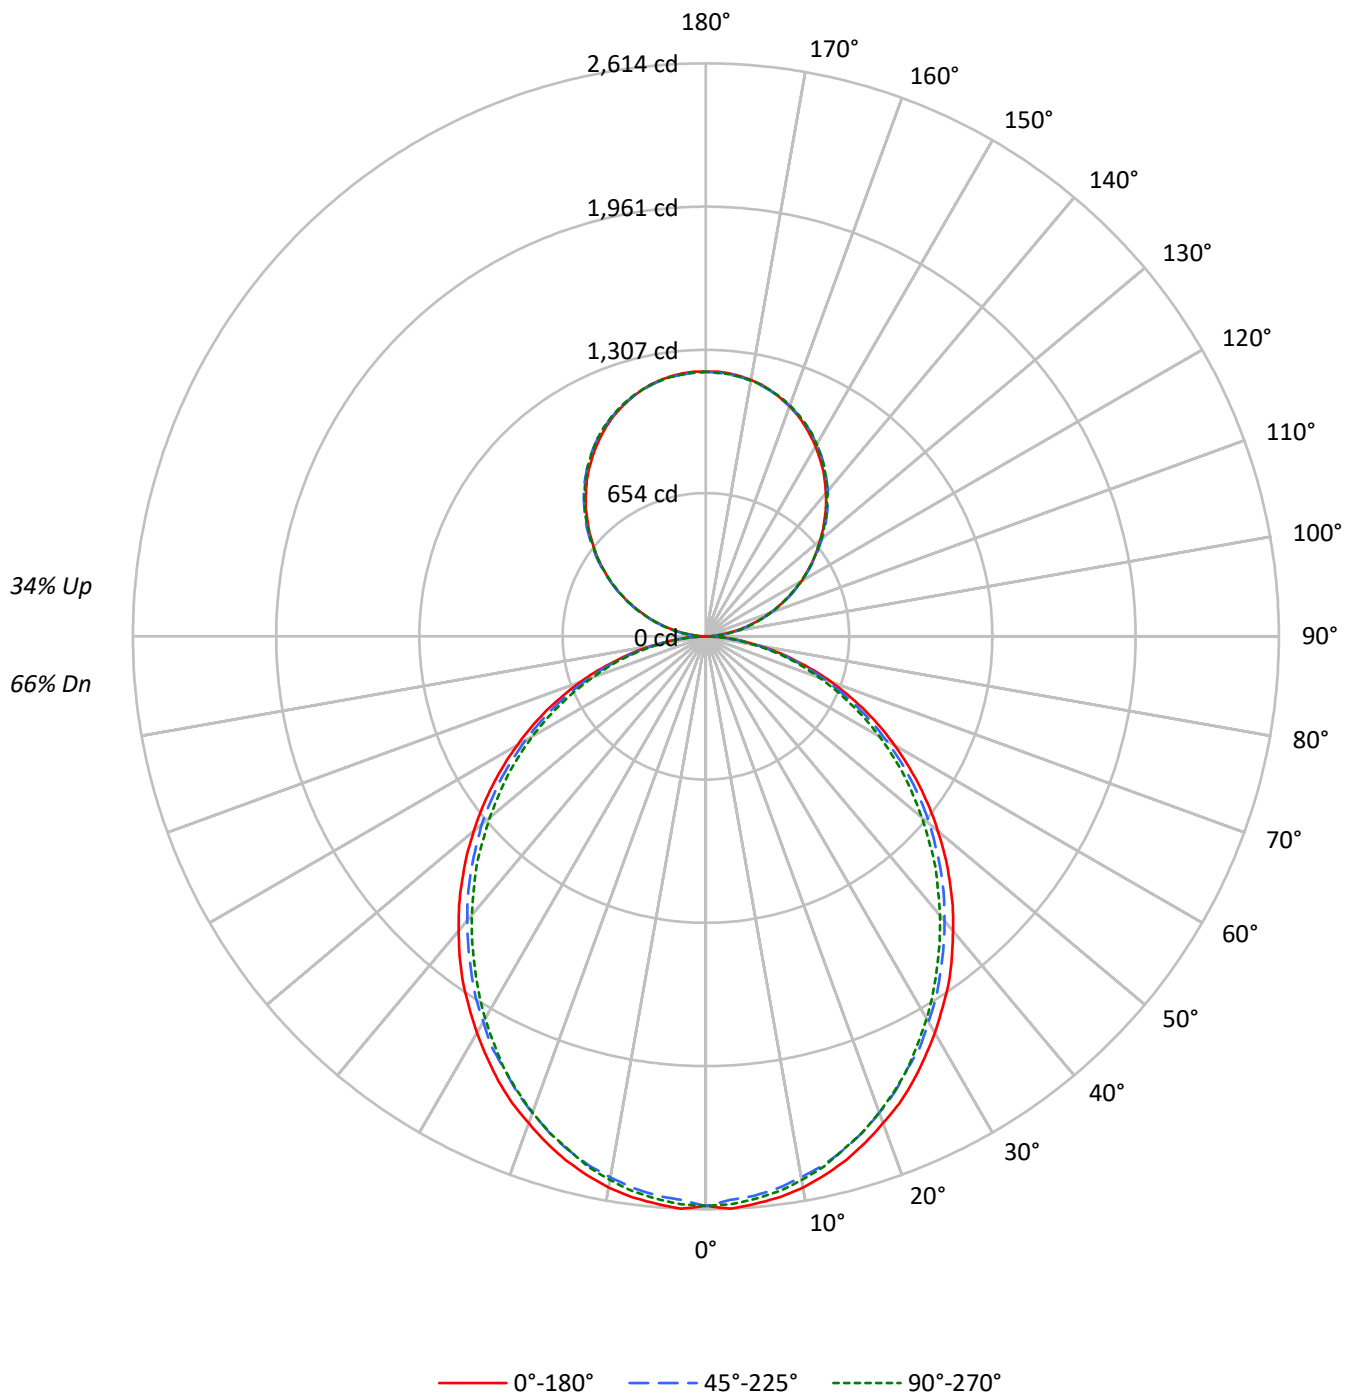

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	72	70	68	63	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	60	57	55	53	51
3	84	75	67	61	79	70	64	58	63	57	53	56	51	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	25
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3010	3010	3010
5°	3013	2966	2986
10°	2988	2924	2944
15°	2942	2874	2879
20°	2881	2805	2813
25°	2821	2723	2737
30°	2746	2646	2640
35°	2674	2556	2538
40°	2586	2465	2440
45°	2498	2374	2341
50°	2403	2278	2225
55°	2302	2167	2119
60°	2188	2036	1997
65°	2064	1900	1853
70°	1905	1733	1698
75°	1686	1533	1552
80°	1421	1279	1278
85°	1009	847	829

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2498 cd/sqm

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	244.6	2.4
10°-20°	688.1	6.9
20°-30°	1011.3	10.1
30°-40°	1174.5	11.8
40°-50°	1173.1	11.7
50°-60°	1022.9	10.2
60°-70°	756.1	7.6
70°-80°	427.8	4.3
80°-90°	116.4	1.2
90°-100°	74.7	0.7
100°-110°	237.3	2.4
110°-120°	406.1	4.1
120°-130°	534.0	5.3
130°-140°	599.4	6.0
140°-150°	587.8	5.9
150°-160°	493.1	4.9
160°-170°	327.0	3.3
170°-180°	114.3	1.1
0°-30°	1943.9	19.5
0°-40°	3118.5	31.2
0°-60°	5314.4	53.2
0°-90°	6614.7	66.2
90°-120°	718.0	7.2
90°-150°	2439.3	24.4
90°-180°	3374.0	33.8
0°-180°	9988.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2598	2598	2598	2598	2598	
5°	2598	2589	2561	2581	2576	247
15°	2474	2459	2426	2436	2424	697
25°	2239	2219	2176	2181	2176	1030
35°	1932	1907	1866	1851	1839	1206
45°	1572	1554	1517	1489	1479	1213
55°	1189	1174	1144	1114	1102	1063
65°	802	787	762	740	727	793
75°	420	415	402	387	392	448
85°	102	100	98	90	88	114
90°	1	13	36	34	34	10
95°	53	63	65	65	63	59
105°	219	222	224	226	226	231
115°	408	413	412	410	408	403
125°	593	602	599	596	594	530
135°	767	778	780	779	776	593
145°	931	938	944	945	941	582
155°	1064	1067	1070	1076	1072	490
165°	1158	1157	1157	1164	1159	327
175°	1205	1202	1200	1207	1201	114
180°	1207	1207	1207	1207	1207	

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2598.4	2598.4	2598.4	2598.4	2598.4
2.5°	2613.6	2601.1	2573.5	2598.4	2593.6
5°	2598.4	2588.7	2561.1	2581.0	2576.2
7.5°	2581.0	2566.1	2538.5	2558.7	2553.7
10°	2553.7	2536.1	2506.2	2526.1	2518.7
12.5°	2516.0	2501.2	2471.2	2483.6	2478.6
15°	2473.6	2458.7	2426.1	2436.2	2423.7
17.5°	2421.1	2406.3	2373.6	2386.1	2373.6
20°	2363.5	2348.7	2313.7	2321.2	2311.4
22.5°	2306.3	2283.8	2251.2	2251.2	2246.1
25°	2238.8	2218.8	2176.5	2181.2	2176.5
27.5°	2163.7	2146.2	2113.9	2106.4	2093.9
30°	2089.0	2068.7	2031.4	2024.0	2013.9
32.5°	2008.8	1994.1	1954.0	1938.9	1928.8
35°	1931.5	1906.6	1866.5	1851.4	1838.9
37.5°	1844.0	1821.5	1781.4	1763.9	1751.4
40°	1754.1	1734.0	1693.9	1671.7	1661.6
42.5°	1666.6	1646.5	1606.7	1581.5	1566.7
45°	1571.7	1554.3	1516.6	1489.3	1479.2
47.5°	1479.2	1461.7	1421.7	1394.1	1379.3
50°	1381.7	1369.2	1334.2	1299.3	1286.8
52.5°	1286.8	1269.3	1237.0	1209.4	1191.8
55°	1189.4	1174.4	1144.4	1114.5	1102.0
57.5°	1091.9	1079.5	1046.8	1016.9	1006.9
60°	994.4	984.5	949.6	922.0	914.6
62.5°	899.4	882.0	857.1	832.2	822.1
65°	802.2	787.0	762.2	739.6	727.1
67.5°	702.2	689.6	667.2	649.8	639.7
70°	609.7	599.7	577.1	559.6	549.8
72.5°	514.8	504.8	492.3	474.8	467.4
75°	419.7	414.9	402.1	387.3	392.4
77.5°	334.9	324.7	319.7	312.2	304.9
80°	249.9	247.4	242.3	234.9	229.8
82.5°	169.9	169.9	167.5	157.5	157.5
85°	102.4	100.0	97.6	89.9	87.5
87.5°	45.0	40.1	35.0	27.6	24.9
90°	1.0	13.1	35.7	33.5	34.5
92.5°	22.5	30.5	31.7	32.7	32.7
95°	53.1	63.3	65.2	65.2	63.3
97.5°	88.4	97.9	101.9	101.9	101.9
100°	129.2	137.6	140.4	140.4	139.4
102.5°	172.1	178.3	182.3	183.4	182.3
105°	219.0	221.9	224.1	225.9	225.9
107.5°	265.6	270.0	270.0	270.6	265.6
110°	310.7	316.5	316.5	316.5	313.7

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	359.5	365.7	364.5	361.7	359.5
115°	407.5	413.4	411.5	410.4	407.5
117.5°	455.2	463.2	458.1	455.2	452.3
120°	503.2	511.2	503.2	503.2	499.9
122.5°	546.8	557.0	552.0	549.0	546.8
125°	592.7	601.8	598.9	595.6	594.5
127.5°	637.5	648.7	644.7	640.3	637.5
130°	679.2	692.4	690.6	688.4	684.4
132.5°	726.2	736.4	737.2	732.0	729.1
135°	766.6	777.9	780.1	778.9	776.1
137.5°	811.8	820.8	822.6	821.9	817.6
140°	851.3	860.5	865.6	865.6	861.6
142.5°	892.2	901.2	904.1	905.3	901.2
145°	930.7	938.0	943.8	944.9	940.9
147.5°	965.3	974.3	978.7	980.5	976.5
150°	1000.9	1007.1	1011.1	1014.4	1011.1
152.5°	1032.6	1038.7	1043.9	1047.9	1043.9
155°	1064.2	1067.1	1070.4	1075.5	1072.2
157.5°	1091.6	1093.7	1095.5	1102.8	1097.7
160°	1115.9	1118.1	1119.1	1125.3	1121.0
162.5°	1138.4	1138.4	1139.6	1146.4	1141.4
165°	1157.8	1156.6	1156.6	1163.9	1158.8
167.5°	1175.2	1171.9	1171.9	1179.2	1174.1
170°	1188.3	1185.3	1184.3	1191.5	1185.3
172.5°	1197.4	1194.5	1193.4	1200.7	1194.5
175°	1204.7	1201.8	1199.6	1206.8	1200.7
177.5°	1208.7	1205.8	1203.6	1209.8	1203.6
180°	1206.8	1206.8	1206.8	1206.8	1206.8

TEST NUMBER: P924442

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.43	13.46	13.24	14.29	15.31	12.00	13.03	12.81	13.86	14.88
	3H	14.10	15.02	14.91	15.86	16.91	13.63	14.55	14.45	15.39	16.44
	4H	14.69	15.56	15.52	16.40	17.46	14.22	15.09	15.05	15.94	16.99
	6H	15.09	15.90	15.94	16.75	17.82	14.62	15.43	15.47	16.28	17.35
	8H	15.20	15.96	16.05	16.83	17.91	14.73	15.49	15.58	16.36	17.44
	12H	15.25	15.98	16.11	16.84	17.94	14.77	15.50	15.63	16.37	17.47
4H	2H	12.91	13.78	13.75	14.63	15.69	12.57	13.44	13.41	14.29	15.34
	3H	14.78	15.51	15.63	16.39	17.46	14.39	15.12	15.24	16.00	17.07
	4H	15.50	16.16	16.36	17.04	18.14	15.10	15.76	15.96	16.64	17.74
	6H	16.02	16.59	16.89	17.49	18.59	15.61	16.19	16.49	17.08	18.19
	8H	16.17	16.70	17.05	17.60	18.71	15.76	16.30	16.64	17.19	18.31
	12H	16.24	16.73	17.14	17.64	18.76	15.83	16.31	16.73	17.22	18.35
8H	4H	15.71	16.24	16.59	17.14	18.25	15.35	15.88	16.23	16.78	17.90
	6H	16.33	16.78	17.24	17.71	18.83	15.98	16.42	16.88	17.35	18.47
	8H	16.55	16.95	17.47	17.87	19.01	16.19	16.58	17.11	17.51	18.64
	12H	16.69	17.03	17.61	17.95	19.14	16.31	16.65	17.23	17.57	18.76
12H	4H	15.70	16.18	16.60	17.09	18.22	15.35	15.83	16.25	16.75	17.87
	6H	16.36	16.76	17.28	17.69	18.82	16.02	16.41	16.93	17.34	18.47
	8H	16.61	16.96	17.53	17.88	19.06	16.25	16.60	17.18	17.52	18.71

END OF REPORT