

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927408

Luminaire Tested: DFN2DIP-HX4F0-090D120US835-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927408
REPORT IS A COMBINATION OF REPORTS P900973 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D120US835-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20790.0 lumens
Efficiency: N/A
Efficacy: 112.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 184.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

Luminous Intensity Polar Plot

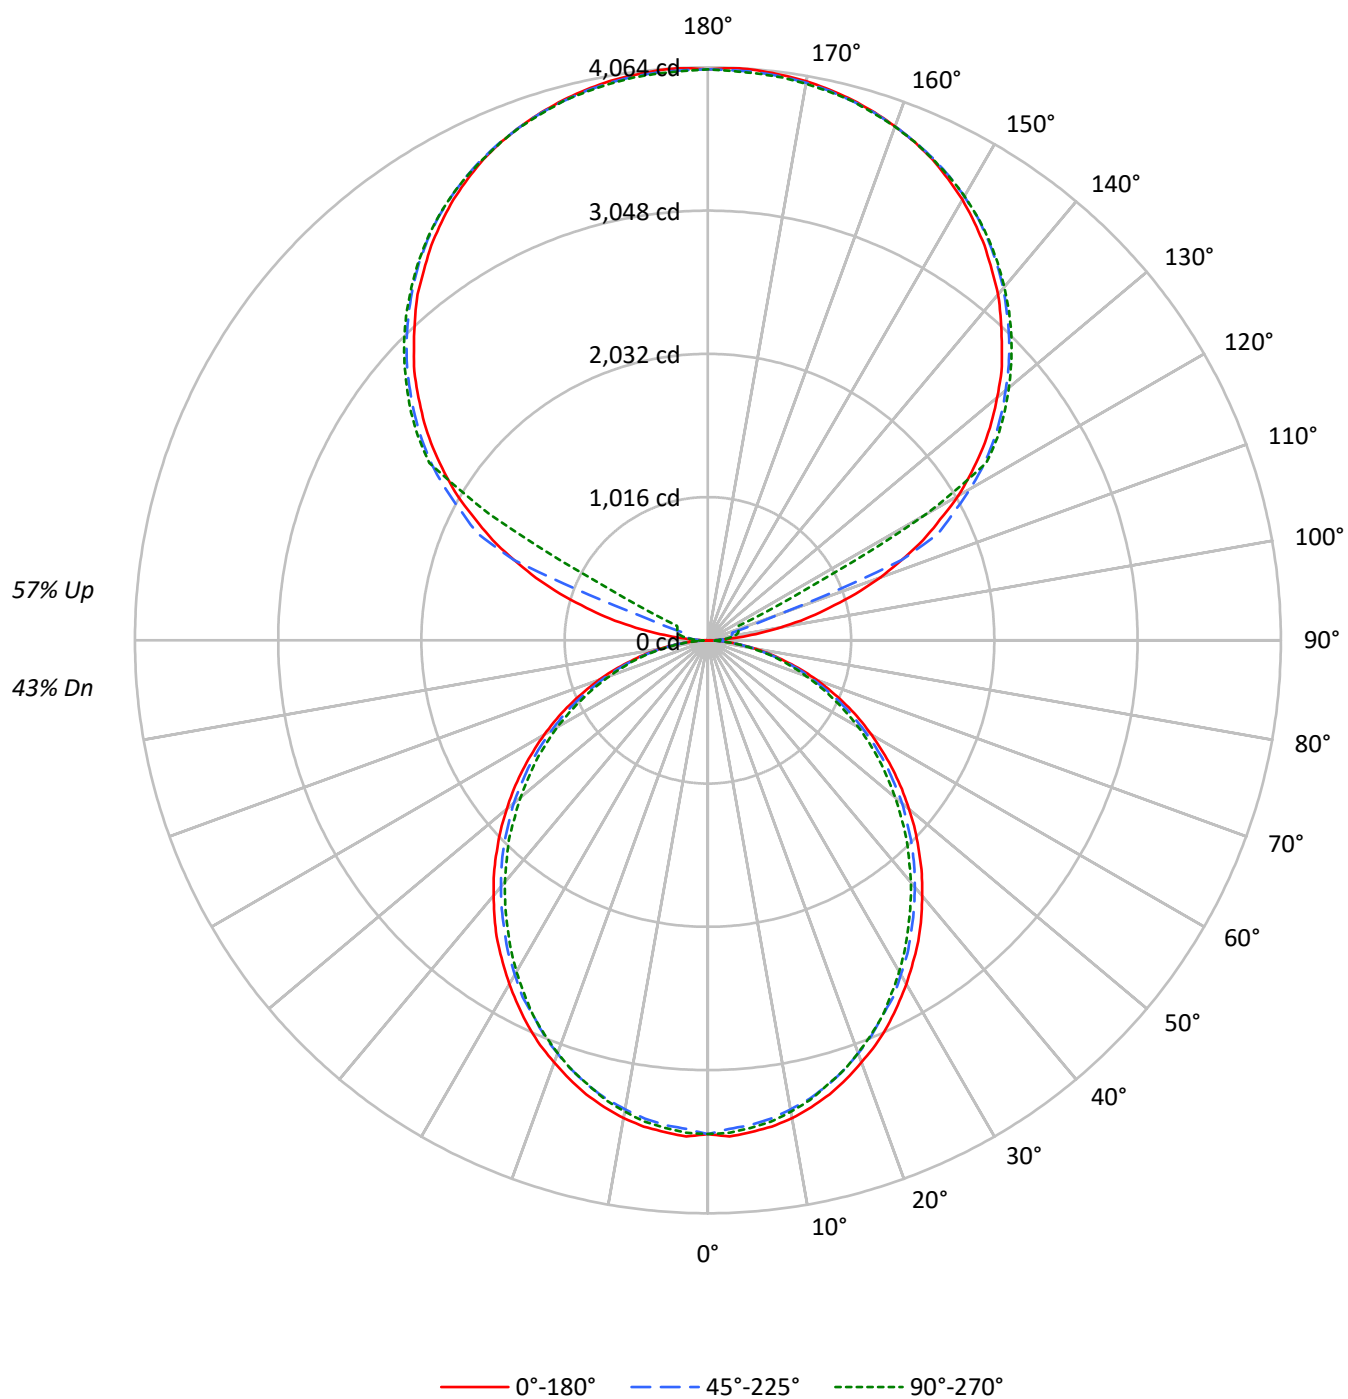

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2604	2604	2604
5°	2608	2568	2585
10°	2587	2534	2550
15°	2550	2492	2496
20°	2498	2434	2440
25°	2447	2365	2375
30°	2384	2301	2293
35°	2323	2225	2206
40°	2248	2149	2123
45°	2174	2072	2039
50°	2093	1992	1941
55°	2008	1898	1851
60°	1912	1788	1748
65°	1807	1673	1626
70°	1674	1534	1495
75°	1489	1367	1374
80°	1267	1154	1143
85°	919	787	760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2174 cd/sqm

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	329.6	1.6
10°-20°	927.4	4.5
20°-30°	1362.9	6.6
30°-40°	1582.9	7.6
40°-50°	1580.9	7.6
50°-60°	1378.5	6.6
60°-70°	1019.0	4.9
70°-80°	576.6	2.8
80°-90°	159.3	0.8
90°-100°	133.5	0.6
100°-110°	497.8	2.4
110°-120°	1320.3	6.4
120°-130°	2189.8	10.5
130°-140°	2326.1	11.2
140°-150°	2161.8	10.4
150°-160°	1738.1	8.4
160°-170°	1119.9	5.4
170°-180°	385.5	1.9
0°-30°	2619.9	12.6
0°-40°	4202.8	20.2
0°-60°	7162.3	34.5
0°-90°	8917.1	42.9
90°-120°	1951.7	9.4
90°-150°	8629.4	41.5
90°-180°	11873.0	57.1
0°-180°	20790.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3502	3502	3502	3502	3502	
5°	3502	3489	3452	3478	3472	332
15°	3334	3314	3270	3283	3266	939
25°	3017	2990	2933	2940	2933	1388
35°	2603	2570	2516	2495	2478	1626
45°	2118	2095	2044	2007	1994	1635
55°	1603	1583	1542	1502	1485	1433
65°	1081	1061	1027	997	980	1069
75°	566	559	542	522	529	604
85°	138	135	132	121	118	154
90°	3	35	58	73	79	19
95°	190	94	114	129	126	225
105°	891	979	179	211	223	952
115°	1685	1735	1808	451	240	1659
125°	2382	2421	2476	2497	2506	2125
135°	2948	2995	3021	3051	3045	2277
145°	3420	3417	3467	3487	3472	2139
155°	3766	3739	3775	3792	3769	1735
165°	3968	3950	3959	3980	3959	1121
175°	4058	4038	4044	4064	4035	386
180°	4050	4050	4050	4050	4050	

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3501.9	3501.9	3501.9	3501.9	3501.9
2.5°	3522.3	3505.5	3468.4	3501.9	3495.5
5°	3501.9	3488.7	3451.6	3478.4	3471.9
7.5°	3478.4	3458.4	3421.2	3448.4	3441.6
10°	3441.6	3418.0	3377.6	3404.4	3394.4
12.5°	3390.8	3370.8	3330.5	3347.2	3340.5
15°	3333.7	3313.7	3269.7	3283.3	3266.5
17.5°	3262.9	3242.9	3199.0	3215.8	3199.0
20°	3185.4	3165.4	3118.2	3128.2	3115.0
22.5°	3108.2	3077.9	3033.9	3033.9	3027.1
25°	3017.1	2990.3	2933.2	2939.6	2933.2
27.5°	2916.0	2892.4	2848.9	2838.9	2822.1
30°	2815.3	2788.1	2737.7	2727.7	2714.2
32.5°	2707.4	2687.4	2633.4	2613.1	2599.5
35°	2603.1	2569.5	2515.5	2495.2	2478.4
37.5°	2485.2	2454.8	2400.8	2377.3	2360.5
40°	2364.0	2336.9	2282.9	2252.9	2239.4
42.5°	2246.1	2219.0	2165.4	2131.5	2111.5
45°	2118.2	2094.7	2043.9	2007.1	1993.6
47.5°	1993.6	1970.0	1916.0	1878.9	1858.9
50°	1862.1	1845.3	1798.1	1751.0	1734.2
52.5°	1734.2	1710.6	1667.0	1629.9	1606.3
55°	1603.1	1582.7	1542.3	1502.0	1485.2
57.5°	1471.6	1454.8	1410.9	1370.5	1356.9
60°	1340.1	1326.9	1279.7	1242.6	1232.6
62.5°	1212.2	1188.6	1155.0	1121.5	1107.9
65°	1081.1	1060.7	1027.1	996.8	980.0
67.5°	946.4	929.3	899.2	875.7	862.1
70°	821.7	808.1	777.8	754.2	741.0
72.5°	693.8	680.2	663.4	639.9	629.9
75°	565.6	559.1	542.0	522.0	528.8
77.5°	451.2	437.7	430.9	420.9	410.9
80°	336.9	333.3	326.5	316.5	309.8
82.5°	229.0	229.0	225.8	212.2	212.2
85°	137.9	134.7	131.5	121.1	117.9
87.5°	60.7	53.9	47.2	37.2	33.6
90°	2.8	35.1	58.5	73.4	79.0
92.5°	73.4	61.6	70.3	76.2	79.0
95°	190.3	93.6	114.1	129.1	126.0
97.5°	342.8	102.7	149.3	158.3	161.1
100°	518.8	117.3	167.0	190.3	196.3
102.5°	712.0	706.4	172.9	205.0	214.0
105°	890.8	978.9	178.9	210.9	222.7
107.5°	1098.9	1172.0	184.8	216.8	228.6
110°	1298.3	1359.6	512.9	219.9	231.4

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1485.9	1538.4	1488.7	225.5	234.5
115°	1684.9	1734.7	1808.1	451.3	240.5
117.5°	1857.9	1916.4	1966.5	1547.1	779.5
120°	2051.4	2095.2	2148.1	2183.3	1787.6
122.5°	2215.3	2262.3	2321.1	2338.5	2341.6
125°	2382.3	2420.6	2476.3	2496.8	2505.5
127.5°	2534.7	2575.8	2620.0	2649.2	2652.0
130°	2678.4	2725.4	2757.4	2789.8	2787.0
132.5°	2824.9	2863.2	2895.2	2921.7	2918.9
135°	2948.1	2995.1	3021.2	3050.8	3044.9
137.5°	3076.9	3112.0	3141.6	3170.8	3162.1
140°	3202.9	3226.5	3258.5	3285.0	3270.4
142.5°	3308.6	3329.2	3367.1	3390.4	3375.8
145°	3420.0	3416.9	3466.6	3487.2	3472.5
147.5°	3516.4	3507.7	3557.5	3572.1	3560.6
150°	3610.3	3589.8	3636.8	3654.2	3639.6
152.5°	3689.3	3666.0	3709.9	3727.6	3707.1
155°	3765.5	3739.4	3774.6	3792.0	3768.7
157.5°	3827.1	3803.8	3830.3	3850.8	3827.1
160°	3880.0	3862.3	3880.0	3897.4	3876.9
162.5°	3926.7	3909.3	3923.9	3944.4	3918.0
165°	3967.7	3950.3	3959.0	3979.6	3959.0
167.5°	4000.1	3982.3	3991.4	4011.9	3985.5
170°	4026.5	4008.8	4014.7	4035.2	4008.8
172.5°	4043.9	4026.5	4032.5	4053.0	4026.5
175°	4058.5	4038.0	4043.9	4064.5	4035.2
177.5°	4064.5	4043.9	4047.1	4067.6	4041.2
180°	4049.9	4049.9	4049.9	4049.9	4049.9

TEST NUMBER: P927408

CATALOG NUMBER: DFN2DIP-HX4F0-090D120US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.90	10.70	10.92	11.73	13.10	9.47	10.27	10.49	11.30	12.67
	3H	11.56	12.28	12.59	13.31	14.70	11.09	11.80	12.11	12.84	14.23
	4H	12.15	12.83	13.18	13.86	15.26	11.67	12.35	12.71	13.39	14.79
	6H	12.54	13.17	13.59	14.21	15.62	12.07	12.69	13.12	13.73	15.14
	8H	12.65	13.24	13.70	14.30	15.70	12.17	12.77	13.22	13.82	15.23
	12H	12.69	13.26	13.75	14.31	15.74	12.21	12.78	13.27	13.83	15.26
4H	2H	10.36	11.04	11.40	12.07	13.47	10.01	10.69	11.06	11.73	13.13
	3H	12.22	12.79	13.27	13.85	15.26	11.83	12.39	12.88	13.46	14.87
	4H	12.93	13.45	13.99	14.51	15.94	12.53	13.05	13.59	14.10	15.53
	6H	13.44	13.89	14.51	14.97	16.40	13.04	13.48	14.10	14.56	15.99
	8H	13.59	14.01	14.66	15.08	16.52	13.18	13.60	14.25	14.67	16.11
	12H	13.66	14.04	14.75	15.13	16.57	13.24	13.62	14.33	14.71	16.15
8H	4H	13.12	13.54	14.19	14.61	16.06	12.76	13.18	13.83	14.25	15.70
	6H	13.75	14.10	14.85	15.21	16.65	13.39	13.74	14.48	14.85	16.29
	8H	13.98	14.28	15.07	15.37	16.83	13.61	13.91	14.71	15.01	16.46
	12H	14.11	14.37	15.21	15.46	16.96	13.72	13.99	14.82	15.08	16.58
12H	4H	13.11	13.49	14.19	14.57	16.02	12.76	13.13	13.84	14.22	15.67
	6H	13.78	14.09	14.88	15.18	16.64	13.43	13.74	14.53	14.83	16.29
	8H	14.02	14.29	15.13	15.38	16.88	13.67	13.93	14.77	15.03	16.52