

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927422

Luminaire Tested: DFN2DIP-HX4F0-100D060US835-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927422
REPORT IS A COMBINATION OF REPORTS P900868 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D060US835-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14440.0 lumens
Efficiency: N/A
Efficacy: 100.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLLONL

Luminous Intensity Polar Plot

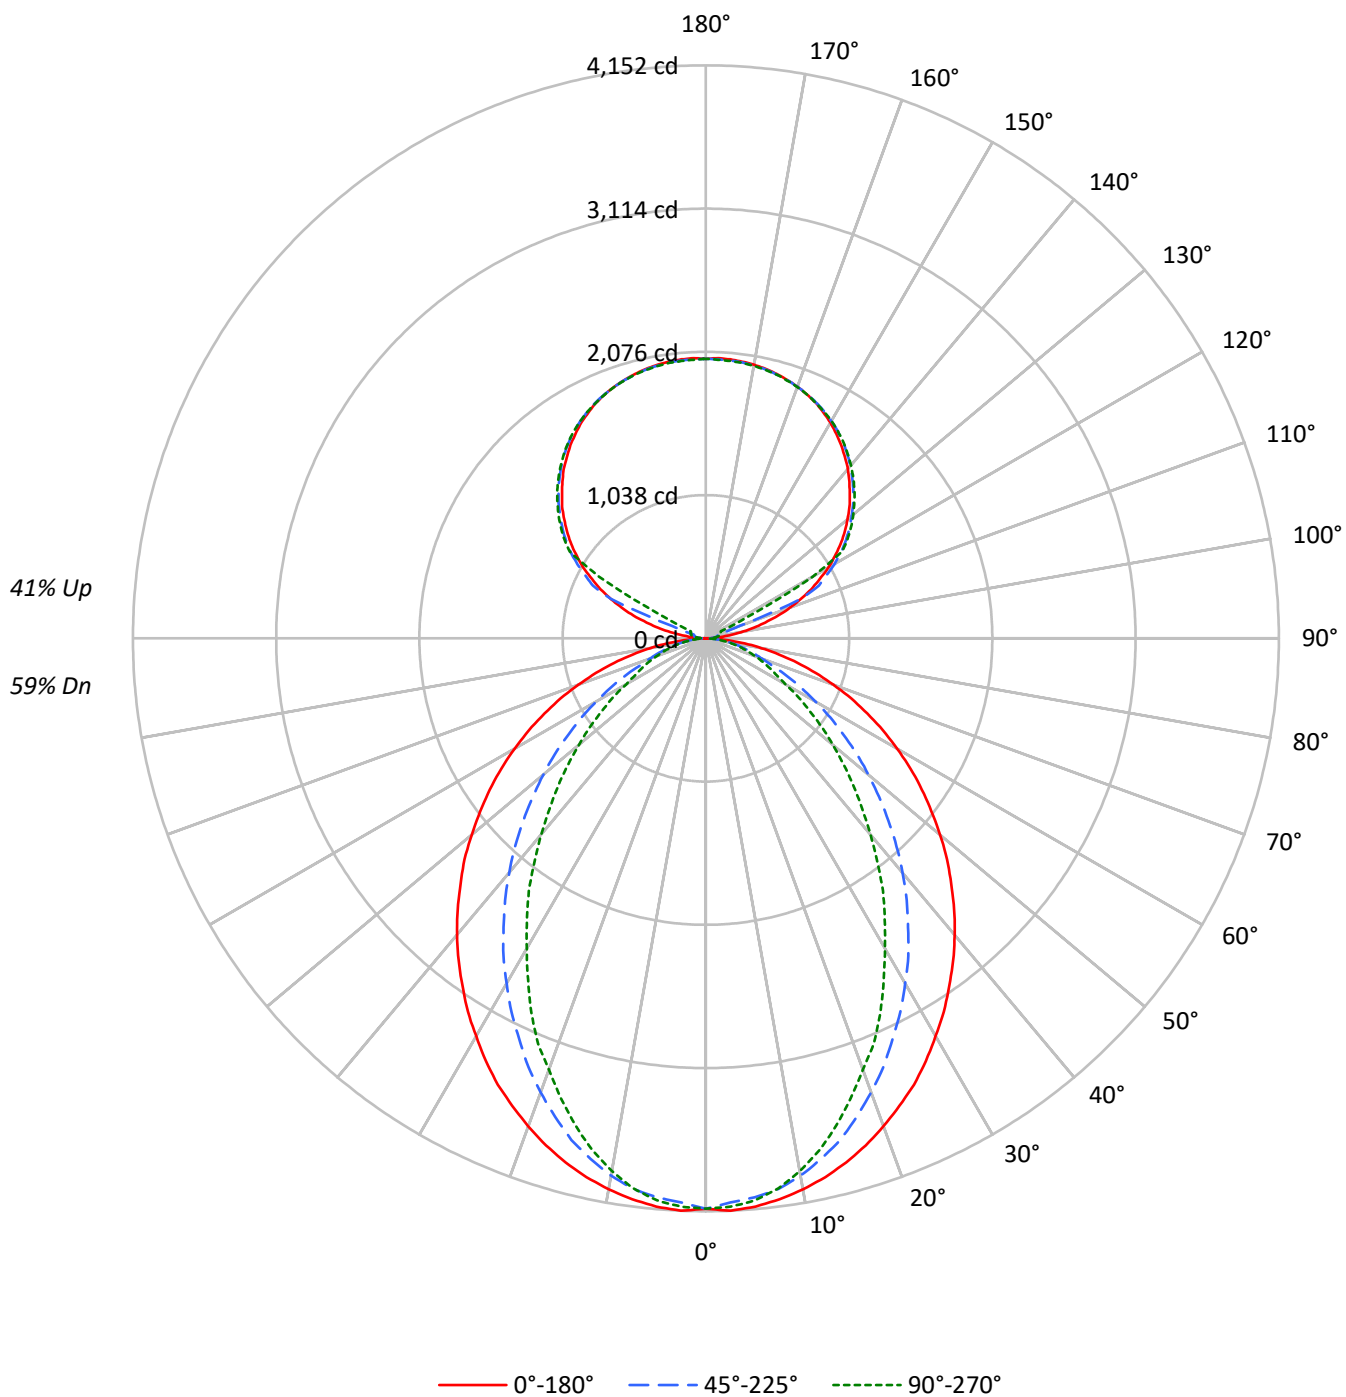

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	55
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	51	49	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	43	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	38	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	23	21
10	50	38	31	26	46	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3073	3073	3073
5°	3078	3025	3044
10°	3048	2966	2945
15°	3006	2868	2792
20°	2951	2733	2604
25°	2895	2582	2423
30°	2818	2427	2193
35°	2744	2260	1991
40°	2668	2088	1759
45°	2580	1896	1549
50°	2489	1703	1344
55°	2394	1496	1147
60°	2284	1280	944
65°	2157	1060	850
70°	2004	855	769
75°	1811	755	700
80°	1532	634	608
85°	1071	425	458

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2580 cd/sqm

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	387.3	2.7
10°-20°	1063.3	7.4
20°-30°	1492.9	10.3
30°-40°	1627.4	11.3
40°-50°	1495.7	10.4
50°-60°	1174.7	8.1
60°-70°	764.6	5.3
70°-80°	393.6	2.7
80°-90°	104.0	0.7
90°-100°	66.8	0.5
100°-110°	248.9	1.7
110°-120°	660.2	4.6
120°-130°	1094.9	7.6
130°-140°	1163.0	8.1
140°-150°	1080.9	7.5
150°-160°	869.0	6.0
160°-170°	560.0	3.9
170°-180°	192.7	1.3
0°-30°	2943.6	20.4
0°-40°	4571.0	31.7
0°-60°	7241.3	50.1
0°-90°	8503.5	58.9
90°-120°	975.8	6.8
90°-150°	4314.7	29.9
90°-180°	5936.0	41.1
0°-180°	14440.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4133	4133	4133	4133	4133	
5°	4133	4114	4066	4099	4088	392
15°	3931	3890	3763	3692	3654	1108
25°	3568	3448	3202	3048	2992	1641
35°	3075	2884	2555	2319	2236	1924
45°	2514	2263	1870	1604	1515	1941
55°	1911	1620	1216	991	920	1708
65°	1290	987	651	524	512	1279
75°	688	426	299	273	269	728
85°	161	82	71	71	71	184
90°	1	18	29	37	40	14
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4133.0	4133.0	4133.0	4133.0	4133.0
2.5°	4151.6	4133.0	4091.7	4129.4	4121.9
5°	4133.0	4114.3	4065.5	4099.3	4088.1
7.5°	4099.3	4077.0	4024.6	4039.3	4020.7
10°	4054.4	4028.2	3953.6	3942.1	3919.9
12.5°	3998.5	3964.7	3863.5	3841.3	3800.0
15°	3931.0	3889.7	3762.7	3691.7	3654.4
17.5°	3852.4	3792.5	3635.4	3553.2	3493.3
20°	3762.7	3687.7	3500.8	3407.6	3325.0
22.5°	3665.5	3579.4	3362.3	3235.4	3179.4
25°	3568.3	3448.5	3201.6	3048.4	2992.1
27.5°	3452.4	3325.0	3052.0	2876.2	2790.1
30°	3329.0	3186.5	2887.3	2696.9	2595.7
32.5°	3209.2	3036.9	2730.6	2506.0	2412.3
35°	3074.6	2883.8	2554.8	2319.1	2236.5
37.5°	2943.7	2737.7	2390.1	2131.8	2038.5
40°	2805.2	2581.0	2217.9	1952.4	1855.2
42.5°	2663.1	2423.8	2046.1	1769.1	1675.8
45°	2513.5	2262.7	1870.3	1604.4	1514.7
47.5°	2371.5	2106.0	1702.0	1436.1	1354.0
50°	2214.3	1948.8	1537.3	1279.0	1200.8
52.5°	2060.7	1780.2	1380.2	1133.3	1062.3
55°	1911.1	1619.5	1215.5	991.3	920.2
57.5°	1758.0	1458.7	1069.9	860.3	800.4
60°	1600.8	1301.6	916.3	725.8	665.9
62.5°	1447.6	1148.4	785.3	606.0	576.2
65°	1290.5	987.3	650.8	523.8	512.3
67.5°	1140.9	837.7	523.8	459.9	448.8
70°	983.7	692.1	433.7	396.4	381.4
72.5°	834.1	557.1	362.7	332.9	325.4
75°	688.1	426.2	299.2	273.0	269.4
77.5°	542.5	302.8	235.7	220.6	213.1
80°	407.5	217.1	179.4	164.7	164.7
82.5°	284.1	146.0	123.4	115.9	115.9
85°	160.7	82.1	71.0	71.0	71.0
87.5°	59.9	29.8	29.8	26.2	26.2
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P927422

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.84	12.75	12.72	13.65	14.79	7.81	8.72	8.70	9.62	10.76
	3H	13.52	14.34	14.42	15.25	16.41	9.01	9.82	9.91	10.73	11.90
	4H	14.14	14.90	15.05	15.82	17.00	9.46	10.23	10.38	11.15	12.32
	6H	14.56	15.27	15.49	16.19	17.38	9.79	10.50	10.72	11.42	12.61
	8H	14.69	15.36	15.62	16.30	17.49	9.89	10.56	10.82	11.50	12.68
	12H	14.76	15.40	15.69	16.33	17.54	9.93	10.57	10.87	11.50	12.72
4H	2H	11.87	12.64	12.79	13.55	14.73	8.42	9.19	9.34	10.10	11.28
	3H	13.71	14.34	14.63	15.29	16.48	9.78	10.42	10.71	11.36	12.55
	4H	14.40	14.98	15.34	15.92	17.14	10.33	10.91	11.27	11.85	13.07
	6H	14.92	15.42	15.87	16.39	17.60	10.76	11.26	11.71	12.22	13.44
	8H	15.10	15.57	16.05	16.52	17.75	10.89	11.35	11.84	12.31	13.54
	12H	15.20	15.62	16.17	16.59	17.83	10.96	11.38	11.93	12.35	13.59
8H	4H	14.38	14.84	15.33	15.80	17.03	10.62	11.08	11.57	12.04	13.27
	6H	14.95	15.33	15.92	16.33	17.56	11.14	11.53	12.12	12.53	13.76
	8H	15.16	15.50	16.15	16.49	17.74	11.33	11.67	12.32	12.66	13.91
	12H	15.31	15.61	16.30	16.59	17.88	11.46	11.76	12.45	12.74	14.03
12H	4H	14.33	14.75	15.30	15.73	16.96	10.63	11.05	11.60	12.02	13.26
	6H	14.92	15.26	15.91	16.25	17.50	11.19	11.53	12.18	12.52	13.77
	8H	15.15	15.45	16.14	16.43	17.72	11.41	11.71	12.40	12.69	13.98

END OF REPORT