

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919134

Luminaire Tested: DFN2DIP-HX4F0-080D080US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919134
REPORT IS A COMBINATION OF REPORTS P899379 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-080D080US935-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12915.0 lumens
Efficiency: N/A
Efficacy: 105.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFLL

Luminous Intensity Polar Plot

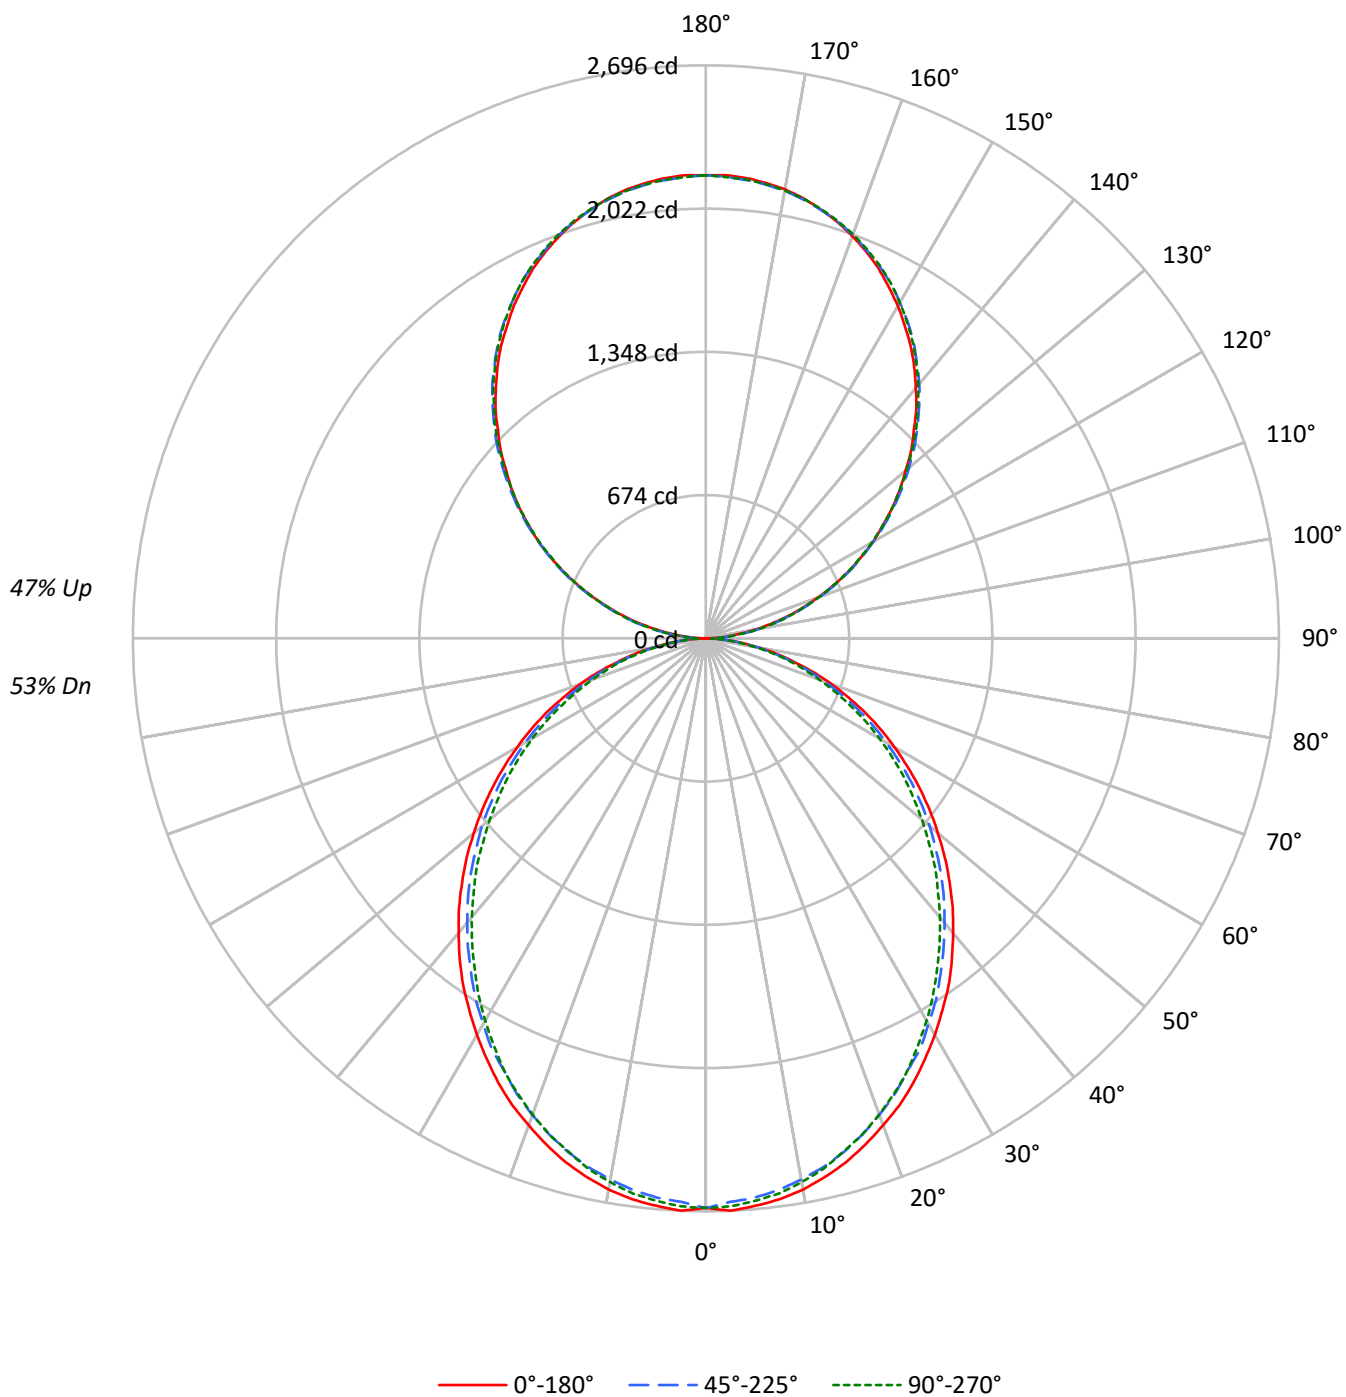

TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1993	1993	1993
5°	1996	1965	1978
10°	1980	1939	1952
15°	1951	1907	1910
20°	1912	1863	1867
25°	1873	1810	1818
30°	1824	1761	1755
35°	1778	1703	1688
40°	1721	1645	1625
45°	1664	1586	1560
50°	1602	1524	1485
55°	1537	1453	1416
60°	1463	1368	1337
65°	1383	1281	1244
70°	1281	1174	1144
75°	1139	1046	1052
80°	970	883	875
85°	704	602	582

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1664 cd/sqm

TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	2.0
10°-20°	709.8	5.5
20°-30°	1043.1	8.1
30°-40°	1211.4	9.4
40°-50°	1209.9	9.4
50°-60°	1055.0	8.2
60°-70°	779.9	6.0
70°-80°	441.2	3.4
80°-90°	122.7	0.9
90°-100°	134.8	1.0
100°-110°	428.3	3.3
110°-120°	733.0	5.7
120°-130°	964.0	7.5
130°-140°	1082.0	8.4
140°-150°	1061.0	8.2
150°-160°	890.1	6.9
160°-170°	590.3	4.6
170°-180°	206.3	1.6
0°-30°	2005.1	15.5
0°-40°	3216.5	24.9
0°-60°	5481.5	42.4
0°-90°	6825.3	52.8
90°-120°	1296.1	10.0
90°-150°	4403.1	34.1
90°-180°	6090.0	47.2
0°-180°	12915.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	24	64	60	62	12
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	



TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P919134

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.93	10.81	10.86	11.76	12.99	9.49	10.38	10.43	11.33	12.56
	3H	11.59	12.39	12.53	13.35	14.60	11.12	11.91	12.06	12.87	14.13
	4H	12.18	12.93	13.14	13.90	15.16	11.71	12.46	12.66	13.42	14.68
	6H	12.58	13.28	13.55	14.24	15.52	12.11	12.80	13.07	13.77	15.04
	8H	12.69	13.35	13.66	14.33	15.61	12.21	12.87	13.19	13.86	15.13
	12H	12.74	13.37	13.72	14.35	15.64	12.26	12.88	13.24	13.86	15.16
4H	2H	10.39	11.15	11.36	12.11	13.37	10.05	10.80	11.01	11.76	13.03
	3H	12.26	12.89	13.24	13.88	15.16	11.87	12.50	12.84	13.49	14.77
	4H	12.98	13.55	13.96	14.54	15.84	12.57	13.15	13.55	14.13	15.43
	6H	13.50	13.99	14.49	15.00	16.30	13.09	13.58	14.08	14.59	15.89
	8H	13.65	14.11	14.64	15.11	16.43	13.23	13.70	14.23	14.70	16.01
	12H	13.72	14.14	14.74	15.16	16.48	13.30	13.72	14.31	14.74	16.05
8H	4H	13.18	13.64	14.17	14.64	15.96	12.82	13.28	13.81	14.28	15.60
	6H	13.81	14.19	14.83	15.24	16.55	13.45	13.83	14.47	14.88	16.19
	8H	14.03	14.37	15.06	15.40	16.73	13.66	14.00	14.69	15.03	16.36
	12H	14.17	14.46	15.20	15.49	16.86	13.78	14.08	14.81	15.10	16.48
12H	4H	13.16	13.58	14.18	14.60	15.92	12.81	13.23	13.83	14.25	15.57
	6H	13.84	14.18	14.87	15.21	16.54	13.49	13.83	14.52	14.86	16.19
	8H	14.09	14.38	15.12	15.41	16.78	13.73	14.03	14.76	15.05	16.43