

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913908

Luminaire Tested: DFN2DIP-PN3F0-040D080US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913908
REPORT IS A COMBINATION OF REPORTS P899583 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-040D080US927-FLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8745.7 lumens
Efficiency: N/A
Efficacy: 91.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 96.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

Luminous Intensity Polar Plot

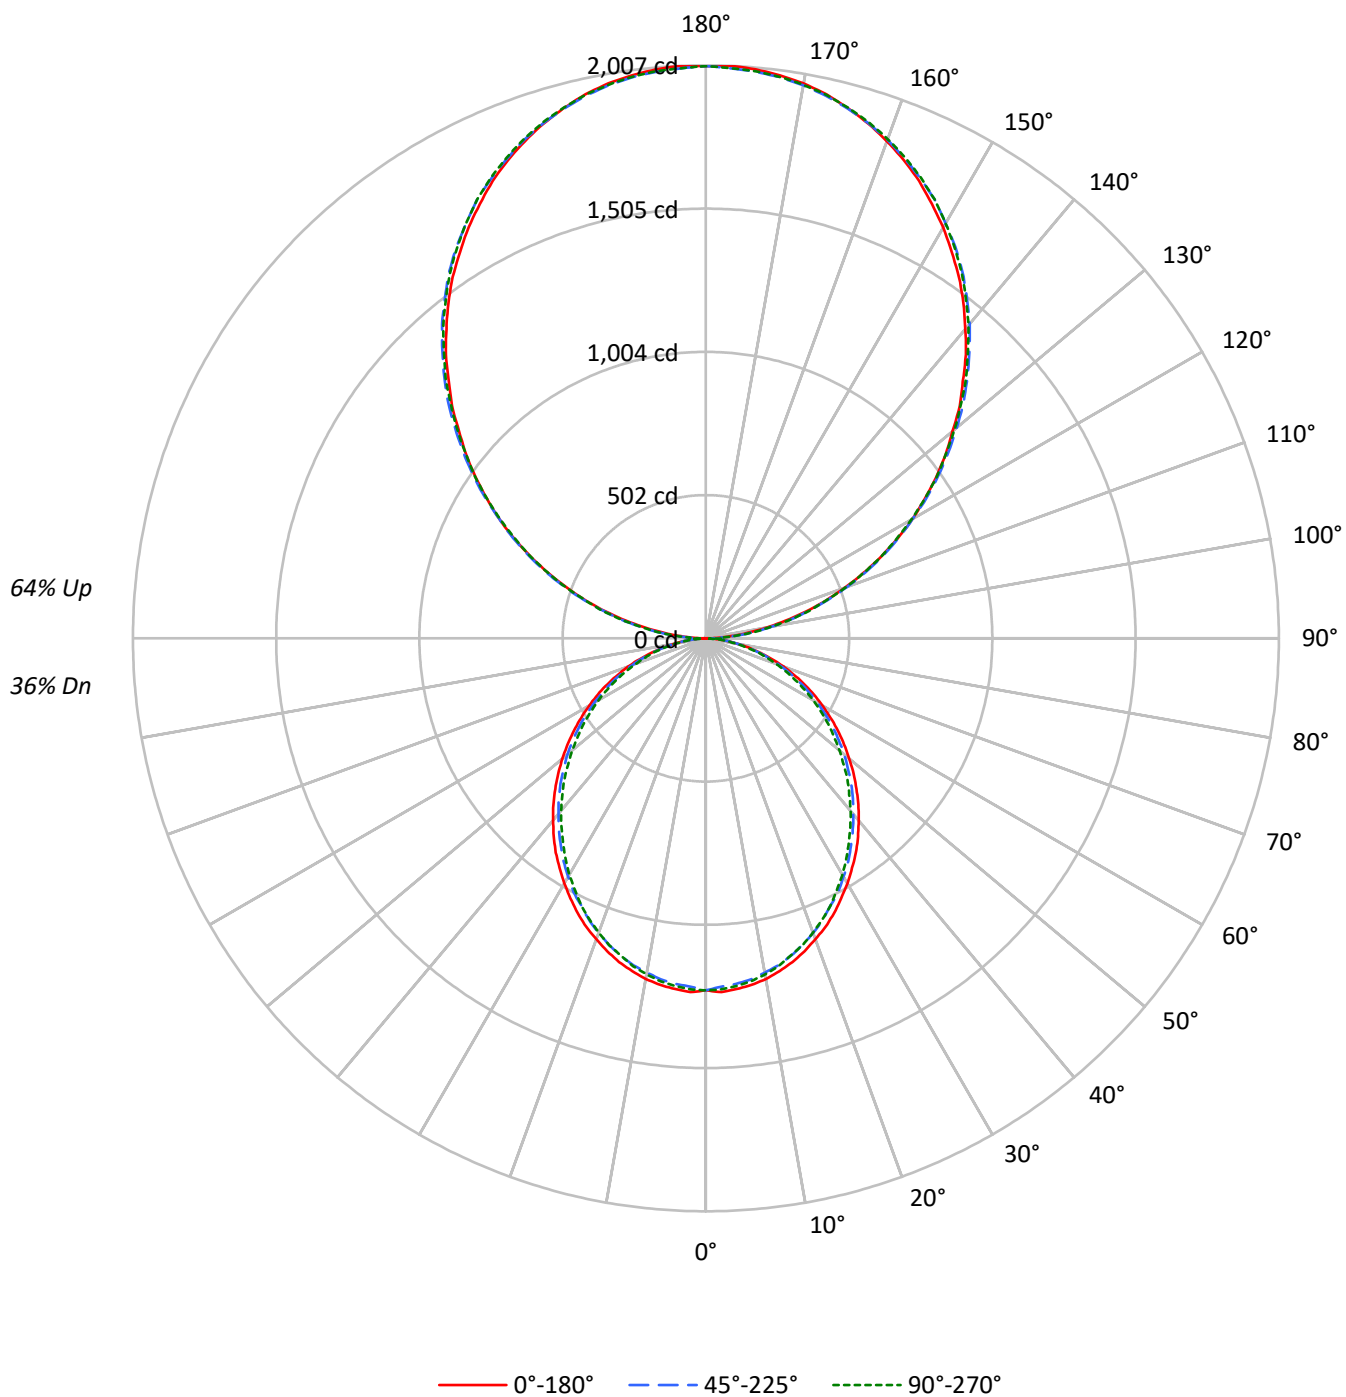

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1441	1441	1441
5°	1443	1420	1430
10°	1430	1400	1410
15°	1408	1376	1379
20°	1379	1343	1348
25°	1350	1304	1311
30°	1314	1267	1265
35°	1279	1224	1216
40°	1237	1180	1170
45°	1195	1137	1122
50°	1148	1091	1067
55°	1100	1038	1017
60°	1045	975	959
65°	985	909	890
70°	909	830	816
75°	803	734	747
80°	675	612	616
85°	477	405	402

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1986 cd/sqm

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.3
10°-20°	326.5	3.7
20°-30°	479.8	5.5
30°-40°	557.3	6.4
40°-50°	556.6	6.4
50°-60°	485.3	5.5
60°-70°	358.8	4.1
70°-80°	203.0	2.3
80°-90°	59.3	0.7
90°-100°	124.0	1.4
100°-110°	394.1	4.5
110°-120°	674.4	7.7
120°-130°	886.9	10.1
130°-140°	995.5	11.4
140°-150°	976.2	11.2
150°-160°	818.9	9.4
160°-170°	543.1	6.2
170°-180°	189.8	2.2
0°-30°	922.4	10.5
0°-40°	1479.7	16.9
0°-60°	2521.7	28.8
0°-90°	3142.7	35.9
90°-120°	1192.5	13.6
90°-150°	4051.1	46.3
90°-180°	5603.0	64.1
0°-180°	8745.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	2	22	59	56	57	9
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P913908

CATALOG NUMBER: DFN2DIP-PN3F0-040D080US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.04	7.79	8.11	8.86	10.32	6.60	7.35	7.67	8.42	9.88
	3H	8.68	9.35	9.76	10.43	11.91	8.20	8.87	9.28	9.95	11.43
	4H	9.26	9.90	10.35	10.98	12.46	8.78	9.41	9.87	10.49	11.98
	6H	9.65	10.24	10.75	11.32	12.82	9.16	9.75	10.26	10.83	12.33
	8H	9.75	10.31	10.85	11.41	12.90	9.26	9.82	10.36	10.92	12.41
	12H	9.79	10.32	10.90	11.42	12.93	9.30	9.83	10.40	10.92	12.43
4H	2H	7.48	8.12	8.58	9.20	10.68	7.13	7.77	8.23	8.85	10.33
	3H	9.33	9.86	10.43	10.97	12.47	8.93	9.46	10.03	10.57	12.06
	4H	10.04	10.52	11.14	11.62	13.14	9.62	10.11	10.73	11.20	12.72
	6H	10.54	10.96	11.65	12.08	13.59	10.12	10.53	11.23	11.66	13.16
	8H	10.68	11.07	11.80	12.19	13.71	10.26	10.65	11.37	11.76	13.28
	12H	10.75	11.10	11.88	12.23	13.76	10.31	10.66	11.44	11.79	13.32
8H	4H	10.22	10.61	11.33	11.72	13.25	9.85	10.24	10.96	11.35	12.88
	6H	10.84	11.16	11.97	12.32	13.84	10.46	10.79	11.60	11.94	13.46
	8H	11.05	11.34	12.20	12.47	14.01	10.67	10.95	11.81	12.09	13.63
	12H	11.18	11.42	12.32	12.56	14.13	10.78	11.02	11.92	12.16	13.73
12H	4H	10.20	10.55	11.33	11.68	13.21	9.84	10.19	10.97	11.32	12.85
	6H	10.86	11.15	12.01	12.28	13.83	10.50	10.78	11.64	11.92	13.46
	8H	11.10	11.34	12.24	12.48	14.05	10.73	10.97	11.87	12.11	13.68

END OF REPORT