

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913970

Luminaire Tested: DFN2DIP-PN3F0-060D090US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913970
REPORT IS A COMBINATION OF REPORTS P899602 AND P896399
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN3F0-060D090US927-RLLFLL
Description: 3 foot, Pentagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10349.9 lumens
Efficiency: N/A
Efficacy: 80.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.96' x L: 3.11' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 128.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLLFLL

Luminous Intensity Polar Plot

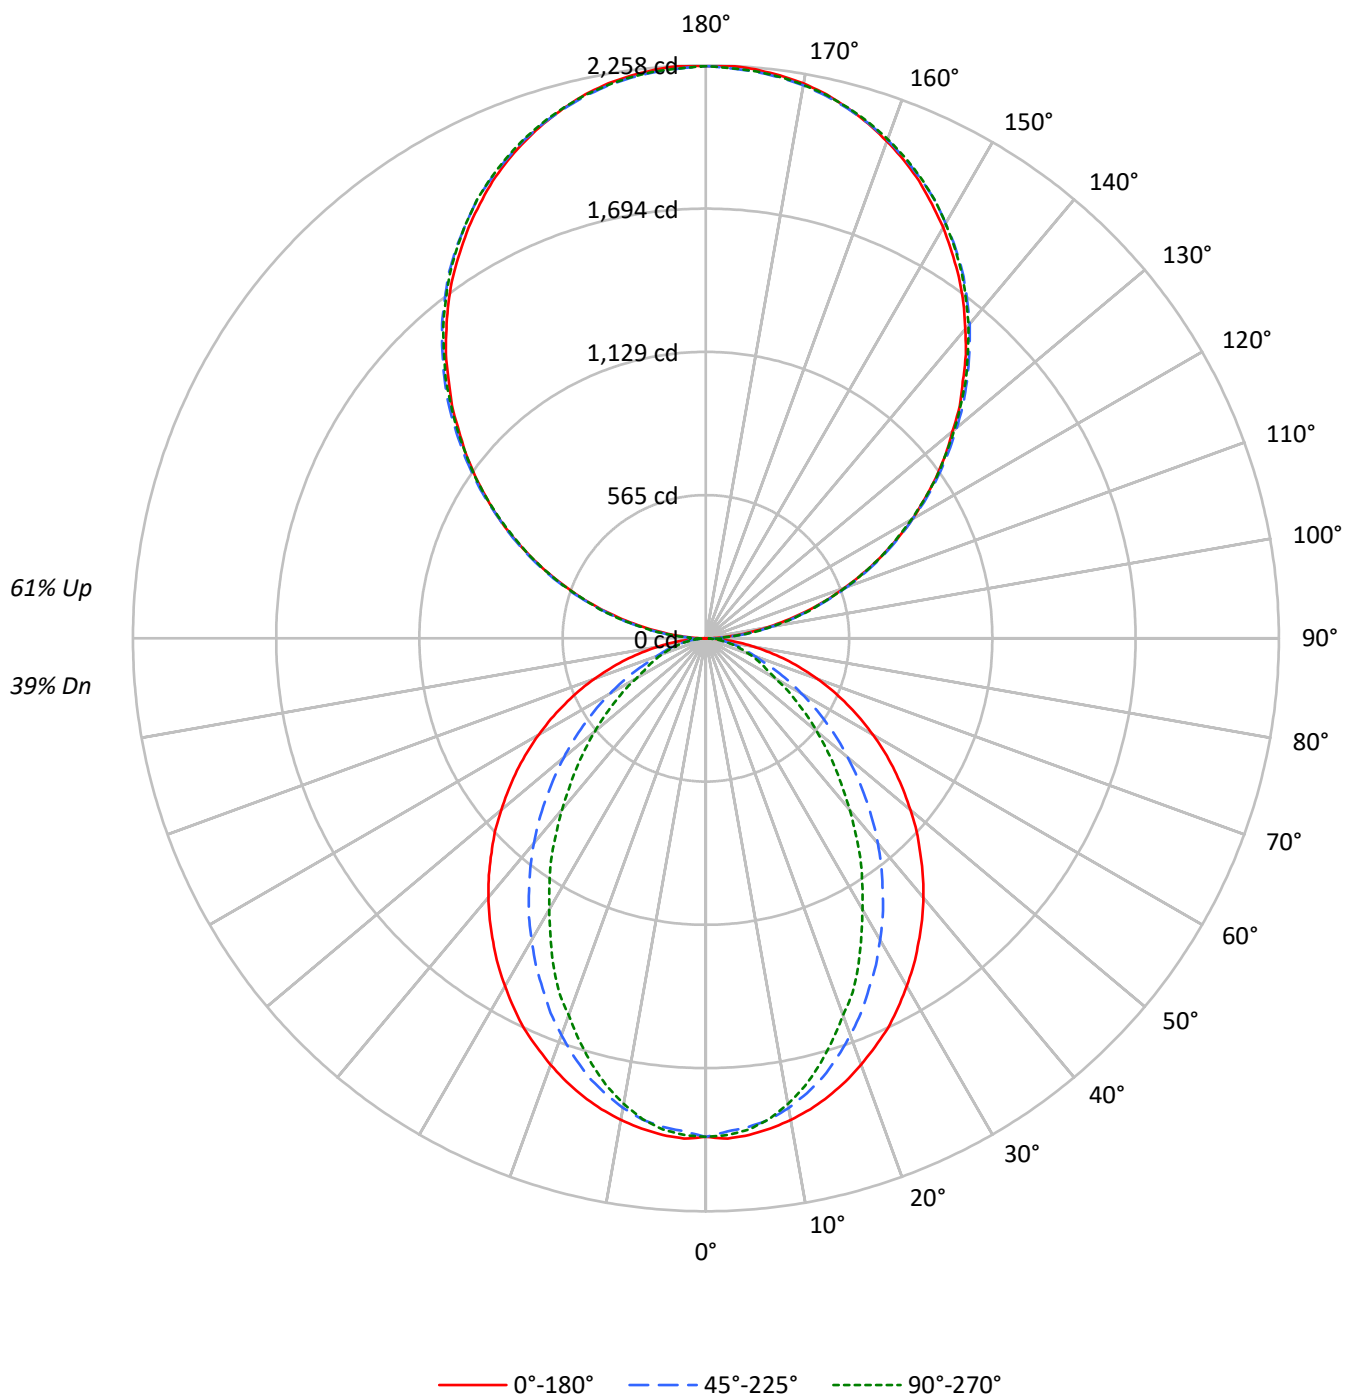

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	51	41	40	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	66	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	24	22
6	62	51	43	37	56	46	40	35	39	33	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	30	35	30	26	29	25	22	22	20	18
8	53	41	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2296	2296	2296
5°	2299	2258	2273
10°	2275	2212	2198
15°	2242	2138	2083
20°	2199	2035	1942
25°	2155	1921	1806
30°	2097	1804	1633
35°	2040	1678	1482
40°	1981	1548	1309
45°	1914	1404	1151
50°	1843	1259	998
55°	1770	1104	850
60°	1685	942	699
65°	1587	778	628
70°	1468	624	567
75°	1319	547	514
80°	1103	454	442
85°	749	295	326

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2235 cd/sqm

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.8
10°-20°	505.4	4.9
20°-30°	709.6	6.9
30°-40°	773.5	7.5
40°-50°	710.9	6.9
50°-60°	558.3	5.4
60°-70°	363.4	3.5
70°-80°	187.1	1.8
80°-90°	54.2	0.5
90°-100°	139.5	1.3
100°-110°	443.3	4.3
110°-120°	758.7	7.3
120°-130°	997.8	9.6
130°-140°	1120.0	10.8
140°-150°	1098.2	10.6
150°-160°	921.3	8.9
160°-170°	611.0	5.9
170°-180°	213.5	2.1
0°-30°	1399.1	13.5
0°-40°	2172.6	21.0
0°-60°	3441.9	33.3
0°-90°	4046.5	39.1
90°-120°	1341.5	13.0
90°-150°	4557.5	44.0
90°-180°	6303.0	60.9
0°-180°	10349.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	2	24	67	62	65	10
95°	99	118	122	122	118	110
105°	409	415	419	422	422	432
115°	761	772	769	767	761	753
125°	1107	1124	1119	1113	1111	990
135°	1432	1453	1458	1455	1450	1107
145°	1739	1752	1763	1765	1758	1086
155°	1988	1994	2000	2009	2003	915
165°	2163	2161	2161	2175	2165	610
175°	2251	2245	2241	2255	2243	214
180°	2255	2255	2255	2255	2255	

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	2.1	24.5	66.6	62.5	64.6
92.5°	42.1	57.1	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.2	182.8	190.4	190.4	190.4
100°	241.3	257.0	262.4	262.4	260.4
102.5°	321.5	333.1	340.6	342.6	340.6
105°	409.2	414.6	418.7	422.2	422.2
107.5°	496.2	504.4	504.4	505.7	496.2
110°	580.5	591.4	591.4	591.4	586.0

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	671.6	683.2	681.1	675.7	671.6
115°	761.4	772.2	768.8	766.8	761.4
117.5°	850.4	865.4	855.9	850.4	844.9
120°	940.2	955.1	940.2	940.2	934.0
122.5°	1021.7	1040.8	1031.3	1025.8	1021.7
125°	1107.4	1124.3	1119.0	1112.8	1110.8
127.5°	1191.0	1212.0	1204.6	1196.4	1191.0
130°	1269.2	1293.6	1290.2	1286.1	1278.7
132.5°	1356.8	1375.9	1377.2	1367.7	1362.3
135°	1432.3	1453.3	1457.5	1455.4	1450.0
137.5°	1516.6	1533.6	1537.0	1535.6	1527.5
140°	1590.7	1607.7	1617.2	1617.2	1609.7
142.5°	1666.8	1683.8	1689.2	1691.3	1683.8
145°	1738.9	1752.5	1763.3	1765.4	1757.9
147.5°	1803.5	1820.4	1828.6	1832.0	1824.6
150°	1870.1	1881.7	1889.1	1895.2	1889.1
152.5°	1929.2	1940.8	1950.3	1957.8	1950.3
155°	1988.4	1993.8	1999.9	2009.4	2003.3
157.5°	2039.3	2043.4	2046.8	2060.4	2050.9
160°	2084.9	2089.0	2091.0	2102.5	2094.4
162.5°	2127.0	2127.0	2129.1	2142.0	2132.5
165°	2163.1	2161.0	2161.0	2174.6	2165.1
167.5°	2195.7	2189.6	2189.6	2203.1	2193.6
170°	2220.2	2214.7	2212.7	2226.3	2214.7
172.5°	2237.1	2231.7	2229.7	2243.3	2231.7
175°	2250.7	2245.3	2241.2	2254.9	2243.3
177.5°	2258.2	2252.8	2248.7	2260.3	2248.7
180°	2254.9	2254.9	2254.9	2254.9	2254.9

TEST NUMBER: P913970

CATALOG NUMBER: DFN2DIP-PN3F0-060D090US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.88	9.63	9.93	10.68	12.10	4.85	5.60	5.90	6.65	8.07
	3H	10.55	11.22	11.61	12.28	13.72	6.03	6.69	7.09	7.76	9.20
	4H	11.15	11.78	12.22	12.85	14.29	6.47	7.10	7.54	8.16	9.61
	6H	11.56	12.15	12.64	13.21	14.67	6.78	7.36	7.86	8.43	9.89
	8H	11.68	12.24	12.77	13.32	14.77	6.87	7.42	7.95	8.50	9.96
	12H	11.74	12.27	12.83	13.34	14.82	6.90	7.43	7.99	8.51	9.98
4H	2H	8.89	9.52	9.97	10.59	12.03	5.43	6.07	6.51	7.13	8.57
	3H	10.70	11.23	11.79	12.32	13.78	6.77	7.29	7.85	8.38	9.84
	4H	11.39	11.87	12.48	12.95	14.43	7.31	7.79	8.40	8.87	10.35
	6H	11.89	12.31	12.99	13.41	14.89	7.72	8.13	8.82	9.23	10.71
	8H	12.06	12.45	13.16	13.55	15.04	7.84	8.23	8.94	9.32	10.81
	12H	12.15	12.50	13.27	13.61	15.10	7.90	8.25	9.01	9.36	10.85
8H	4H	11.35	11.74	12.45	12.83	14.32	7.58	7.96	8.68	9.06	10.55
	6H	11.91	12.22	13.03	13.36	14.85	8.08	8.40	9.21	9.54	11.03
	8H	12.12	12.40	13.24	13.52	15.02	8.27	8.55	9.40	9.67	11.18
	12H	12.25	12.49	13.38	13.61	15.15	8.38	8.63	9.51	9.74	11.29
12H	4H	11.30	11.65	12.41	12.76	14.25	7.58	7.93	8.69	9.04	10.53
	6H	11.88	12.16	13.01	13.28	14.79	8.13	8.41	9.26	9.53	11.04
	8H	12.09	12.34	13.22	13.45	15.00	8.33	8.58	9.46	9.69	11.24