

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906056

Luminaire Tested: DFN2DIP-PN4F0-090D050US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906056
REPORT IS A COMBINATION OF REPORTS P899637 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-090D050US835-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13335.0 lumens
Efficiency: N/A
Efficacy: 105.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 126
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFLL

Luminous Intensity Polar Plot

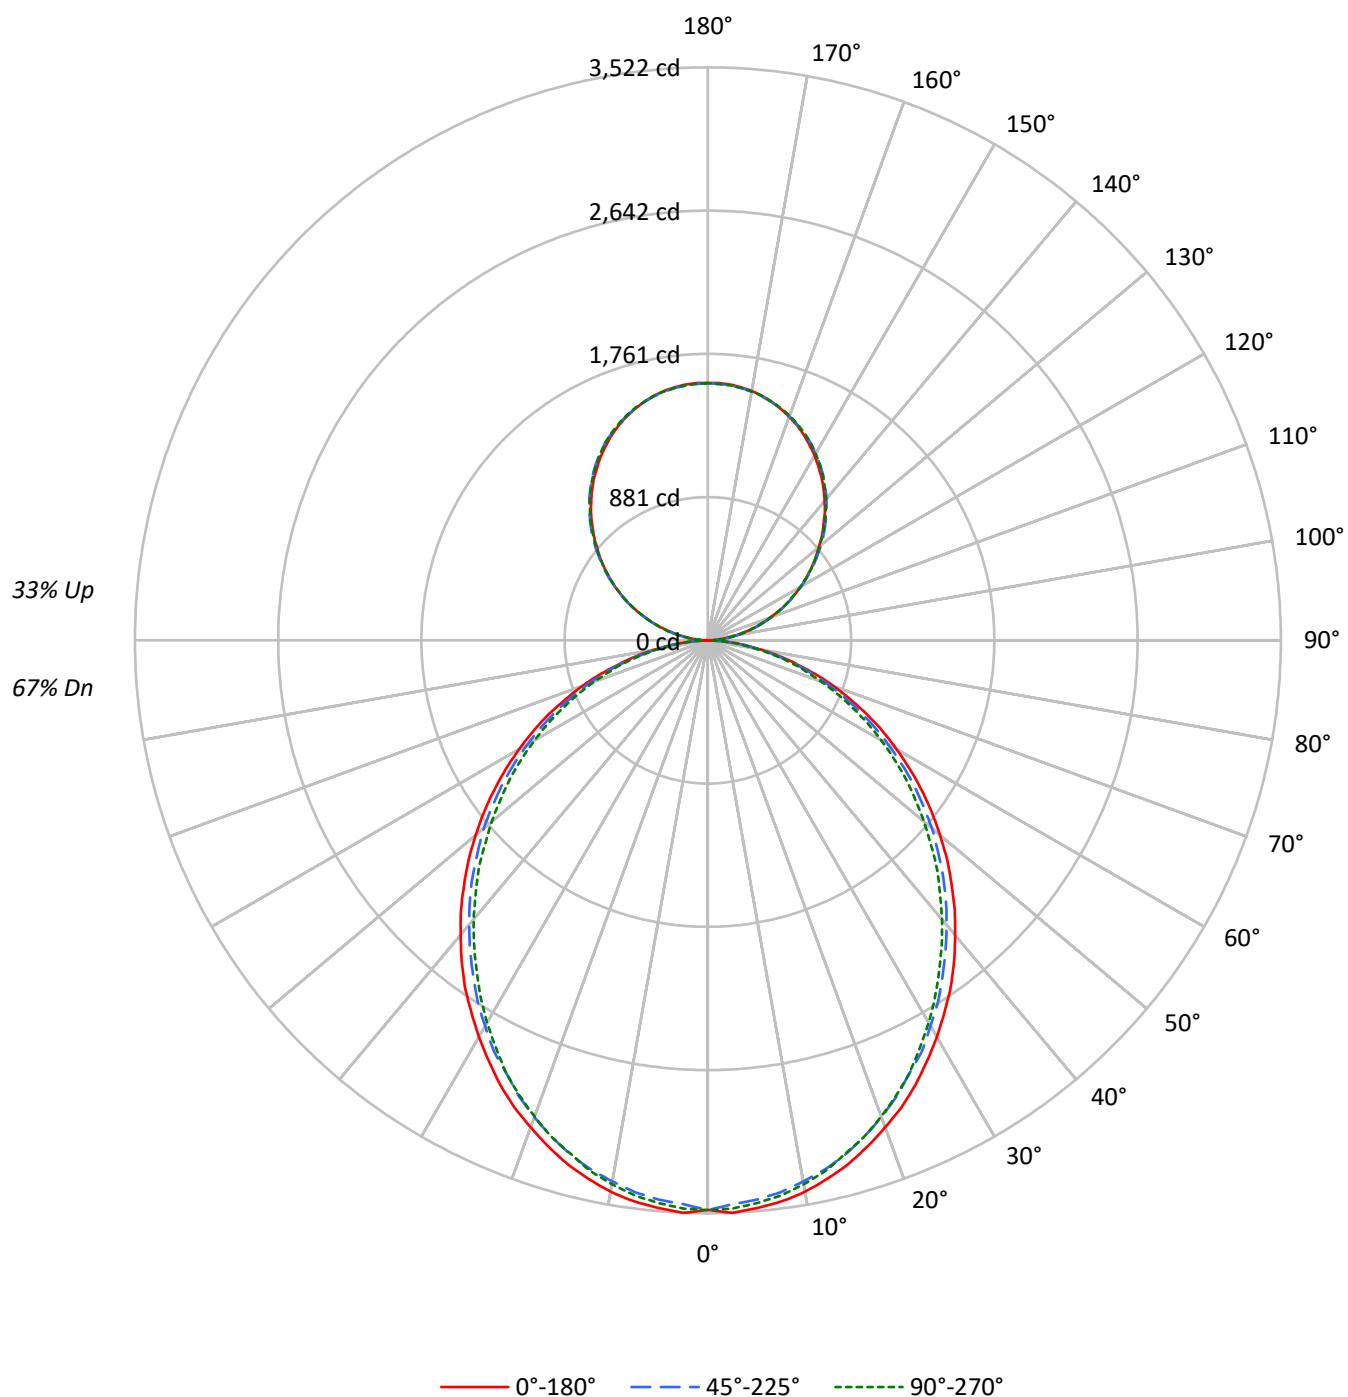

TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	72	72	72
1	102	97	93	90	96	92	88	85	81	79	76	72	70	68	63	62	61
2	93	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	73	63	55	50	56	50	45	50	45	41	44	41	37
5	71	59	51	45	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	32	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2556	2556	2556
5°	2560	2521	2538
10°	2540	2487	2504
15°	2502	2447	2451
20°	2452	2390	2396
25°	2402	2323	2333
30°	2339	2260	2253
35°	2279	2185	2168
40°	2206	2110	2087
45°	2132	2035	2005
50°	2053	1956	1909
55°	1969	1865	1821
60°	1874	1756	1720
65°	1771	1644	1601
70°	1639	1507	1473
75°	1457	1344	1356
80°	1238	1135	1131
85°	895	775	757

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2132 cd/sqm

TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	329.6	2.5
10°-20°	927.4	7.0
20°-30°	1362.9	10.2
30°-40°	1582.9	11.9
40°-50°	1580.9	11.9
50°-60°	1378.5	10.3
60°-70°	1019.0	7.6
70°-80°	576.6	4.3
80°-90°	156.7	1.2
90°-100°	97.8	0.7
100°-110°	310.9	2.3
110°-120°	532.1	4.0
120°-130°	699.7	5.2
130°-140°	785.4	5.9
140°-150°	770.2	5.8
150°-160°	646.1	4.8
160°-170°	428.5	3.2
170°-180°	149.8	1.1
0°-30°	2619.9	19.6
0°-40°	4202.8	31.5
0°-60°	7162.3	53.7
0°-90°	8914.5	66.9
90°-120°	940.8	7.1
90°-150°	3196.2	24.0
90°-180°	4421.0	33.2
0°-180°	13335.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3502	3502	3502	3502	3502	
5°	3502	3489	3452	3478	3472	332
15°	3334	3314	3270	3283	3266	939
25°	3017	2990	2933	2940	2933	1388
35°	2603	2570	2516	2495	2478	1626
45°	2118	2095	2044	2007	1994	1635
55°	1603	1583	1542	1502	1485	1433
65°	1081	1061	1027	997	980	1069
75°	566	559	542	522	529	604
85°	138	135	132	121	118	154
90°	1	17	47	44	45	13
95°	70	83	85	85	83	77
105°	287	291	294	296	296	303
115°	534	542	539	538	534	528
125°	777	788	785	780	779	694
135°	1004	1019	1022	1021	1017	776
145°	1220	1229	1237	1238	1233	762
155°	1394	1398	1402	1409	1405	642
165°	1517	1516	1516	1525	1518	428
175°	1578	1575	1572	1581	1573	150
180°	1581	1581	1581	1581	1581	

TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3501.9	3501.9	3501.9	3501.9	3501.9
2.5°	3522.3	3505.5	3468.4	3501.9	3495.5
5°	3501.9	3488.7	3451.6	3478.4	3471.9
7.5°	3478.4	3458.4	3421.2	3448.4	3441.6
10°	3441.6	3418.0	3377.6	3404.4	3394.4
12.5°	3390.8	3370.8	3330.5	3347.2	3340.5
15°	3333.7	3313.7	3269.7	3283.3	3266.5
17.5°	3262.9	3242.9	3199.0	3215.8	3199.0
20°	3185.4	3165.4	3118.2	3128.2	3115.0
22.5°	3108.2	3077.9	3033.9	3033.9	3027.1
25°	3017.1	2990.3	2933.2	2939.6	2933.2
27.5°	2916.0	2892.4	2848.9	2838.9	2822.1
30°	2815.3	2788.1	2737.7	2727.7	2714.2
32.5°	2707.4	2687.4	2633.4	2613.1	2599.5
35°	2603.1	2569.5	2515.5	2495.2	2478.4
37.5°	2485.2	2454.8	2400.8	2377.3	2360.5
40°	2364.0	2336.9	2282.9	2252.9	2239.4
42.5°	2246.1	2219.0	2165.4	2131.5	2111.5
45°	2118.2	2094.7	2043.9	2007.1	1993.6
47.5°	1993.6	1970.0	1916.0	1878.9	1858.9
50°	1862.1	1845.3	1798.1	1751.0	1734.2
52.5°	1734.2	1710.6	1667.0	1629.9	1606.3
55°	1603.1	1582.7	1542.3	1502.0	1485.2
57.5°	1471.6	1454.8	1410.9	1370.5	1356.9
60°	1340.1	1326.9	1279.7	1242.6	1232.6
62.5°	1212.2	1188.6	1155.0	1121.5	1107.9
65°	1081.1	1060.7	1027.1	996.8	980.0
67.5°	946.4	929.3	899.2	875.7	862.1
70°	821.7	808.1	777.8	754.2	741.0
72.5°	693.8	680.2	663.4	639.9	629.9
75°	565.6	559.1	542.0	522.0	528.8
77.5°	451.2	437.7	430.9	420.9	410.9
80°	336.9	333.3	326.5	316.5	309.8
82.5°	229.0	229.0	225.8	212.2	212.2
85°	137.9	134.7	131.5	121.1	117.9
87.5°	60.7	53.9	47.2	37.2	33.6
90°	1.4	17.2	46.7	43.9	45.3
92.5°	29.6	40.0	41.5	42.9	42.9
95°	69.6	83.0	85.3	85.3	83.0
97.5°	115.8	128.2	133.5	133.5	133.5
100°	169.2	180.2	184.0	184.0	182.6
102.5°	225.5	233.6	238.8	240.3	238.8
105°	287.0	290.8	293.7	296.0	296.0
107.5°	348.0	353.7	353.7	354.7	348.0
110°	407.1	414.8	414.8	414.8	410.9



TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	471.0	479.1	477.7	473.9	471.0
115°	533.9	541.6	539.2	537.8	533.9
117.5°	596.4	606.9	600.2	596.4	592.6
120°	659.3	669.8	659.3	659.3	655.0
122.5°	716.5	729.9	723.2	719.4	716.5
125°	776.6	788.5	784.7	780.4	779.0
127.5°	835.2	850.0	844.8	839.0	835.2
130°	890.1	907.2	904.8	902.0	896.7
132.5°	951.6	964.9	965.9	959.2	955.4
135°	1004.5	1019.2	1022.1	1020.7	1016.9
137.5°	1063.6	1075.5	1077.9	1076.9	1071.2
140°	1115.5	1127.5	1134.1	1134.1	1128.9
142.5°	1168.9	1180.9	1184.7	1186.1	1180.9
145°	1219.5	1229.0	1236.6	1238.1	1232.8
147.5°	1264.8	1276.7	1282.4	1284.8	1279.5
150°	1311.5	1319.6	1324.8	1329.1	1324.8
152.5°	1353.0	1361.1	1367.7	1373.0	1367.7
155°	1394.4	1398.2	1402.5	1409.2	1404.9
157.5°	1430.2	1433.0	1435.4	1445.0	1438.3
160°	1462.1	1465.0	1466.4	1474.5	1468.8
162.5°	1491.7	1491.7	1493.1	1502.2	1495.5
165°	1517.0	1515.5	1515.5	1525.1	1518.4
167.5°	1539.8	1535.5	1535.5	1545.1	1538.4
170°	1557.0	1553.2	1551.8	1561.3	1553.2
172.5°	1568.9	1565.1	1563.7	1573.2	1565.1
175°	1578.5	1574.6	1571.8	1581.3	1573.2
177.5°	1583.7	1579.9	1577.0	1585.1	1577.0
180°	1581.3	1581.3	1581.3	1581.3	1581.3

TEST NUMBER: P906056

CATALOG NUMBER: DFN2DIP-PN4F0-090D050US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.96	13.00	12.76	13.82	14.83	11.52	12.56	12.32	13.38	14.39
	3H	13.64	14.57	14.45	15.40	16.44	13.16	14.09	13.97	14.92	15.95
	4H	14.24	15.12	15.07	15.95	17.00	13.75	14.63	14.58	15.47	16.52
	6H	14.65	15.46	15.49	16.31	17.37	14.16	14.97	15.00	15.81	16.88
	8H	14.76	15.53	15.61	16.40	17.46	14.27	15.04	15.12	15.90	16.97
	12H	14.82	15.55	15.67	16.41	17.50	14.32	15.05	15.17	15.91	17.00
4H	2H	12.45	13.33	13.28	14.16	15.21	12.10	12.97	12.93	13.81	14.86
	3H	14.33	15.07	15.18	15.94	17.00	13.93	14.66	14.77	15.53	16.60
	4H	15.06	15.72	15.91	16.59	17.68	14.64	15.31	15.49	16.18	17.27
	6H	15.58	16.16	16.46	17.05	18.15	15.16	15.74	16.03	16.63	17.72
	8H	15.74	16.28	16.61	17.17	18.27	15.31	15.85	16.19	16.74	17.85
	12H	15.82	16.31	16.72	17.22	18.33	15.38	15.87	16.28	16.78	17.89
8H	4H	15.27	15.81	16.14	16.69	17.80	14.90	15.44	15.77	16.32	17.43
	6H	15.91	16.36	16.81	17.29	18.39	15.53	15.98	16.44	16.91	18.02
	8H	16.13	16.53	17.05	17.45	18.58	15.75	16.15	16.66	17.07	18.19
	12H	16.27	16.62	17.19	17.54	18.71	15.87	16.22	16.79	17.14	18.31
12H	4H	15.26	15.75	16.16	16.65	17.77	14.90	15.39	15.79	16.29	17.41
	6H	15.94	16.34	16.85	17.26	18.38	15.57	15.97	16.49	16.89	18.02
	8H	16.19	16.54	17.11	17.46	18.63	15.82	16.17	16.74	17.08	18.26

END OF REPORT