

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906104

Luminaire Tested: DFN2DIP-PN4F0-100D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906104
REPORT IS A COMBINATION OF REPORTS P899693 AND P896497
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-PN4F0-100D080US835-FLLFLL
Description: 4 foot, Pentagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16980.0 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.74' x L: 3.94' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 158.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFLL

Luminous Intensity Polar Plot

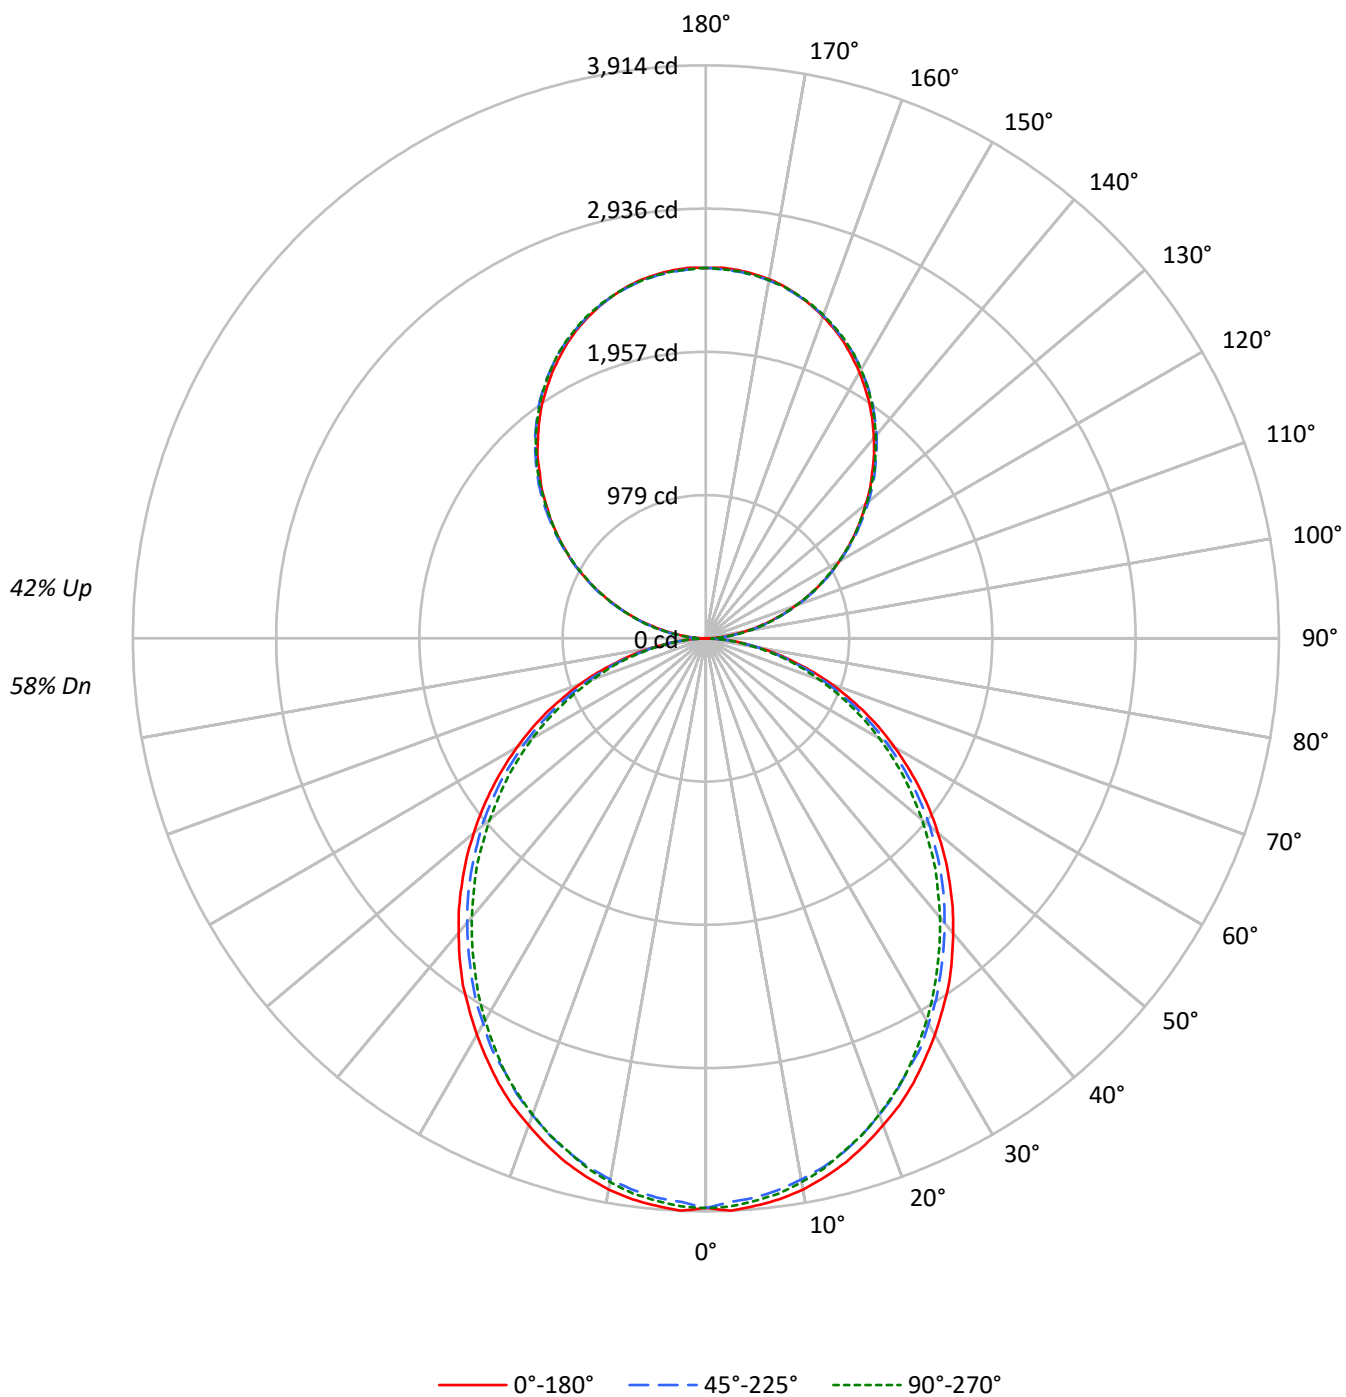

TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2840	2840	2840
5°	2845	2801	2820
10°	2822	2764	2782
15°	2780	2719	2723
20°	2724	2656	2663
25°	2668	2581	2593
30°	2599	2511	2503
35°	2532	2428	2409
40°	2451	2345	2319
45°	2369	2261	2227
50°	2281	2173	2121
55°	2187	2072	2023
60°	2082	1951	1911
65°	1968	1827	1779
70°	1821	1675	1637
75°	1619	1493	1507
80°	1375	1262	1257
85°	994	861	841

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2369 cd/sqm

TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.2	2.2
10°-20°	1030.4	6.1
20°-30°	1514.3	8.9
30°-40°	1758.8	10.4
40°-50°	1756.6	10.3
50°-60°	1531.7	9.0
60°-70°	1132.3	6.7
70°-80°	640.6	3.8
80°-90°	176.3	1.0
90°-100°	156.6	0.9
100°-110°	497.5	2.9
110°-120°	851.3	5.0
120°-130°	1119.6	6.6
130°-140°	1256.7	7.4
140°-150°	1232.3	7.3
150°-160°	1033.7	6.1
160°-170°	685.6	4.0
170°-180°	239.6	1.4
0°-30°	2911.0	17.1
0°-40°	4669.7	27.5
0°-60°	7958.0	46.9
0°-90°	9907.2	58.3
90°-120°	1505.3	8.9
90°-150°	5113.9	30.1
90°-180°	7073.0	41.7
0°-180°	16980.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3891	3891	3891	3891	3891	
5°	3891	3876	3835	3865	3858	369
15°	3704	3682	3633	3648	3630	1043
25°	3352	3323	3259	3266	3259	1543
35°	2892	2855	2795	2772	2754	1806
45°	2354	2327	2271	2230	2215	1816
55°	1781	1759	1714	1669	1650	1592
65°	1201	1179	1141	1108	1089	1188
75°	628	621	602	580	588	671
85°	153	150	146	135	131	171
90°	2	28	75	70	72	16
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3891.1	3891.1	3891.1	3891.1	3891.1
2.5°	3913.7	3895.0	3853.7	3891.1	3883.9
5°	3891.1	3876.4	3835.1	3864.9	3857.7
7.5°	3864.9	3842.6	3801.3	3831.5	3824.0
10°	3824.0	3797.8	3752.9	3782.7	3771.6
12.5°	3767.6	3745.4	3700.5	3719.2	3711.6
15°	3704.1	3681.9	3633.0	3648.1	3629.5
17.5°	3625.5	3603.3	3554.4	3573.1	3554.4
20°	3539.3	3517.1	3464.7	3475.8	3461.1
22.5°	3453.6	3419.9	3371.0	3371.0	3363.5
25°	3352.4	3322.6	3259.1	3266.2	3259.1
27.5°	3240.0	3213.8	3165.4	3154.3	3135.6
30°	3128.1	3097.9	3041.9	3030.8	3015.7
32.5°	3008.2	2986.0	2926.0	2903.4	2888.3
35°	2892.3	2855.0	2795.0	2772.4	2753.7
37.5°	2761.3	2727.5	2667.6	2641.4	2622.7
40°	2626.7	2596.5	2536.6	2503.3	2488.2
42.5°	2495.7	2465.5	2406.0	2368.3	2346.1
45°	2353.6	2327.4	2271.0	2230.1	2215.1
47.5°	2215.1	2188.9	2128.9	2087.6	2065.4
50°	2069.0	2050.3	1997.9	1945.5	1926.9
52.5°	1926.9	1900.7	1852.2	1811.0	1784.8
55°	1781.2	1758.6	1713.7	1668.8	1650.2
57.5°	1635.1	1616.4	1567.6	1522.8	1507.7
60°	1489.0	1474.3	1421.9	1380.6	1369.5
62.5°	1346.9	1320.7	1283.4	1246.1	1231.0
65°	1201.2	1178.6	1141.3	1107.5	1088.9
67.5°	1051.6	1032.5	999.2	973.0	957.9
70°	913.0	897.9	864.2	838.0	823.3
72.5°	770.9	755.8	737.2	711.0	699.8
75°	628.4	621.3	602.2	580.0	587.5
77.5°	501.4	486.3	478.7	467.6	456.5
80°	374.3	370.4	362.8	351.7	344.2
82.5°	254.5	254.5	250.9	235.8	235.8
85°	153.2	149.7	146.1	134.6	131.0
87.5°	67.5	59.9	52.4	41.3	37.3
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5



TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P906104

CATALOG NUMBER: DFN2DIP-PN4F0-100D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.64	12.58	12.52	13.49	14.63	11.20	12.14	12.08	13.05	14.19
	3H	13.31	14.16	14.20	15.07	16.24	12.83	13.67	13.72	14.58	15.76
	4H	13.90	14.70	14.81	15.62	16.80	13.42	14.22	14.33	15.13	16.32
	6H	14.31	15.05	15.23	15.97	17.17	13.82	14.56	14.74	15.48	16.67
	8H	14.42	15.12	15.35	16.06	17.26	13.93	14.63	14.85	15.57	16.76
	12H	14.47	15.14	15.41	16.07	17.29	13.97	14.64	14.91	15.57	16.79
4H	2H	12.11	12.91	13.03	13.83	15.01	11.76	12.56	12.68	13.48	14.66
	3H	13.99	14.66	14.91	15.60	16.80	13.59	14.25	14.51	15.20	16.40
	4H	14.71	15.32	15.64	16.26	17.48	14.29	14.90	15.23	15.84	17.07
	6H	15.23	15.76	16.18	16.72	17.95	14.81	15.33	15.76	16.30	17.52
	8H	15.38	15.88	16.34	16.84	18.07	14.96	15.45	15.91	16.41	17.64
	12H	15.46	15.91	16.43	16.88	18.13	15.02	15.47	15.99	16.44	17.69
8H	4H	14.91	15.40	15.86	16.36	17.60	14.54	15.03	15.49	15.99	17.23
	6H	15.55	15.96	16.53	16.96	18.19	15.17	15.58	16.15	16.58	17.82
	8H	15.77	16.13	16.76	17.12	18.38	15.39	15.75	16.38	16.74	17.99
	12H	15.91	16.23	16.90	17.21	18.51	15.51	15.83	16.50	16.81	18.11
12H	4H	14.90	15.34	15.87	16.32	17.56	14.54	14.98	15.51	15.96	17.20
	6H	15.58	15.94	16.57	16.93	18.19	15.22	15.58	16.20	16.57	17.82
	8H	15.83	16.15	16.82	17.13	18.43	15.46	15.77	16.45	16.76	18.06

END OF REPORT