

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906339

Luminaire Tested: DFN2DIP-SQ2F0-080D080US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906339
REPORT IS A COMBINATION OF REPORTS P901362 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D080US835-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14720.0 lumens
Efficiency: N/A
Efficacy: 102.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLLONL

Luminous Intensity Polar Plot

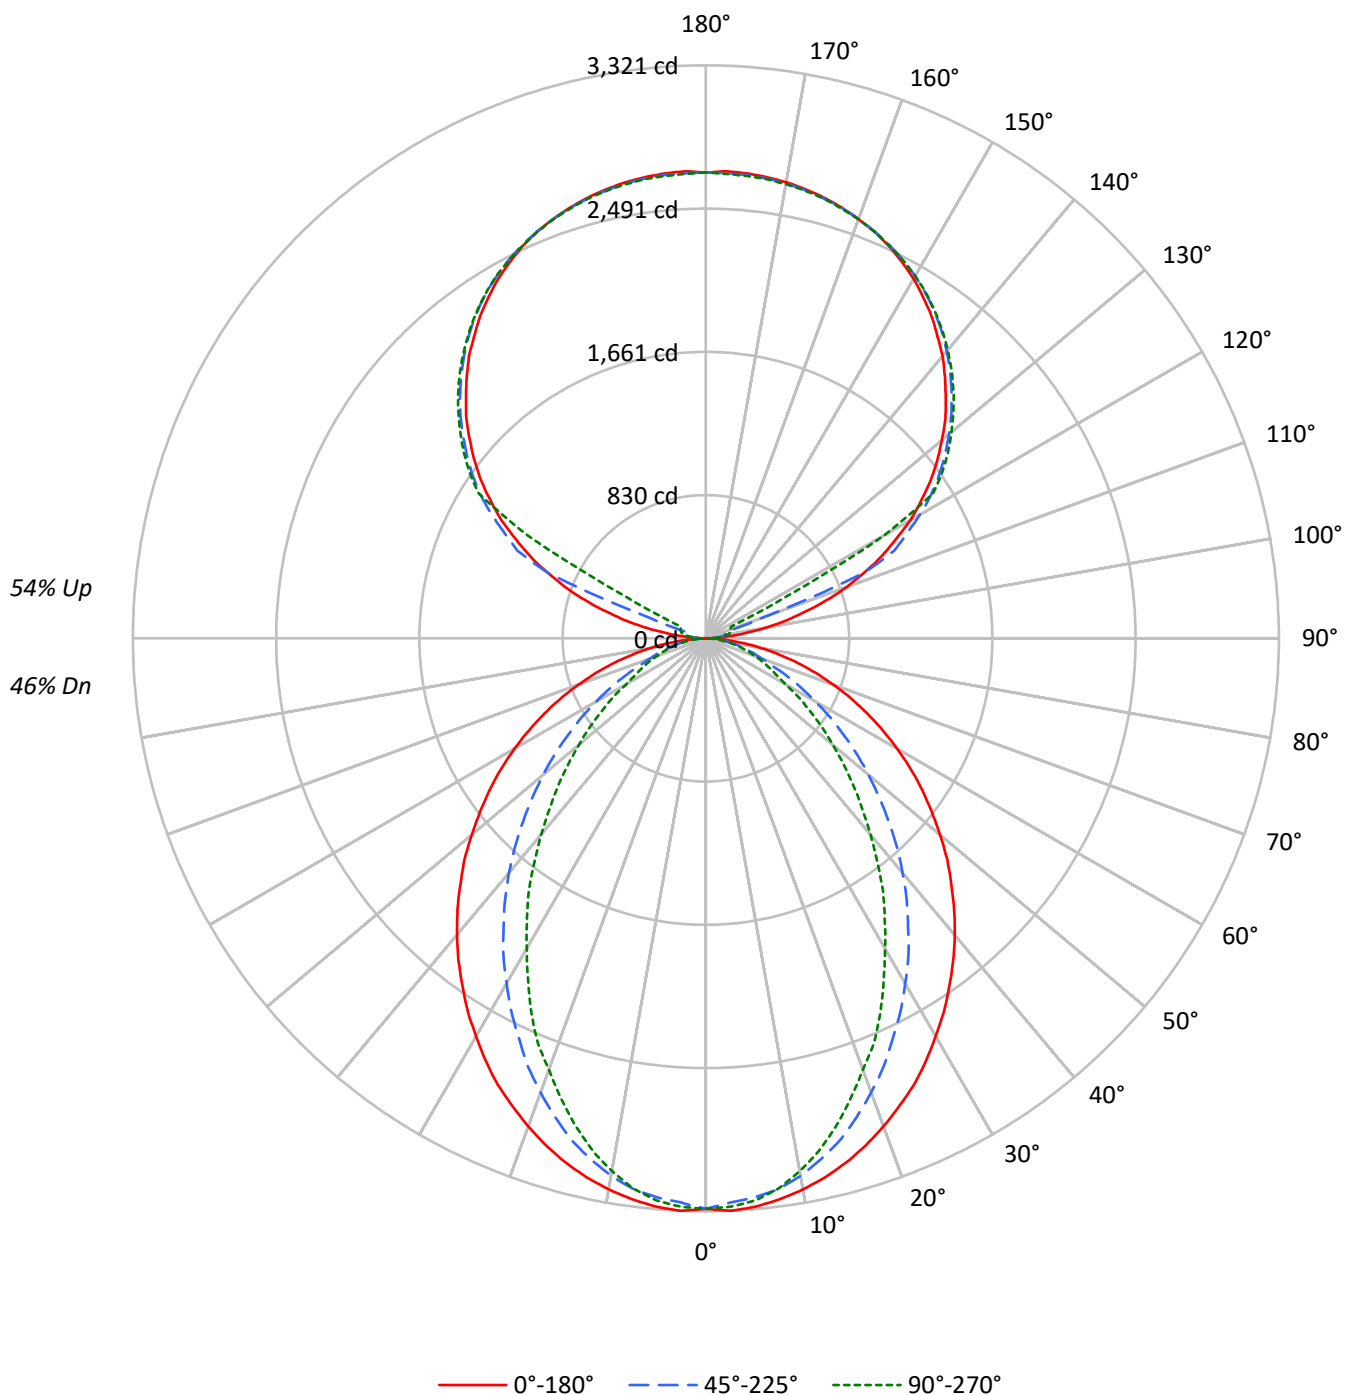

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	7270	7270	7270
5°	7269	7139	7191
10°	7185	6983	6947
15°	7073	6737	6576
20°	6930	6405	6124
25°	6783	6034	5688
30°	6590	5656	5138
35°	6400	5251	4656
40°	6206	4834	4104
45°	5983	4373	3605
50°	5750	3910	3118
55°	5506	3416	2651
60°	5223	2902	2173
65°	4897	2382	1944
70°	4501	1898	1745
75°	4002	1642	1567
80°	3286	1334	1327
85°	2139	828	945

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5983 cd/sqm

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.9	2.1
10°-20°	850.7	5.8
20°-30°	1194.3	8.1
30°-40°	1301.9	8.8
40°-50°	1196.6	8.1
50°-60°	939.7	6.4
60°-70°	611.7	4.2
70°-80°	314.9	2.1
80°-90°	85.1	0.6
90°-100°	89.0	0.6
100°-110°	331.9	2.3
110°-120°	880.2	6.0
120°-130°	1459.9	9.9
130°-140°	1550.7	10.5
140°-150°	1441.2	9.8
150°-160°	1158.7	7.9
160°-170°	746.6	5.1
170°-180°	257.0	1.7
0°-30°	2354.9	16.0
0°-40°	3656.8	24.8
0°-60°	5793.1	39.4
0°-90°	6804.8	46.2
90°-120°	1301.1	8.8
90°-150°	5752.9	39.1
90°-180°	7915.0	53.8
0°-180°	14720.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3306	3306	3306	3306	3306	
5°	3306	3292	3252	3279	3270	314
15°	3145	3112	3010	2953	2924	886
25°	2855	2759	2561	2439	2394	1313
35°	2460	2307	2044	1855	1789	1540
45°	2011	1810	1496	1284	1212	1553
55°	1529	1296	972	793	736	1366
65°	1032	790	521	419	410	1024
75°	550	341	239	218	216	582
85°	129	66	57	57	57	148
90°	2	23	39	49	53	14
95°	127	62	76	86	84	150
105°	594	653	119	141	148	635
115°	1123	1156	1205	301	160	1106
125°	1588	1614	1651	1664	1670	1416
135°	1965	1997	2014	2034	2030	1518
145°	2280	2278	2311	2325	2315	1426
155°	2510	2493	2516	2528	2512	1157
165°	2645	2634	2639	2653	2639	747
175°	2706	2692	2696	2710	2690	258
180°	2700	2700	2700	2700	2700	

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3306.4	3306.4	3306.4	3306.4	3306.4
2.5°	3321.3	3306.4	3273.4	3303.5	3297.5
5°	3306.4	3291.5	3252.4	3279.4	3270.5
7.5°	3279.4	3261.6	3219.7	3231.5	3216.5
10°	3243.5	3222.6	3162.9	3153.7	3135.9
12.5°	3198.8	3171.8	3090.8	3073.0	3040.0
15°	3144.8	3111.8	3010.2	2953.4	2923.5
17.5°	3081.9	3034.0	2908.3	2842.6	2794.6
20°	3010.2	2950.2	2800.7	2726.1	2660.0
22.5°	2932.4	2863.5	2689.9	2588.3	2543.5
25°	2854.6	2758.8	2561.3	2438.8	2393.7
27.5°	2761.9	2660.0	2441.6	2301.0	2232.1
30°	2663.2	2549.2	2309.9	2157.5	2076.5
32.5°	2567.3	2429.6	2184.5	2004.8	1929.9
35°	2459.7	2307.0	2043.8	1855.3	1789.2
37.5°	2354.9	2190.2	1912.1	1705.4	1630.8
40°	2244.2	2064.8	1774.3	1561.9	1484.1
42.5°	2130.5	1939.1	1636.8	1415.3	1340.6
45°	2010.8	1810.2	1496.2	1283.5	1211.8
47.5°	1897.2	1684.8	1361.6	1148.9	1083.2
50°	1771.4	1559.1	1229.9	1023.2	960.6
52.5°	1648.6	1424.1	1104.1	906.7	849.9
55°	1528.9	1295.6	972.4	793.0	736.2
57.5°	1406.4	1167.0	855.9	688.3	640.3
60°	1280.6	1041.3	733.0	580.6	532.7
62.5°	1158.1	918.7	628.3	484.8	461.0
65°	1032.4	789.8	520.6	419.1	409.8
67.5°	912.7	670.2	419.1	367.9	359.1
70°	787.0	553.7	347.0	317.1	305.1
72.5°	667.3	445.7	290.2	266.4	260.3
75°	550.5	341.0	239.4	218.4	215.6
77.5°	434.0	242.2	188.6	176.5	170.5
80°	326.0	173.7	143.5	131.7	131.7
82.5°	227.3	116.8	98.7	92.7	92.7
85°	128.6	65.7	56.8	56.8	56.8
87.5°	47.9	23.8	23.8	21.0	21.0
90°	1.9	23.4	39.0	48.9	52.7
92.5°	48.9	41.1	46.9	50.8	52.7
95°	126.9	62.4	76.1	86.1	84.0
97.5°	228.5	68.4	99.5	105.6	107.4
100°	345.9	78.2	111.4	126.9	130.8
102.5°	474.7	470.9	115.3	136.6	142.7
105°	593.9	652.6	119.2	140.6	148.5
107.5°	732.6	781.3	123.2	144.5	152.4
110°	865.6	906.4	342.0	146.6	154.3

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	990.6	1025.6	992.5	150.3	156.4
115°	1123.3	1156.5	1205.4	300.9	160.3
117.5°	1238.6	1277.6	1311.0	1031.4	519.7
120°	1367.6	1396.8	1432.1	1455.5	1191.7
122.5°	1476.8	1508.2	1547.4	1559.0	1561.1
125°	1588.2	1613.7	1650.8	1664.5	1670.3
127.5°	1689.8	1717.2	1746.7	1766.1	1768.0
130°	1785.6	1816.9	1838.3	1859.9	1858.0
132.5°	1883.3	1908.8	1930.2	1947.8	1945.9
135°	1965.4	1996.7	2014.1	2033.9	2029.9
137.5°	2051.3	2074.7	2094.4	2113.9	2108.1
140°	2135.2	2151.0	2172.4	2190.0	2180.2
142.5°	2205.8	2219.4	2244.7	2260.3	2250.5
145°	2280.0	2277.9	2311.1	2324.8	2315.0
147.5°	2344.3	2338.5	2371.6	2381.4	2373.7
150°	2406.9	2393.2	2424.5	2436.1	2426.4
152.5°	2459.6	2444.0	2473.2	2485.1	2471.4
155°	2510.4	2493.0	2516.4	2528.0	2512.5
157.5°	2551.4	2535.9	2553.5	2567.2	2551.4
160°	2586.7	2574.9	2586.7	2598.3	2584.6
162.5°	2617.8	2606.2	2615.9	2629.6	2612.0
165°	2645.2	2633.6	2639.4	2653.0	2639.4
167.5°	2666.7	2654.9	2660.9	2674.6	2657.0
170°	2684.4	2672.5	2676.5	2690.2	2672.5
172.5°	2696.0	2684.4	2688.3	2702.0	2684.4
175°	2705.7	2692.0	2696.0	2709.6	2690.2
177.5°	2709.6	2696.0	2698.0	2711.7	2694.1
180°	2699.9	2699.9	2699.9	2699.9	2699.9

TEST NUMBER: P906339

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.56	14.36	14.56	15.36	16.69	9.52	10.32	10.52	11.32	12.65
	3H	15.22	15.93	16.22	16.94	18.29	10.69	11.41	11.70	12.42	13.77
	4H	15.81	16.49	16.83	17.50	18.86	11.13	11.80	12.15	12.82	14.17
	6H	16.22	16.84	17.24	17.86	19.23	11.43	12.05	12.46	13.07	14.44
	8H	16.33	16.92	17.37	17.96	19.32	11.51	12.10	12.55	13.14	14.50
	12H	16.39	16.95	17.42	17.98	19.36	11.55	12.11	12.58	13.14	14.52
4H	2H	13.57	14.25	14.60	15.26	16.62	10.10	10.78	11.13	11.79	13.15
	3H	15.38	15.94	16.41	16.98	18.35	11.43	11.99	12.46	13.04	14.40
	4H	16.05	16.57	17.09	17.60	18.99	11.96	12.48	13.00	13.51	14.90
	6H	16.55	16.99	17.60	18.05	19.43	12.36	12.80	13.41	13.86	15.25
	8H	16.71	17.12	17.76	18.17	19.57	12.48	12.89	13.53	13.94	15.34
	12H	16.79	17.16	17.86	18.23	19.64	12.53	12.90	13.60	13.97	15.37
8H	4H	16.01	16.42	17.06	17.48	18.88	12.23	12.64	13.28	13.69	15.09
	6H	16.56	16.90	17.63	17.99	19.39	12.72	13.06	13.79	14.15	15.55
	8H	16.76	17.06	17.84	18.13	19.55	12.90	13.20	13.98	14.27	15.69
	12H	16.88	17.15	17.97	18.22	19.68	13.00	13.26	14.08	14.33	15.79
12H	4H	15.96	16.33	17.03	17.40	18.81	12.23	12.60	13.30	13.67	15.07
	6H	16.53	16.83	17.61	17.91	19.32	12.76	13.06	13.84	14.14	15.56
	8H	16.73	17.00	17.82	18.07	19.53	12.96	13.22	14.04	14.29	15.75

END OF REPORT