

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917248

Luminaire Tested: DFN2DIP-SQ2F0-080D080US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917248
REPORT IS A COMBINATION OF REPORTS P899841 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D080US930-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12229.5 lumens
Efficiency: N/A
Efficacy: 85.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFLL

Luminous Intensity Polar Plot

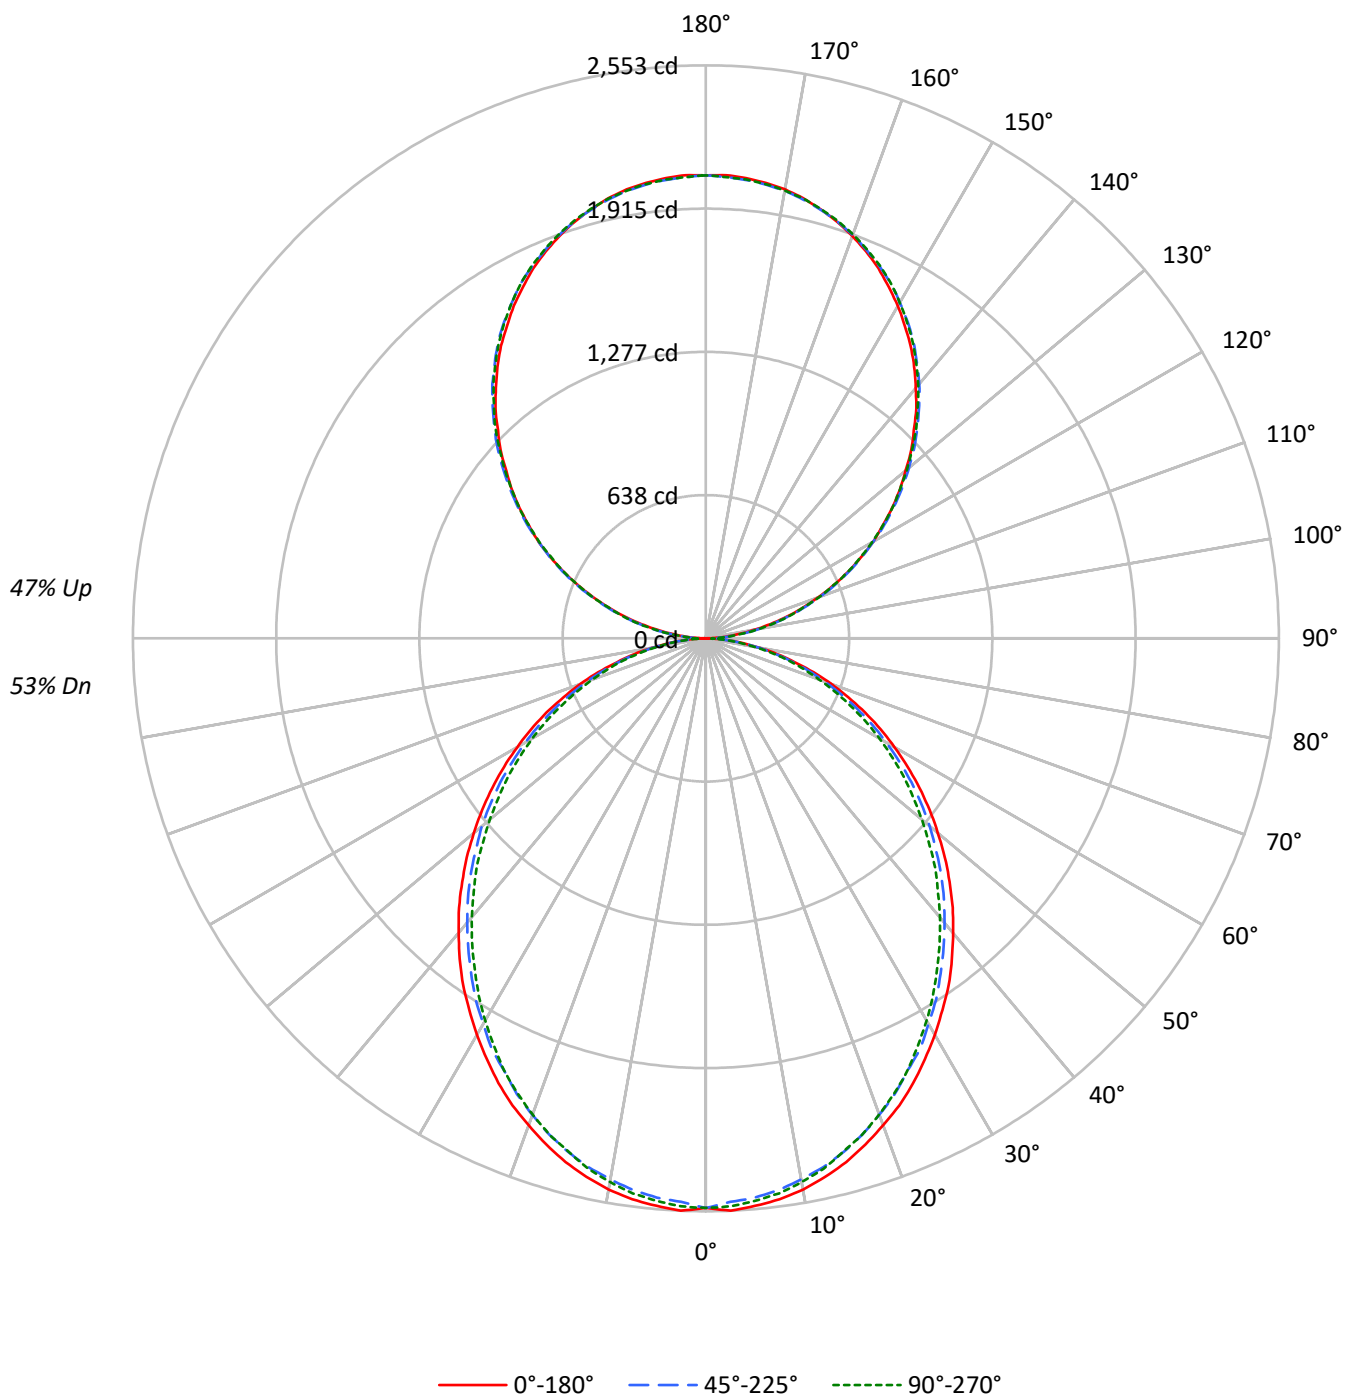

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5581	5581	5581
5°	5580	5491	5532
10°	5525	5405	5449
15°	5434	5303	5325
20°	5314	5168	5197
25°	5195	5008	5051
30°	5049	4858	4867
35°	4908	4684	4673
40°	4738	4507	4488
45°	4567	4329	4299
50°	4381	4142	4080
55°	4184	3927	3876
60°	3961	3672	3643
65°	3716	3406	3369
70°	3406	3083	3071
75°	2980	2694	2786
80°	2461	2200	2263
85°	1664	1389	1421

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4567 cd/sqm

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.9	2.0
10°-20°	672.1	5.5
20°-30°	987.7	8.1
30°-40°	1147.1	9.4
40°-50°	1145.7	9.4
50°-60°	999.0	8.2
60°-70°	738.5	6.0
70°-80°	417.8	3.4
80°-90°	116.2	0.9
90°-100°	127.6	1.0
100°-110°	405.6	3.3
110°-120°	694.1	5.7
120°-130°	912.8	7.5
130°-140°	1024.6	8.4
140°-150°	1004.7	8.2
150°-160°	842.8	6.9
160°-170°	558.9	4.6
170°-180°	195.4	1.6
0°-30°	1898.6	15.5
0°-40°	3045.8	24.9
0°-60°	5190.5	42.4
0°-90°	6463.0	52.8
90°-120°	1227.3	10.0
90°-150°	4169.4	34.1
90°-180°	5766.0	47.1
0°-180°	12229.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2538	2538	2538	2538	2538	
5°	2538	2528	2501	2521	2516	241
15°	2416	2402	2370	2379	2367	680
25°	2186	2167	2126	2130	2126	1006
35°	1886	1862	1823	1808	1796	1178
45°	1535	1518	1481	1455	1445	1185
55°	1162	1147	1118	1088	1076	1039
65°	784	769	744	722	710	775
75°	410	405	393	378	383	438
85°	100	98	95	88	85	112
90°	2	22	61	57	59	12
95°	91	108	111	111	108	101
105°	374	379	383	386	386	395
115°	696	706	703	702	696	689
125°	1013	1029	1024	1018	1016	905
135°	1310	1330	1333	1332	1326	1013
145°	1591	1603	1613	1615	1608	994
155°	1819	1824	1830	1838	1833	837
165°	1979	1977	1977	1989	1981	558
175°	2059	2054	2050	2063	2052	196
180°	2063	2063	2063	2063	2063	

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2537.9	2537.9	2537.9	2537.9	2537.9
2.5°	2552.6	2540.5	2513.6	2537.9	2533.2
5°	2537.9	2528.3	2501.4	2520.8	2516.2
7.5°	2520.8	2506.3	2479.4	2499.1	2494.2
10°	2494.2	2477.0	2447.8	2467.2	2460.0
12.5°	2457.4	2442.9	2413.6	2425.8	2420.9
15°	2416.0	2401.5	2369.6	2379.4	2367.3
17.5°	2364.7	2350.2	2318.3	2330.5	2318.3
20°	2308.5	2294.0	2259.8	2267.1	2257.5
22.5°	2252.6	2230.6	2198.7	2198.7	2193.8
25°	2186.5	2167.1	2125.7	2130.4	2125.7
27.5°	2113.3	2096.2	2064.6	2057.3	2045.2
30°	2040.3	2020.6	1984.1	1976.9	1967.0
32.5°	1962.1	1947.6	1908.5	1893.7	1883.9
35°	1886.4	1862.1	1823.0	1808.2	1796.1
37.5°	1801.0	1779.0	1739.9	1722.8	1710.7
40°	1713.3	1693.5	1654.5	1632.7	1622.9
42.5°	1627.8	1608.1	1569.3	1544.7	1530.2
45°	1535.1	1518.0	1481.2	1454.6	1444.8
47.5°	1444.8	1427.7	1388.5	1361.6	1347.1
50°	1349.5	1337.3	1303.1	1268.9	1256.8
52.5°	1256.8	1239.7	1208.1	1181.2	1164.1
55°	1161.7	1147.0	1117.8	1088.5	1076.3
57.5°	1066.5	1054.3	1022.5	993.2	983.3
60°	971.2	961.6	927.4	900.5	893.2
62.5°	878.5	861.4	837.1	812.8	802.9
65°	783.5	768.7	744.4	722.4	710.2
67.5°	685.8	673.4	651.7	634.6	624.8
70°	595.5	585.6	563.7	546.6	537.0
72.5°	502.8	493.0	480.8	463.7	456.5
75°	409.9	405.2	392.8	378.3	383.2
77.5°	327.0	317.2	312.3	305.0	297.7
80°	244.2	241.6	236.7	229.4	224.5
82.5°	166.0	166.0	163.6	153.8	153.8
85°	100.0	97.6	95.3	87.8	85.4
87.5°	44.0	39.1	34.2	26.9	24.4
90°	1.9	22.4	61.0	57.2	59.1
92.5°	38.6	52.3	54.1	55.9	55.9
95°	90.8	108.2	111.3	111.3	108.2
97.5°	151.2	167.3	174.1	174.1	174.1
100°	220.8	235.1	240.0	240.0	238.1
102.5°	294.2	304.8	311.5	313.4	311.5
105°	374.4	379.4	383.1	386.2	386.2
107.5°	454.0	461.5	461.5	462.7	454.0
110°	531.1	541.0	541.0	541.0	536.1

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	614.4	625.0	623.1	618.2	614.4
115°	696.5	706.5	703.4	701.5	696.5
117.5°	778.0	791.7	782.9	778.0	773.0
120°	860.1	873.8	860.1	860.1	854.4
122.5°	934.7	952.1	943.4	938.4	934.7
125°	1013.0	1028.6	1023.6	1018.0	1016.2
127.5°	1089.6	1108.8	1102.0	1094.5	1089.6
130°	1161.1	1183.4	1180.3	1176.6	1169.8
132.5°	1241.3	1258.7	1260.0	1251.2	1246.3
135°	1310.3	1329.6	1333.3	1331.5	1326.5
137.5°	1387.4	1403.0	1406.1	1404.8	1397.3
140°	1455.2	1470.7	1479.4	1479.4	1472.6
142.5°	1524.9	1540.4	1545.4	1547.3	1540.4
145°	1590.8	1603.2	1613.1	1615.0	1608.2
147.5°	1649.8	1665.4	1672.8	1676.0	1669.2
150°	1710.8	1721.3	1728.2	1733.8	1728.2
152.5°	1764.9	1775.5	1784.2	1791.0	1784.2
155°	1819.0	1824.0	1829.6	1838.3	1832.7
157.5°	1865.6	1869.4	1872.5	1884.9	1876.2
160°	1907.3	1911.1	1912.9	1923.5	1916.0
162.5°	1945.9	1945.9	1947.7	1959.6	1950.8
165°	1978.8	1976.9	1976.9	1989.4	1980.7
167.5°	2008.7	2003.1	2003.1	2015.5	2006.8
170°	2031.1	2026.1	2024.2	2036.7	2026.1
172.5°	2046.6	2041.7	2039.8	2052.2	2041.7
175°	2059.0	2054.1	2050.3	2062.8	2052.2
177.5°	2065.9	2060.9	2057.2	2067.8	2057.2
180°	2062.8	2062.8	2062.8	2062.8	2062.8

TEST NUMBER: P917248

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.39	14.28	14.32	15.23	16.46	12.94	13.83	13.88	14.78	16.01
	3H	15.03	15.83	15.97	16.79	18.04	14.54	15.34	15.49	16.30	17.55
	4H	15.61	16.36	16.57	17.32	18.59	15.11	15.87	16.07	16.83	18.09
	6H	15.99	16.69	16.96	17.66	18.93	15.49	16.19	16.46	17.16	18.43
	8H	16.09	16.75	17.07	17.74	19.01	15.59	16.25	16.57	17.24	18.51
	12H	16.13	16.76	17.12	17.74	19.04	15.63	16.25	16.61	17.23	18.53
4H	2H	13.84	14.60	14.81	15.56	16.82	13.49	14.24	14.45	15.20	16.47
	3H	15.69	16.32	16.66	17.31	18.59	15.28	15.91	16.25	16.90	18.18
	4H	16.39	16.96	17.37	17.95	19.25	15.96	16.54	16.95	17.52	18.82
	6H	16.89	17.38	17.88	18.39	19.69	16.45	16.95	17.45	17.96	19.26
	8H	17.03	17.49	18.02	18.49	19.81	16.59	17.05	17.59	18.06	19.37
	12H	17.09	17.51	18.11	18.53	19.85	16.64	17.06	17.66	18.08	19.40
8H	4H	16.57	17.04	17.57	18.04	19.35	16.20	16.66	17.19	17.66	18.98
	6H	17.18	17.57	18.20	18.61	19.92	16.80	17.18	17.82	18.23	19.54
	8H	17.39	17.73	18.42	18.76	20.09	17.00	17.33	18.03	18.37	19.70
	12H	17.51	17.81	18.54	18.83	20.21	17.10	17.40	18.13	18.42	19.80
12H	4H	16.56	16.98	17.57	18.00	19.31	16.19	16.61	17.20	17.63	18.94
	6H	17.21	17.55	18.24	18.58	19.91	16.83	17.17	17.86	18.20	19.53
	8H	17.44	17.73	18.47	18.76	20.13	17.05	17.35	18.09	18.38	19.75