

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919902

Luminaire Tested: DFN2DIP-SQ2F0-050D070US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919902
REPORT IS A COMBINATION OF REPORTS P899824 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D070US935-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8993.2 lumens
Efficiency: N/A
Efficacy: 91.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLFLL

Luminous Intensity Polar Plot

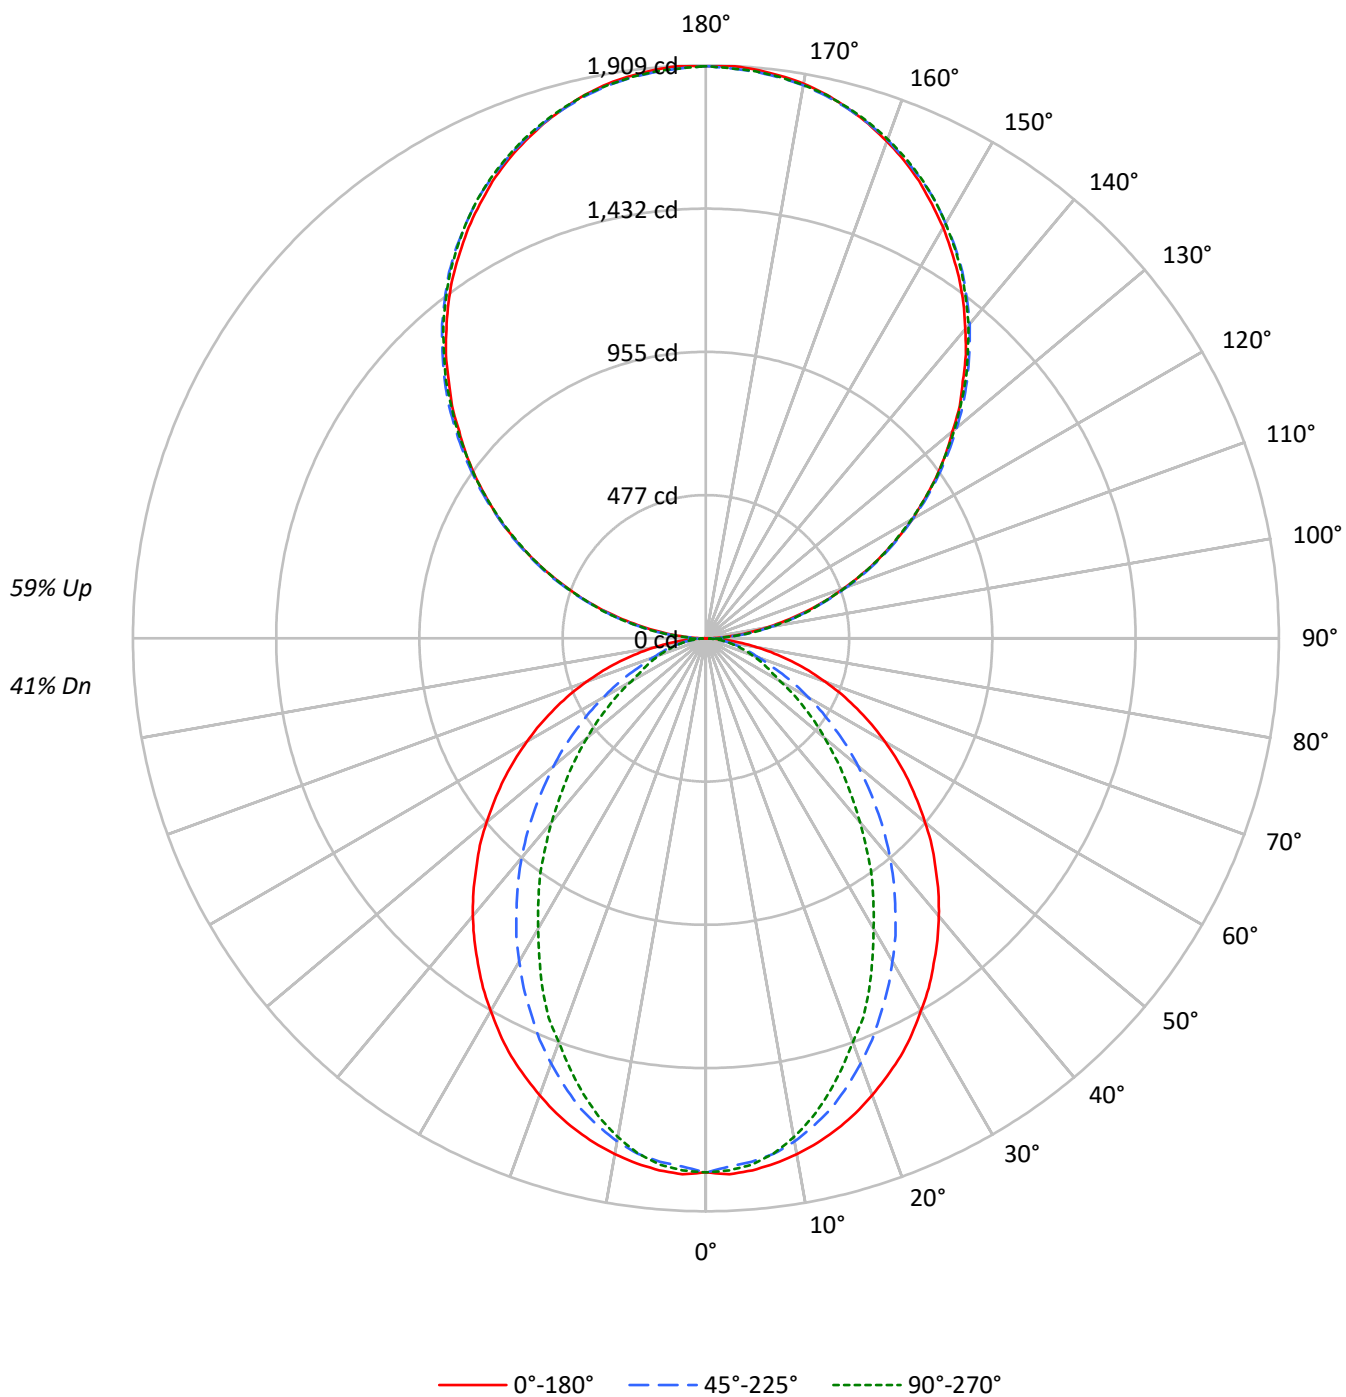

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	32	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	27	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3912	3912	3912
5°	3912	3842	3870
10°	3866	3758	3738
15°	3806	3626	3538
20°	3729	3446	3295
25°	3650	3247	3061
30°	3546	3044	2765
35°	3444	2826	2505
40°	3340	2601	2209
45°	3219	2353	1940
50°	3094	2104	1678
55°	2963	1838	1426
60°	2810	1562	1169
65°	2635	1282	1046
70°	2422	1022	939
75°	2154	884	843
80°	1769	717	715
85°	1151	446	509

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3219 cd/sqm

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.8	1.9
10°-20°	457.8	5.1
20°-30°	642.7	7.1
30°-40°	700.6	7.8
40°-50°	643.9	7.2
50°-60°	505.7	5.6
60°-70°	329.2	3.7
70°-80°	169.5	1.9
80°-90°	48.7	0.5
90°-100°	117.9	1.3
100°-110°	374.8	4.2
110°-120°	641.3	7.1
120°-130°	843.5	9.4
130°-140°	946.7	10.5
140°-150°	928.4	10.3
150°-160°	778.8	8.7
160°-170°	516.5	5.7
170°-180°	180.5	2.0
0°-30°	1267.2	14.1
0°-40°	1967.8	21.9
0°-60°	3117.4	34.7
0°-90°	3664.7	40.7
90°-120°	1134.1	12.6
90°-150°	3852.7	42.8
90°-180°	5328.0	59.2
0°-180°	8993.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1779	1779	1779	1779	1779	
5°	1779	1771	1750	1765	1760	169
15°	1692	1675	1620	1589	1573	477
25°	1536	1484	1378	1312	1288	706
35°	1324	1242	1100	998	963	828
45°	1082	974	805	691	652	836
55°	823	697	523	427	396	735
65°	556	425	280	226	221	551
75°	296	184	129	118	116	313
85°	69	35	31	31	31	79
90°	2	21	56	53	55	9
95°	84	100	103	103	100	93
105°	346	350	354	357	357	365
115°	644	653	650	648	644	637
125°	936	950	946	941	939	837
135°	1211	1229	1232	1230	1226	936
145°	1470	1481	1491	1492	1486	918
155°	1681	1685	1691	1699	1694	774
165°	1828	1827	1827	1838	1830	516
175°	1903	1898	1895	1906	1896	181
180°	1906	1906	1906	1906	1906	

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1779.3	1779.3	1779.3	1779.3	1779.3
2.5°	1787.3	1779.3	1761.5	1777.7	1774.4
5°	1779.3	1771.2	1750.2	1764.7	1760.0
7.5°	1764.7	1755.1	1732.6	1739.0	1730.9
10°	1745.4	1734.1	1702.0	1697.1	1687.5
12.5°	1721.3	1706.8	1663.3	1653.7	1635.9
15°	1692.3	1674.6	1619.9	1589.3	1573.2
17.5°	1658.5	1632.7	1565.0	1529.6	1503.8
20°	1619.9	1587.6	1507.1	1467.0	1431.4
22.5°	1578.0	1540.9	1447.5	1392.8	1368.7
25°	1536.1	1484.5	1378.3	1312.3	1288.1
27.5°	1486.3	1431.4	1313.9	1238.2	1201.2
30°	1433.1	1371.8	1243.0	1161.0	1117.4
32.5°	1381.6	1307.4	1175.5	1078.8	1038.5
35°	1323.6	1241.5	1099.8	998.3	962.9
37.5°	1267.2	1178.6	1029.0	917.7	877.6
40°	1207.6	1111.1	954.8	840.5	798.7
42.5°	1146.5	1043.4	880.8	761.6	721.4
45°	1082.1	974.1	805.1	690.7	652.0
47.5°	1020.9	906.6	732.7	618.3	582.9
50°	953.3	839.0	661.8	550.6	516.9
52.5°	887.2	766.4	594.2	487.9	457.4
55°	822.8	697.1	523.2	426.7	396.1
57.5°	756.8	628.0	460.5	370.4	344.6
60°	689.1	560.3	394.4	312.5	286.6
62.5°	623.2	494.4	338.1	260.9	248.1
65°	555.5	425.1	280.2	225.5	220.6
67.5°	491.1	360.7	225.5	198.0	193.2
70°	423.5	297.9	186.8	170.6	164.2
72.5°	359.1	239.9	156.2	143.4	140.1
75°	296.3	183.5	128.8	117.5	116.0
77.5°	233.5	130.4	101.5	95.0	91.7
80°	175.5	93.4	77.2	70.9	70.9
82.5°	122.3	62.9	53.1	49.9	49.9
85°	69.2	35.4	30.6	30.6	30.6
87.5°	25.8	12.8	12.8	11.3	11.3
90°	1.7	20.7	56.3	52.9	54.6
92.5°	35.6	48.3	50.0	51.7	51.7
95°	83.9	100.0	102.9	102.9	100.0
97.5°	139.7	154.5	160.9	160.9	160.9
100°	204.0	217.2	221.8	221.8	220.1
102.5°	271.8	281.5	287.9	289.6	287.9
105°	345.9	350.5	354.0	356.9	356.9
107.5°	419.5	426.4	426.4	427.6	419.5
110°	490.8	500.0	500.0	500.0	495.3

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	567.7	577.6	575.8	571.2	567.7
115°	643.6	652.8	650.0	648.2	643.6
117.5°	718.8	731.5	723.5	718.8	714.3
120°	794.7	807.4	794.7	794.7	789.5
122.5°	863.7	879.8	871.8	867.1	863.7
125°	936.1	950.5	945.9	940.7	939.0
127.5°	1006.8	1024.6	1018.3	1011.4	1006.8
130°	1072.9	1093.6	1090.7	1087.3	1080.9
132.5°	1147.0	1163.1	1164.2	1156.2	1151.6
135°	1210.8	1228.6	1232.1	1230.3	1225.7
137.5°	1282.0	1296.4	1299.2	1298.1	1291.2
140°	1344.7	1359.1	1367.1	1367.1	1360.8
142.5°	1409.0	1423.4	1428.0	1429.7	1423.4
145°	1470.0	1481.4	1490.6	1492.4	1486.1
147.5°	1524.6	1538.9	1545.8	1548.7	1542.4
150°	1580.9	1590.6	1597.0	1602.1	1597.0
152.5°	1630.8	1640.6	1648.6	1655.0	1648.6
155°	1680.8	1685.4	1690.7	1698.7	1693.5
157.5°	1724.0	1727.4	1730.3	1741.8	1733.7
160°	1762.5	1765.9	1767.6	1777.4	1770.5
162.5°	1798.1	1798.1	1799.8	1810.7	1802.7
165°	1828.5	1826.8	1826.8	1838.3	1830.2
167.5°	1856.1	1851.0	1851.0	1862.4	1854.4
170°	1876.8	1872.2	1870.5	1882.0	1872.2
172.5°	1891.2	1886.5	1884.8	1896.3	1886.5
175°	1902.6	1898.1	1894.6	1906.1	1896.3
177.5°	1909.0	1904.4	1900.9	1910.7	1900.9
180°	1906.1	1906.1	1906.1	1906.1	1906.1

TEST NUMBER: P919902

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.84	11.60	11.88	12.64	14.04	6.80	7.56	7.84	8.60	10.00
	3H	12.49	13.17	13.54	14.22	15.64	7.97	8.65	9.01	9.70	11.11
	4H	13.08	13.73	14.15	14.78	16.21	8.40	9.04	9.46	10.10	11.52
	6H	13.49	14.08	14.56	15.14	16.57	8.70	9.29	9.77	10.35	11.79
	8H	13.60	14.17	14.68	15.24	16.67	8.78	9.34	9.86	10.42	11.85
	12H	13.65	14.19	14.73	15.25	16.71	8.81	9.35	9.89	10.41	11.87
4H	2H	10.84	11.49	11.91	12.54	13.97	7.38	8.02	8.44	9.07	10.50
	3H	12.65	13.18	13.72	14.26	15.70	8.70	9.24	9.77	10.31	11.75
	4H	13.32	13.81	14.40	14.88	16.34	9.23	9.72	10.31	10.79	12.25
	6H	13.81	14.23	14.90	15.33	16.78	9.63	10.05	10.71	11.14	12.59
	8H	13.97	14.37	15.06	15.45	16.92	9.74	10.13	10.83	11.22	12.69
	12H	14.06	14.41	15.16	15.51	16.98	9.79	10.15	10.90	11.25	12.72
8H	4H	13.28	13.67	14.37	14.76	16.23	9.49	9.89	10.58	10.97	12.44
	6H	13.82	14.14	14.93	15.27	16.74	9.98	10.31	11.09	11.44	12.90
	8H	14.02	14.31	15.14	15.42	16.90	10.16	10.44	11.28	11.55	13.04
	12H	14.14	14.39	15.26	15.50	17.02	10.26	10.51	11.38	11.62	13.14
12H	4H	13.23	13.58	14.33	14.68	16.15	9.49	9.85	10.60	10.94	12.42
	6H	13.79	14.08	14.91	15.19	16.67	10.03	10.31	11.14	11.42	12.91
	8H	14.00	14.25	15.12	15.35	16.88	10.22	10.47	11.34	11.57	13.10

END OF REPORT