

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922596

Luminaire Tested: DFN2DIP-SQ2F0-040D050US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922596
REPORT IS A COMBINATION OF REPORTS P899797 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D050US940-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7477.0 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFLL

Luminous Intensity Polar Plot

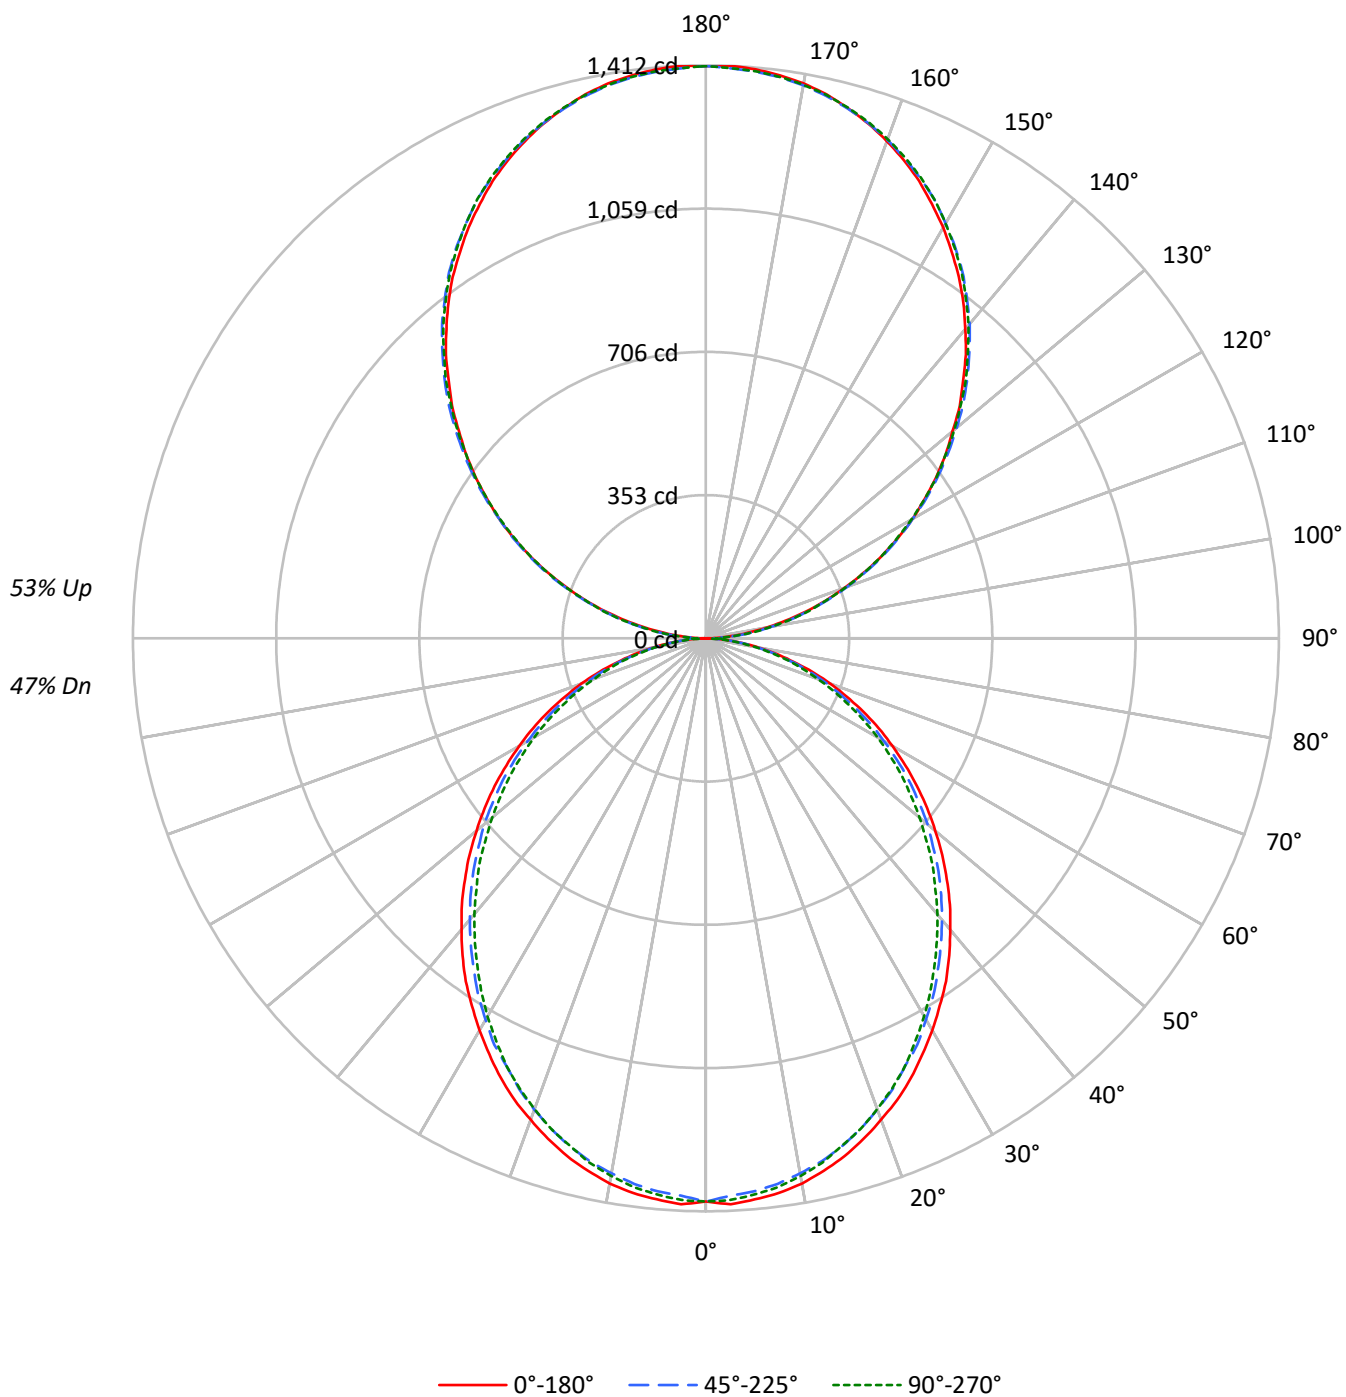

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	35	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	33	29	30	27	24
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	35	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3052	3052	3052
5°	3051	3003	3025
10°	3021	2956	2980
15°	2972	2900	2912
20°	2906	2826	2842
25°	2841	2739	2762
30°	2761	2657	2662
35°	2684	2561	2556
40°	2591	2465	2454
45°	2498	2368	2351
50°	2396	2265	2231
55°	2288	2147	2120
60°	2166	2008	1992
65°	2032	1863	1842
70°	1863	1686	1679
75°	1630	1473	1524
80°	1346	1203	1238
85°	910	760	777

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2498 cd/sqm

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.7
10°-20°	367.5	4.9
20°-30°	540.1	7.2
30°-40°	627.3	8.4
40°-50°	626.6	8.4
50°-60°	546.3	7.3
60°-70°	403.9	5.4
70°-80°	228.5	3.1
80°-90°	64.3	0.9
90°-100°	87.3	1.2
100°-110°	277.2	3.7
110°-120°	474.5	6.3
120°-130°	624.0	8.3
130°-140°	700.4	9.4
140°-150°	686.8	9.2
150°-160°	576.1	7.7
160°-170°	382.1	5.1
170°-180°	133.5	1.8
0°-30°	1038.3	13.9
0°-40°	1665.6	22.3
0°-60°	2838.5	38.0
0°-90°	3535.2	47.3
90°-120°	838.9	11.2
90°-150°	2850.1	38.1
90°-180°	3942.0	52.7
0°-180°	7477.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	15	42	39	40	7
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1

TEST NUMBER: P922596

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.77	11.61	11.75	12.61	13.92	10.33	11.17	11.31	12.16	13.47
	3H	12.41	13.17	13.40	14.17	15.50	11.92	12.67	12.91	13.68	15.01
	4H	12.99	13.70	13.99	14.70	16.04	12.49	13.20	13.50	14.21	15.55
	6H	13.37	14.03	14.39	15.04	16.39	12.87	13.53	13.89	14.54	15.89
	8H	13.47	14.09	14.49	15.12	16.47	12.97	13.59	13.99	14.62	15.96
	12H	13.51	14.10	14.53	15.12	16.49	13.00	13.59	14.03	14.61	15.99
4H	2H	11.22	11.93	12.23	12.94	14.28	10.87	11.58	11.88	12.58	13.92
	3H	13.06	13.66	14.08	14.69	16.04	12.65	13.25	13.67	14.28	15.64
	4H	13.76	14.30	14.79	15.33	16.71	13.34	13.88	14.36	14.91	16.28
	6H	14.26	14.72	15.29	15.77	17.14	13.82	14.29	14.86	15.34	16.71
	8H	14.40	14.83	15.43	15.88	17.26	13.96	14.40	15.00	15.44	16.82
	12H	14.46	14.85	15.52	15.91	17.30	14.01	14.40	15.07	15.46	16.85
8H	4H	13.94	14.38	14.98	15.42	16.81	13.57	14.00	14.60	15.05	16.43
	6H	14.55	14.91	15.61	16.00	17.38	14.17	14.53	15.23	15.61	17.00
	8H	14.76	15.08	15.83	16.14	17.55	14.36	14.68	15.43	15.75	17.15
	12H	14.87	15.15	15.95	16.22	17.66	14.46	14.74	15.54	15.81	17.25
12H	4H	13.93	14.32	14.98	15.38	16.77	13.56	13.95	14.61	15.01	16.40
	6H	14.57	14.89	15.64	15.96	17.37	14.20	14.52	15.27	15.59	16.99
	8H	14.80	15.08	15.87	16.14	17.59	14.42	14.70	15.49	15.76	17.21

END OF REPORT