

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903644

Luminaire Tested: DFN2DIP-SQ3F0-040D120US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903644
REPORT IS A COMBINATION OF REPORTS P900005 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D120US830-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13742.3 lumens
Efficiency: N/A
Efficacy: 108.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 126.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFLL

Luminous Intensity Polar Plot

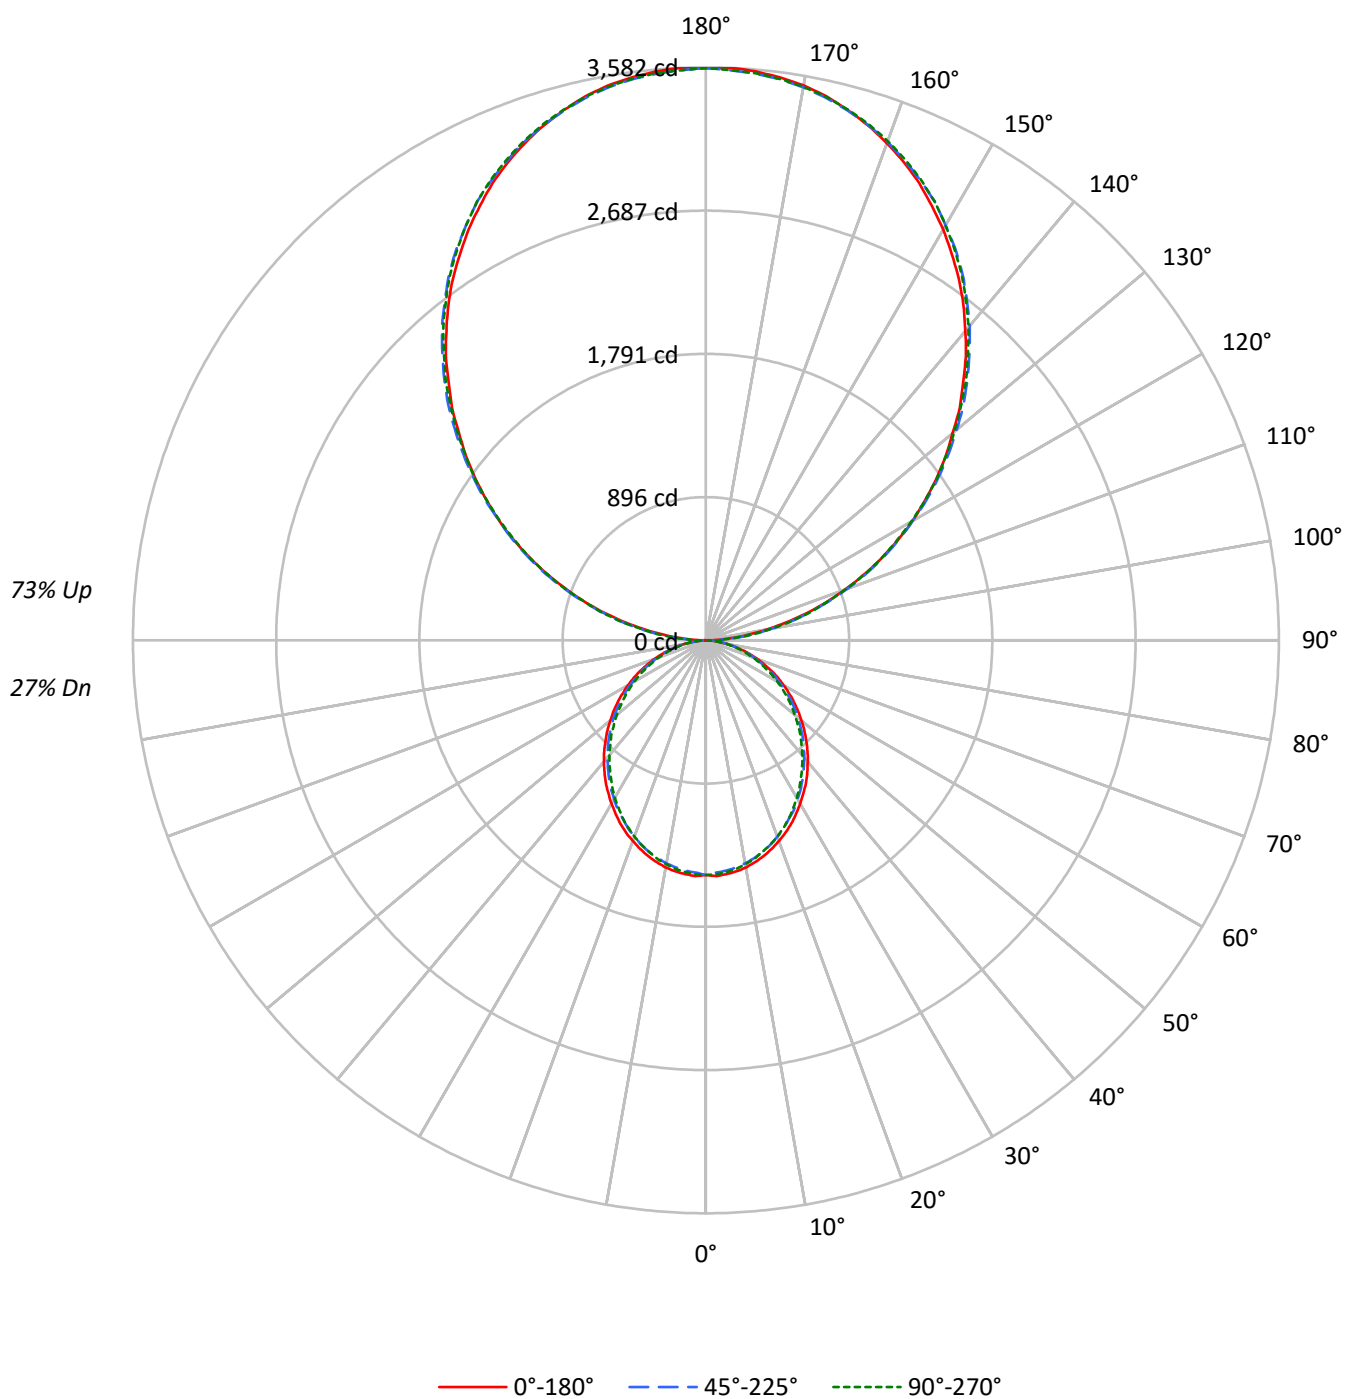

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	52	52	52	35	35	35
1	93	88	85	81	83	79	76	73	62	60	58	46	44	43	31	30	30
2	84	77	71	66	75	69	64	60	54	51	48	40	38	36	27	26	25
3	77	68	61	55	68	61	55	50	48	44	40	35	33	30	24	23	21
4	70	60	52	47	62	54	47	42	42	38	34	32	29	26	22	20	18
5	64	53	45	40	57	48	41	36	38	33	29	28	25	22	19	17	16
6	59	48	40	34	53	43	36	31	34	29	25	25	22	20	18	16	14
7	55	43	35	30	49	39	32	27	31	26	22	23	20	17	16	14	12
8	51	39	31	26	45	35	28	24	28	23	20	21	18	15	15	13	11
9	47	35	28	23	42	32	26	21	25	21	17	19	16	14	14	11	10
10	44	32	25	21	39	29	23	19	23	19	16	18	15	12	13	10	9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1681	1681	1681
5°	1683	1656	1668
10°	1668	1633	1645
15°	1642	1605	1609
20°	1608	1567	1572
25°	1574	1521	1530
30°	1531	1478	1477
35°	1491	1428	1420
40°	1442	1377	1366
45°	1392	1326	1310
50°	1338	1273	1246
55°	1282	1211	1188
60°	1218	1138	1120
65°	1148	1062	1040
70°	1058	969	954
75°	935	858	874
80°	786	715	723
85°	553	473	473

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3600 cd/sqm

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.0
10°-20°	388.5	2.8
20°-30°	570.9	4.2
30°-40°	663.1	4.8
40°-50°	662.3	4.8
50°-60°	577.5	4.2
60°-70°	426.9	3.1
70°-80°	241.5	1.8
80°-90°	73.9	0.5
90°-100°	221.3	1.6
100°-110°	703.3	5.1
110°-120°	1203.6	8.8
120°-130°	1582.9	11.5
130°-140°	1776.7	12.9
140°-150°	1742.3	12.7
150°-160°	1461.5	10.6
160°-170°	969.3	7.1
170°-180°	338.8	2.5
0°-30°	1097.5	8.0
0°-40°	1760.6	12.8
0°-60°	3000.3	21.8
0°-90°	3742.6	27.2
90°-120°	2128.2	15.5
90°-150°	7230.1	52.6
90°-180°	10000.0	72.8
0°-180°	13742.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	3	39	106	99	102	14
95°	157	188	193	193	188	175
105°	649	658	664	670	670	685
115°	1208	1225	1220	1216	1208	1195
125°	1757	1784	1775	1765	1762	1570
135°	2272	2306	2312	2309	2300	1756
145°	2758	2780	2797	2801	2789	1724
155°	3154	3163	3173	3188	3178	1452
165°	3432	3428	3428	3450	3435	968
175°	3571	3562	3556	3577	3559	339
180°	3577	3577	3577	3577	3577	

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	3.2	38.8	105.7	99.2	102.5
92.5°	66.8	90.6	93.8	97.1	97.1
95°	157.4	187.7	193.0	193.0	187.7
97.5°	262.0	290.1	302.0	302.0	302.0
100°	382.9	407.6	416.2	416.2	413.0
102.5°	510.1	528.4	540.3	543.6	540.3
105°	649.2	657.8	664.3	669.7	669.7
107.5°	787.2	800.2	800.2	802.3	787.2
110°	921.0	938.2	938.2	938.2	929.6

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1065.4	1083.8	1080.5	1072.0	1065.4
115°	1207.8	1225.1	1219.6	1216.4	1207.8
117.5°	1349.1	1372.8	1357.7	1349.1	1340.5
120°	1491.5	1515.1	1491.5	1491.5	1481.8
122.5°	1620.9	1651.1	1636.0	1627.3	1620.9
125°	1756.7	1783.7	1775.1	1765.4	1762.1
127.5°	1889.4	1922.8	1910.9	1898.0	1889.4
130°	2013.4	2052.2	2046.8	2040.3	2028.4
132.5°	2152.5	2182.7	2184.8	2169.7	2161.2
135°	2272.2	2305.6	2312.2	2308.9	2300.3
137.5°	2405.9	2432.9	2438.3	2436.1	2423.2
140°	2523.5	2550.4	2565.5	2565.5	2553.6
142.5°	2644.3	2671.3	2679.8	2683.0	2671.3
145°	2758.5	2780.1	2797.4	2800.7	2788.8
147.5°	2861.0	2887.9	2901.0	2906.3	2894.5
150°	2966.7	2985.0	2996.9	3006.6	2996.9
152.5°	3060.5	3078.8	3094.0	3105.9	3094.0
155°	3154.3	3163.0	3172.7	3187.8	3178.1
157.5°	3235.3	3241.7	3247.1	3268.6	3253.6
160°	3307.5	3314.0	3317.2	3335.6	3322.6
162.5°	3374.3	3374.3	3377.6	3398.1	3383.0
165°	3431.5	3428.3	3428.3	3449.8	3434.7
167.5°	3483.3	3473.6	3473.6	3495.1	3480.1
170°	3522.1	3513.4	3510.2	3531.8	3513.4
172.5°	3549.0	3540.4	3537.2	3558.8	3540.4
175°	3570.6	3562.0	3555.6	3577.0	3558.8
177.5°	3582.5	3573.8	3567.3	3585.7	3567.3
180°	3577.0	3577.0	3577.0	3577.0	3577.0

TEST NUMBER: P903644

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.43	7.12	7.56	8.24	9.81	5.99	6.68	7.12	7.80	9.36
	3H	8.07	8.69	9.21	9.82	11.40	7.58	8.20	8.72	9.33	10.91
	4H	8.65	9.24	9.80	10.37	11.95	8.16	8.74	9.30	9.87	11.46
	6H	9.04	9.58	10.19	10.71	12.31	8.54	9.08	9.69	10.21	11.81
	8H	9.14	9.65	10.29	10.80	12.38	8.63	9.15	9.79	10.30	11.88
	12H	9.18	9.66	10.34	10.81	12.42	8.67	9.15	9.83	10.30	11.91
4H	2H	6.87	7.45	8.02	8.58	10.17	6.51	7.10	7.67	8.23	9.81
	3H	8.71	9.20	9.87	10.36	11.95	8.30	8.79	9.46	9.95	11.55
	4H	9.42	9.87	10.58	11.01	12.63	8.99	9.44	10.15	10.59	12.20
	6H	9.92	10.30	11.08	11.47	13.07	9.48	9.87	10.65	11.04	12.64
	8H	10.06	10.42	11.23	11.58	13.20	9.62	9.98	10.79	11.14	12.76
	12H	10.12	10.45	11.31	11.62	13.25	9.67	10.00	10.86	11.17	12.80
8H	4H	9.59	9.95	10.76	11.11	12.73	9.22	9.58	10.38	10.74	12.36
	6H	10.21	10.51	11.40	11.71	13.33	9.83	10.12	11.01	11.33	12.94
	8H	10.43	10.69	11.62	11.87	13.50	10.03	10.29	11.23	11.47	13.11
	12H	10.55	10.77	11.74	11.95	13.62	10.14	10.36	11.33	11.54	13.21
12H	4H	9.57	9.90	10.75	11.07	12.69	9.20	9.53	10.39	10.70	12.33
	6H	10.24	10.50	11.43	11.68	13.32	9.87	10.12	11.06	11.30	12.94
	8H	10.47	10.69	11.66	11.87	13.54	10.09	10.31	11.28	11.49	13.16

END OF REPORT