

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906536

Luminaire Tested: DFN2DIP-SQ3F0-090D080US835-FLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P906536  
REPORT IS A COMBINATION OF REPORTS P899943 AND P896733  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-SQ3F0-090D080US835-FLLFLL  
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 15990.0 lumens  
Efficiency: N/A  
Efficacy: 107.9 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')  
CIE Type: General Diffuse

Input Watts (W): 148.2  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.996  
Total Harmonic Distortion (THDi): 0.064  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFLL

### Luminous Intensity Polar Plot

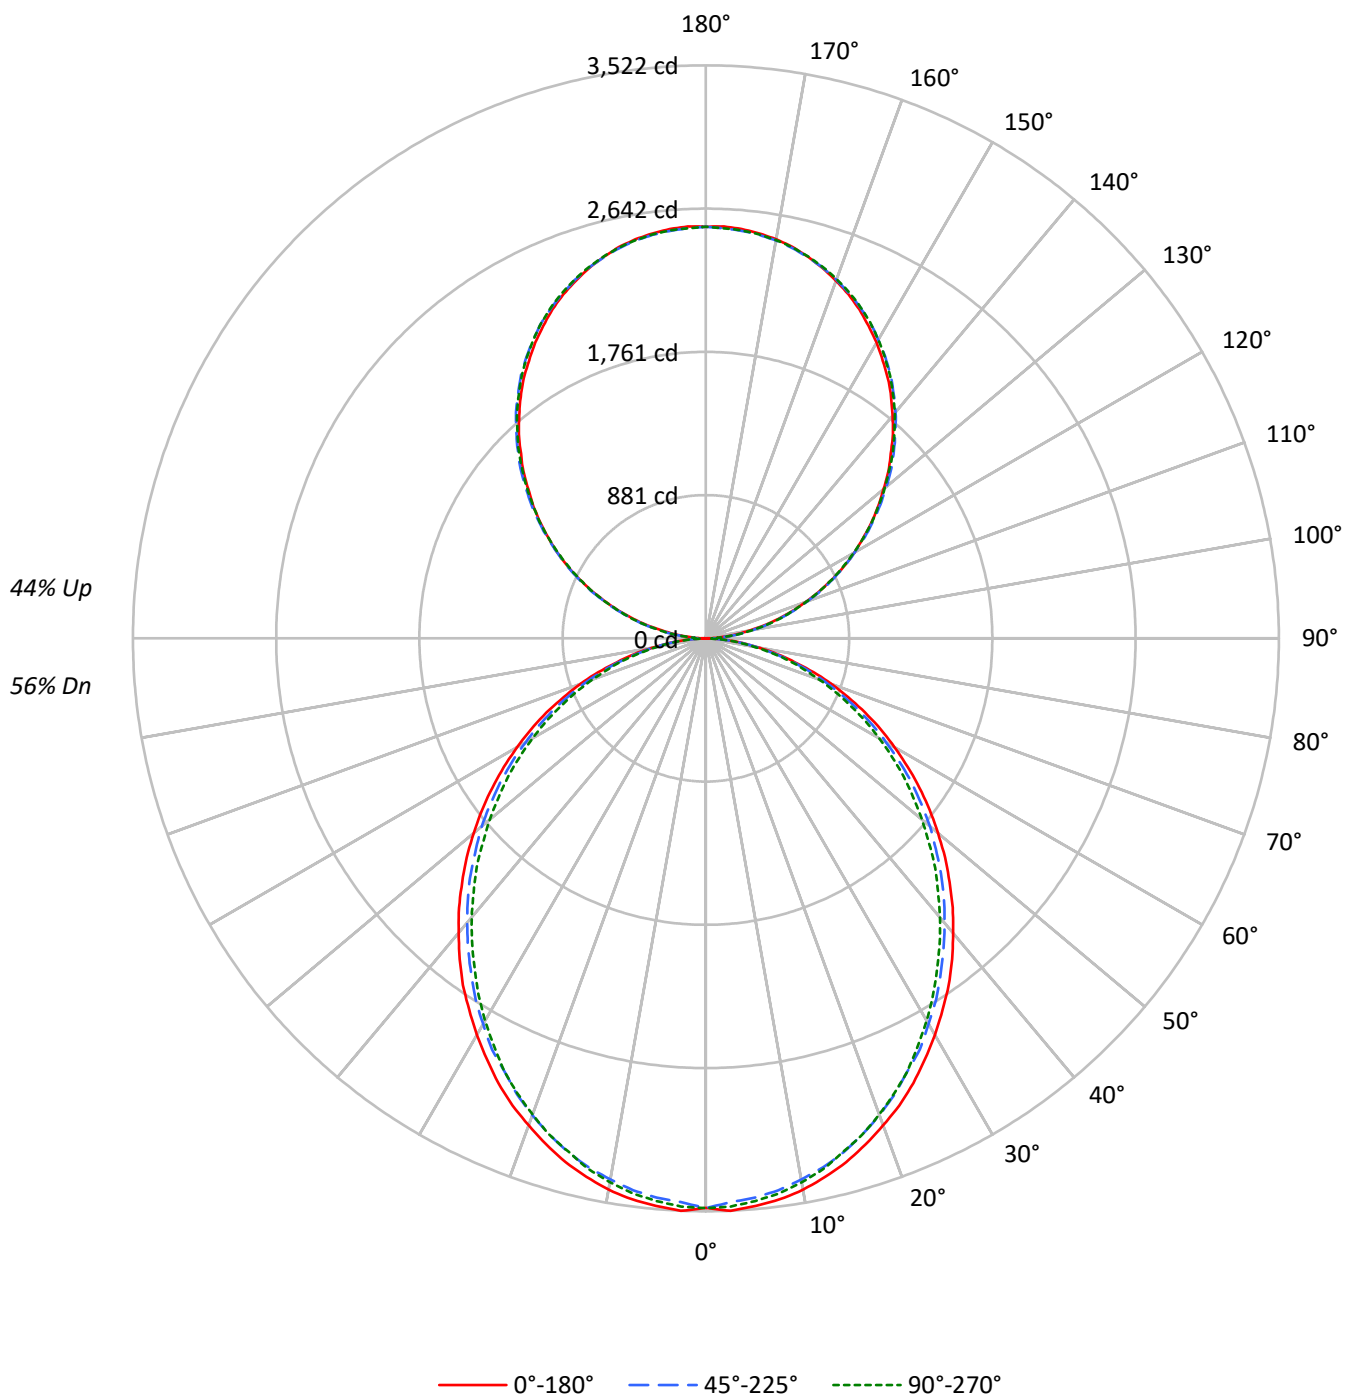

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
| 0   | 109 | 109 | 109 | 109 | 101 | 101 | 101 | 101 | 87 | 87 | 87 | 73 | 73 | 73 | 61 | 61 | 61 |
| 1   | 99  | 95  | 91  | 87  | 92  | 88  | 85  | 82  | 76 | 73 | 71 | 65 | 63 | 61 | 54 | 53 | 52 |
| 2   | 90  | 83  | 77  | 71  | 84  | 77  | 72  | 67  | 67 | 62 | 59 | 57 | 54 | 51 | 48 | 46 | 44 |
| 3   | 82  | 73  | 65  | 59  | 76  | 68  | 61  | 56  | 59 | 54 | 50 | 50 | 46 | 43 | 42 | 40 | 37 |
| 4   | 75  | 64  | 56  | 50  | 70  | 60  | 53  | 48  | 52 | 47 | 42 | 45 | 41 | 37 | 38 | 35 | 32 |
| 5   | 69  | 57  | 49  | 43  | 64  | 54  | 46  | 41  | 47 | 41 | 36 | 40 | 36 | 32 | 34 | 31 | 28 |
| 6   | 64  | 52  | 43  | 37  | 59  | 48  | 41  | 36  | 42 | 36 | 32 | 36 | 32 | 28 | 31 | 27 | 25 |
| 7   | 59  | 47  | 39  | 33  | 55  | 44  | 36  | 31  | 38 | 32 | 28 | 33 | 28 | 25 | 28 | 25 | 22 |
| 8   | 55  | 42  | 35  | 29  | 51  | 40  | 33  | 28  | 35 | 29 | 25 | 30 | 26 | 22 | 26 | 22 | 20 |
| 9   | 51  | 39  | 31  | 26  | 47  | 36  | 30  | 25  | 32 | 26 | 22 | 28 | 23 | 20 | 24 | 20 | 18 |
| 10  | 48  | 36  | 28  | 23  | 44  | 33  | 27  | 22  | 30 | 24 | 20 | 26 | 21 | 18 | 22 | 19 | 16 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 4012 | 4012 | 4012 |
| 5°  | 4016 | 3954 | 3982 |
| 10° | 3981 | 3898 | 3927 |
| 15° | 3920 | 3831 | 3841 |
| 20° | 3838 | 3739 | 3754 |
| 25° | 3757 | 3630 | 3653 |
| 30° | 3656 | 3528 | 3525 |
| 35° | 3560 | 3408 | 3389 |
| 40° | 3442 | 3287 | 3260 |
| 45° | 3324 | 3166 | 3128 |
| 50° | 3195 | 3038 | 2976 |
| 55° | 3060 | 2890 | 2835 |
| 60° | 2907 | 2716 | 2674 |
| 65° | 2739 | 2534 | 2483 |
| 70° | 2526 | 2313 | 2278 |
| 75° | 2232 | 2047 | 2087 |
| 80° | 1876 | 1708 | 1725 |
| 85° | 1320 | 1132 | 1129 |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3324 cd/sqm

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 329.6   | 2.1       |
| 10°-20°   | 927.4   | 5.8       |
| 20°-30°   | 1362.9  | 8.5       |
| 30°-40°   | 1582.9  | 9.9       |
| 40°-50°   | 1580.9  | 9.9       |
| 50°-60°   | 1378.5  | 8.6       |
| 60°-70°   | 1019.0  | 6.4       |
| 70°-80°   | 576.6   | 3.6       |
| 80°-90°   | 159.4   | 1.0       |
| 90°-100°  | 156.6   | 1.0       |
| 100°-110° | 497.5   | 3.1       |
| 110°-120° | 851.3   | 5.3       |
| 120°-130° | 1119.6  | 7.0       |
| 130°-140° | 1256.7  | 7.9       |
| 140°-150° | 1232.3  | 7.7       |
| 150°-160° | 1033.7  | 6.5       |
| 160°-170° | 685.6   | 4.3       |
| 170°-180° | 239.6   | 1.5       |
| 0°-30°    | 2619.9  | 16.4      |
| 0°-40°    | 4202.8  | 26.3      |
| 0°-60°    | 7162.3  | 44.8      |
| 0°-90°    | 8917.2  | 55.8      |
| 90°-120°  | 1505.3  | 9.4       |
| 90°-150°  | 5113.9  | 32.0      |
| 90°-180°  | 7073.0  | 44.2      |
| 0°-180°   | 15990.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 3502 | 3502  | 3502 | 3502  | 3502 |      |
| 5°   | 3502 | 3489  | 3452 | 3478  | 3472 | 332  |
| 15°  | 3334 | 3314  | 3270 | 3283  | 3266 | 939  |
| 25°  | 3017 | 2990  | 2933 | 2940  | 2933 | 1388 |
| 35°  | 2603 | 2570  | 2516 | 2495  | 2478 | 1626 |
| 45°  | 2118 | 2095  | 2044 | 2007  | 1994 | 1635 |
| 55°  | 1603 | 1583  | 1542 | 1502  | 1485 | 1433 |
| 65°  | 1081 | 1061  | 1027 | 997   | 980  | 1069 |
| 75°  | 566  | 559   | 542  | 522   | 529  | 604  |
| 85°  | 138  | 135   | 132  | 121   | 118  | 154  |
| 90°  | 2    | 28    | 75   | 70    | 72   | 15   |
| 95°  | 111  | 133   | 136  | 136   | 133  | 124  |
| 105° | 459  | 465   | 470  | 474   | 474  | 485  |
| 115° | 854  | 866   | 863  | 860   | 854  | 845  |
| 125° | 1242 | 1262  | 1256 | 1249  | 1246 | 1110 |
| 135° | 1607 | 1631  | 1635 | 1633  | 1627 | 1242 |
| 145° | 1951 | 1966  | 1979 | 1981  | 1972 | 1219 |
| 155° | 2231 | 2237  | 2244 | 2255  | 2248 | 1027 |
| 165° | 2427 | 2425  | 2425 | 2440  | 2429 | 685  |
| 175° | 2526 | 2519  | 2515 | 2530  | 2517 | 240  |
| 180° | 2530 | 2530  | 2530 | 2530  | 2530 |      |

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFLL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 3501.9 | 3501.9 | 3501.9 | 3501.9 | 3501.9 |
| 2.5°   | 3522.3 | 3505.5 | 3468.4 | 3501.9 | 3495.5 |
| 5°     | 3501.9 | 3488.7 | 3451.6 | 3478.4 | 3471.9 |
| 7.5°   | 3478.4 | 3458.4 | 3421.2 | 3448.4 | 3441.6 |
| 10°    | 3441.6 | 3418.0 | 3377.6 | 3404.4 | 3394.4 |
| 12.5°  | 3390.8 | 3370.8 | 3330.5 | 3347.2 | 3340.5 |
| 15°    | 3333.7 | 3313.7 | 3269.7 | 3283.3 | 3266.5 |
| 17.5°  | 3262.9 | 3242.9 | 3199.0 | 3215.8 | 3199.0 |
| 20°    | 3185.4 | 3165.4 | 3118.2 | 3128.2 | 3115.0 |
| 22.5°  | 3108.2 | 3077.9 | 3033.9 | 3033.9 | 3027.1 |
| 25°    | 3017.1 | 2990.3 | 2933.2 | 2939.6 | 2933.2 |
| 27.5°  | 2916.0 | 2892.4 | 2848.9 | 2838.9 | 2822.1 |
| 30°    | 2815.3 | 2788.1 | 2737.7 | 2727.7 | 2714.2 |
| 32.5°  | 2707.4 | 2687.4 | 2633.4 | 2613.1 | 2599.5 |
| 35°    | 2603.1 | 2569.5 | 2515.5 | 2495.2 | 2478.4 |
| 37.5°  | 2485.2 | 2454.8 | 2400.8 | 2377.3 | 2360.5 |
| 40°    | 2364.0 | 2336.9 | 2282.9 | 2252.9 | 2239.4 |
| 42.5°  | 2246.1 | 2219.0 | 2165.4 | 2131.5 | 2111.5 |
| 45°    | 2118.2 | 2094.7 | 2043.9 | 2007.1 | 1993.6 |
| 47.5°  | 1993.6 | 1970.0 | 1916.0 | 1878.9 | 1858.9 |
| 50°    | 1862.1 | 1845.3 | 1798.1 | 1751.0 | 1734.2 |
| 52.5°  | 1734.2 | 1710.6 | 1667.0 | 1629.9 | 1606.3 |
| 55°    | 1603.1 | 1582.7 | 1542.3 | 1502.0 | 1485.2 |
| 57.5°  | 1471.6 | 1454.8 | 1410.9 | 1370.5 | 1356.9 |
| 60°    | 1340.1 | 1326.9 | 1279.7 | 1242.6 | 1232.6 |
| 62.5°  | 1212.2 | 1188.6 | 1155.0 | 1121.5 | 1107.9 |
| 65°    | 1081.1 | 1060.7 | 1027.1 | 996.8  | 980.0  |
| 67.5°  | 946.4  | 929.3  | 899.2  | 875.7  | 862.1  |
| 70°    | 821.7  | 808.1  | 777.8  | 754.2  | 741.0  |
| 72.5°  | 693.8  | 680.2  | 663.4  | 639.9  | 629.9  |
| 75°    | 565.6  | 559.1  | 542.0  | 522.0  | 528.8  |
| 77.5°  | 451.2  | 437.7  | 430.9  | 420.9  | 410.9  |
| 80°    | 336.9  | 333.3  | 326.5  | 316.5  | 309.8  |
| 82.5°  | 229.0  | 229.0  | 225.8  | 212.2  | 212.2  |
| 85°    | 137.9  | 134.7  | 131.5  | 121.1  | 117.9  |
| 87.5°  | 60.7   | 53.9   | 47.2   | 37.2   | 33.6   |
| 90°    | 2.3    | 27.5   | 74.8   | 70.2   | 72.5   |
| 92.5°  | 47.3   | 64.1   | 66.4   | 68.6   | 68.6   |
| 95°    | 111.4  | 132.7  | 136.5  | 136.5  | 132.7  |
| 97.5°  | 185.4  | 205.2  | 213.6  | 213.6  | 213.6  |
| 100°   | 270.8  | 288.3  | 294.4  | 294.4  | 292.1  |
| 102.5° | 360.8  | 373.8  | 382.1  | 384.4  | 382.1  |
| 105°   | 459.2  | 465.3  | 469.9  | 473.7  | 473.7  |
| 107.5° | 556.8  | 566.0  | 566.0  | 567.5  | 556.8  |
| 110°   | 651.4  | 663.6  | 663.6  | 663.6  | 657.5  |

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 753.6  | 766.6  | 764.3  | 758.2  | 753.6  |
| 115°   | 854.3  | 866.5  | 862.7  | 860.4  | 854.3  |
| 117.5° | 954.2  | 971.0  | 960.3  | 954.2  | 948.1  |
| 120°   | 1054.9 | 1071.7 | 1054.9 | 1054.9 | 1048.0 |
| 122.5° | 1146.4 | 1167.8 | 1157.1 | 1151.0 | 1146.4 |
| 125°   | 1242.5 | 1261.6 | 1255.5 | 1248.6 | 1246.4 |
| 127.5° | 1336.4 | 1360.0 | 1351.6 | 1342.5 | 1336.4 |
| 130°   | 1424.1 | 1451.5 | 1447.7 | 1443.2 | 1434.8 |
| 132.5° | 1522.5 | 1543.8 | 1545.4 | 1534.7 | 1528.6 |
| 135°   | 1607.1 | 1630.8 | 1635.4 | 1633.1 | 1627.0 |
| 137.5° | 1701.7 | 1720.8 | 1724.6 | 1723.1 | 1713.9 |
| 140°   | 1784.9 | 1803.9 | 1814.6 | 1814.6 | 1806.2 |
| 142.5° | 1870.3 | 1889.4 | 1895.5 | 1897.8 | 1889.4 |
| 145°   | 1951.2 | 1966.4 | 1978.6 | 1980.9 | 1972.5 |
| 147.5° | 2023.6 | 2042.7 | 2051.8 | 2055.7 | 2047.3 |
| 150°   | 2098.4 | 2111.3 | 2119.7 | 2126.6 | 2119.7 |
| 152.5° | 2164.7 | 2177.7 | 2188.4 | 2196.8 | 2188.4 |
| 155°   | 2231.1 | 2237.2 | 2244.1 | 2254.7 | 2247.9 |
| 157.5° | 2288.3 | 2292.9 | 2296.7 | 2311.9 | 2301.3 |
| 160°   | 2339.4 | 2344.0 | 2346.3 | 2359.2 | 2350.1 |
| 162.5° | 2386.7 | 2386.7 | 2389.0 | 2403.5 | 2392.8 |
| 165°   | 2427.1 | 2424.8 | 2424.8 | 2440.1 | 2429.4 |
| 167.5° | 2463.7 | 2456.9 | 2456.9 | 2472.1 | 2461.4 |
| 170°   | 2491.2 | 2485.1 | 2482.8 | 2498.1 | 2485.1 |
| 172.5° | 2510.3 | 2504.2 | 2501.9 | 2517.1 | 2504.2 |
| 175°   | 2525.5 | 2519.4 | 2514.8 | 2530.1 | 2517.1 |
| 177.5° | 2533.9 | 2527.8 | 2523.2 | 2536.2 | 2523.2 |
| 180°   | 2530.1 | 2530.1 | 2530.1 | 2530.1 | 2530.1 |

TEST NUMBER: P906536

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US835-FLLFLL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |       |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|-------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7   | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3   | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2   | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |       |       |       |       |
| X=2H            | Y=2H | 12.58            | 13.50 | 13.49 | 14.42 | 15.61 | 12.14          | 13.05 | 13.04 | 13.98 | 15.16 |
|                 | 3H   | 14.24            | 15.06 | 15.16 | 16.00 | 17.21 | 13.75          | 14.57 | 14.67 | 15.51 | 16.72 |
|                 | 4H   | 14.83            | 15.60 | 15.76 | 16.54 | 17.76 | 14.33          | 15.11 | 15.27 | 16.05 | 17.27 |
|                 | 6H   | 15.23            | 15.94 | 16.17 | 16.89 | 18.12 | 14.73          | 15.44 | 15.67 | 16.39 | 17.62 |
|                 | 8H   | 15.33            | 16.01 | 16.28 | 16.98 | 18.21 | 14.83          | 15.51 | 15.78 | 16.48 | 17.71 |
|                 | 12H  | 15.38            | 16.03 | 16.34 | 16.99 | 18.24 | 14.87          | 15.52 | 15.83 | 16.48 | 17.73 |
| 4H              | 2H   | 13.04            | 13.82 | 13.98 | 14.76 | 15.98 | 12.69          | 13.47 | 13.63 | 14.41 | 15.63 |
|                 | 3H   | 14.91            | 15.56 | 15.86 | 16.53 | 17.76 | 14.50          | 15.15 | 15.45 | 16.12 | 17.36 |
|                 | 4H   | 15.62            | 16.21 | 16.58 | 17.18 | 18.44 | 15.20          | 15.79 | 16.16 | 16.76 | 18.01 |
|                 | 6H   | 16.14            | 16.65 | 17.11 | 17.64 | 18.89 | 15.70          | 16.22 | 16.68 | 17.20 | 18.46 |
|                 | 8H   | 16.28            | 16.76 | 17.26 | 17.74 | 19.02 | 15.85          | 16.33 | 16.82 | 17.31 | 18.58 |
|                 | 12H  | 16.36            | 16.79 | 17.35 | 17.79 | 19.07 | 15.91          | 16.34 | 16.90 | 17.34 | 18.62 |
| 8H              | 4H   | 15.82            | 16.30 | 16.79 | 17.28 | 18.55 | 15.44          | 15.92 | 16.42 | 16.90 | 18.17 |
|                 | 6H   | 16.45            | 16.84 | 17.44 | 17.86 | 19.14 | 16.06          | 16.46 | 17.06 | 17.48 | 18.75 |
|                 | 8H   | 16.66            | 17.01 | 17.67 | 18.02 | 19.31 | 16.27          | 16.62 | 17.28 | 17.63 | 18.92 |
|                 | 12H  | 16.80            | 17.10 | 17.81 | 18.11 | 19.44 | 16.38          | 16.69 | 17.40 | 17.70 | 19.03 |
| 12H             | 4H   | 15.81            | 16.24 | 16.80 | 17.24 | 18.51 | 15.44          | 15.87 | 16.43 | 16.87 | 18.15 |
|                 | 6H   | 16.48            | 16.82 | 17.48 | 17.84 | 19.12 | 16.10          | 16.45 | 17.11 | 17.46 | 18.75 |
|                 | 8H   | 16.72            | 17.02 | 17.73 | 18.03 | 19.36 | 16.34          | 16.64 | 17.35 | 17.65 | 18.98 |