

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P331860-830

Luminaire Tested: **S122RDIW-S1005D1240U830-4F0-1E-UDD-F1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P331860-830
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-8,
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: NEO-RAY
Catalog Number: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1
Description: DEFINE 2 DIRECT-INDIRECT WALL MOUNT LED LUMINAIRE
DOWNLIGHT 1005 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER, REGRESSED
HOUSING
UPLIGHT 1240 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7338.2 lumens
Efficiency: N/A
Efficacy: 96.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: General Diffuse


Input Watts (W): 76.2
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

Luminous Intensity Polar Plot

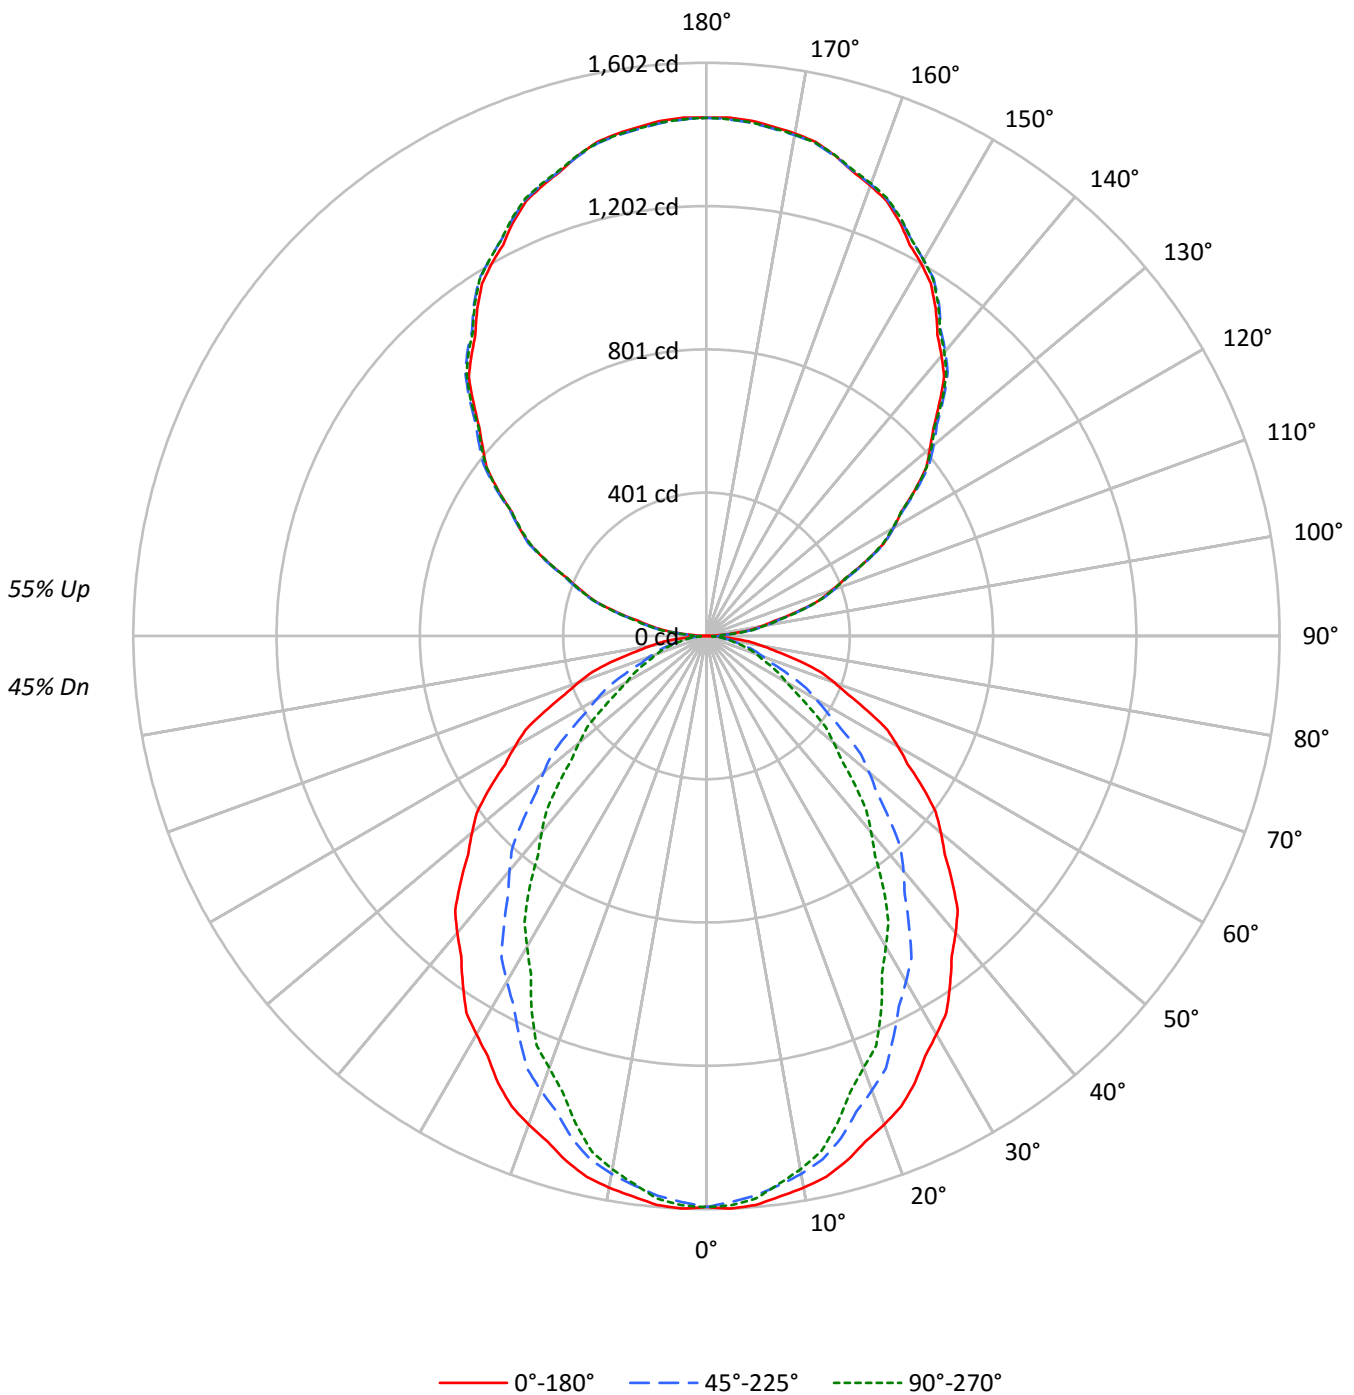



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51	45
1	97	93	89	86	89	85	82	79	71	69	67	58	57	55	46	45	44	39
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38	33
3	81	72	65	59	74	66	60	55	56	51	48	46	43	40	37	35	33	28
4	74	64	56	51	68	59	52	47	50	45	41	41	38	35	33	31	29	25
5	68	57	49	44	63	53	46	41	45	40	36	37	33	30	30	27	25	22
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	25	22	19
7	58	47	39	33	54	43	36	32	37	31	28	31	27	24	25	22	20	17
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18	16
9	51	39	31	27	46	36	30	25	31	26	22	26	22	19	21	19	16	14
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	25770	25770	25770
5°	25869	25449	25590
10°	25671	25032	24819
15°	25377	24289	23590
20°	24967	23230	22063
25°	24549	22026	20587
30°	23968	20789	18690
35°	23402	19446	17026
40°	22835	18054	15099
45°	22165	16493	13358
50°	21481	14913	11645
55°	20777	13216	10001
60°	19963	11428	8302
65°	19037	9605	7561
70°	17934	7912	6954
75°	16581	7211	6488
80°	14635	6453	5904
85°	11504	5076	5076



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.4	2.0
10°-20°	410.2	5.6
20°-30°	576.1	7.9
30°-40°	628.2	8.6
40°-50°	577.6	7.9
50°-60°	453.6	6.2
60°-70°	295.8	4.0
70°-80°	152.5	2.1
80°-90°	45.3	0.6
90°-100°	91.8	1.3
100°-110°	285.0	3.9
110°-120°	487.2	6.6
120°-130°	640.7	8.7
130°-140°	719.1	9.8
140°-150°	705.1	9.6
150°-160°	591.4	8.1
160°-170°	392.2	5.3
170°-180°	137.1	1.9
0°-30°	1135.7	15.5
0°-40°	1763.9	24.0
0°-60°	2795.1	38.1
0°-90°	3288.6	44.8
90°-120°	864.0	11.8
90°-150°	2928.8	39.9
90°-180°	4050.0	55.2
0°-180°	7338.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1596	1596	1596	1596	1596	
5°	1596	1588	1570	1582	1579	151
15°	1518	1500	1453	1426	1411	427
25°	1378	1329	1236	1179	1156	633
35°	1187	1111	987	899	864	743
45°	971	871	722	623	585	749
55°	738	623	470	386	355	659
65°	498	381	251	205	198	494
75°	266	168	116	106	104	281
85°	62	33	27	27	27	73
90°	1	17	43	40	42	6
95°	64	75	78	78	76	73
105°	263	266	269	271	271	277
115°	489	496	494	492	489	483
125°	711	721	719	715	714	635
135°	920	933	936	935	931	711
145°	1117	1126	1133	1134	1129	698
155°	1277	1281	1284	1290	1287	588
165°	1390	1388	1388	1396	1391	392
175°	1446	1442	1440	1447	1441	137
180°	1448	1448	1448	1448	1448	



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1
2.5°	1601.9	1600.6	1599.3	1598.1	1596.8	1594.7	1591.9	1589.1	1586.3	1583.5	1586.0
5°	1596.1	1594.5	1592.9	1591.3	1589.7	1586.9	1582.6	1578.5	1574.3	1570.2	1573.0
7.5°	1579.7	1577.7	1575.7	1573.7	1571.7	1568.3	1563.4	1558.5	1553.7	1548.8	1549.6
10°	1565.8	1563.6	1561.3	1559.1	1556.8	1552.5	1546.1	1539.6	1533.2	1526.8	1525.9
12.5°	1548.5	1545.7	1542.9	1540.2	1537.5	1531.9	1523.7	1515.5	1507.3	1499.1	1497.3
15°	1518.2	1514.6	1511.1	1507.5	1504.0	1496.8	1485.9	1475.0	1464.1	1453.1	1447.1
17.5°	1480.8	1475.5	1470.1	1464.7	1459.3	1449.6	1435.6	1421.6	1407.6	1393.6	1386.4
20°	1453.1	1446.7	1440.3	1433.9	1427.5	1416.3	1400.1	1384.1	1368.1	1352.0	1344.0
22.5°	1423.1	1415.9	1408.7	1401.6	1394.3	1381.7	1363.6	1345.5	1327.4	1309.3	1298.9
25°	1378.0	1367.7	1357.4	1347.2	1336.9	1321.3	1300.0	1278.8	1257.6	1236.4	1223.3
27.5°	1323.7	1312.6	1301.4	1290.2	1279.0	1261.5	1237.7	1213.7	1189.9	1166.0	1150.7
30°	1285.6	1273.4	1261.2	1249.0	1236.8	1217.9	1192.1	1166.5	1140.9	1115.1	1098.7
32.5°	1248.6	1234.4	1220.1	1205.9	1191.6	1171.4	1145.2	1119.0	1092.8	1066.6	1047.9
35°	1187.3	1171.0	1154.6	1138.2	1121.9	1099.6	1071.3	1043.1	1014.8	986.6	966.4
37.5°	1126.1	1108.1	1090.1	1072.1	1054.2	1030.2	1000.0	970.0	939.8	909.7	887.5
40°	1083.4	1064.1	1044.8	1025.6	1006.4	981.1	950.0	918.9	887.7	856.6	833.8
42.5°	1039.4	1019.2	998.9	978.5	958.3	932.1	899.9	867.7	835.6	803.4	779.9
45°	970.7	949.1	927.7	906.2	884.7	857.1	823.3	789.7	755.9	722.3	699.5
47.5°	903.6	880.9	858.1	835.3	812.5	783.7	748.9	714.1	679.3	644.5	621.9
50°	855.2	832.4	809.5	786.7	763.9	734.9	699.6	664.3	629.0	593.7	571.6
52.5°	807.8	783.9	760.2	736.3	712.5	683.3	648.8	614.3	579.7	545.2	523.8
55°	738.1	713.1	688.1	663.0	638.0	608.1	573.4	538.8	504.2	469.5	450.2
57.5°	666.8	641.1	615.4	589.7	564.0	534.5	501.2	467.9	434.6	401.2	383.6
60°	618.2	592.6	566.8	541.2	515.5	486.2	453.1	420.0	386.9	353.9	337.5
62.5°	570.9	545.2	519.5	493.8	468.2	439.5	408.0	376.5	345.0	313.5	297.8
65°	498.3	472.3	446.4	420.4	394.4	366.9	338.0	309.2	280.2	251.4	240.4
67.5°	428.4	402.7	376.8	351.0	325.2	299.3	273.3	247.3	221.3	195.3	190.3
70°	379.9	354.9	329.8	304.8	279.7	256.2	234.0	211.9	189.7	167.6	164.4
72.5°	333.7	309.6	285.7	261.6	237.6	216.7	199.0	181.2	163.3	145.6	142.9
75°	265.8	243.3	220.8	198.4	175.9	159.2	148.3	137.4	126.5	115.6	113.3
77.5°	199.1	179.4	159.7	140.0	120.2	107.7	102.5	97.2	91.9	86.7	85.4
80°	157.4	141.1	124.7	108.3	92.0	82.2	79.0	75.8	72.6	69.4	68.1
82.5°	119.3	106.5	93.8	81.0	68.2	60.7	58.5	56.4	54.2	52.0	51.3
85°	62.1	55.3	48.6	41.8	35.2	31.3	30.3	29.4	28.4	27.4	27.4
87.5°	18.8	17.3	15.9	14.5	13.1	13.0	14.2	15.4	16.6	17.8	17.4
90°	1.2	4.5	7.7	11.0	14.2	18.9	24.9	30.8	36.8	42.8	42.2
92.5°	21.8	24.1	26.6	28.9	31.3	33.2	34.6	36.0	37.4	38.8	38.9
95°	63.5	66.3	69.0	71.7	74.5	76.1	76.6	77.1	77.7	78.2	78.2
97.5°	116.1	118.5	120.9	123.3	125.6	127.3	128.4	129.4	130.4	131.5	131.5
100°	155.2	157.4	159.6	161.7	163.9	165.4	166.2	167.0	167.9	168.6	168.6
102.5°	196.2	198.0	199.7	201.5	203.2	204.6	205.7	206.7	207.7	208.8	209.0
105°	262.8	263.5	264.4	265.2	266.0	266.7	267.2	267.8	268.3	268.9	269.4
107.5°	329.7	330.9	332.2	333.3	334.5	335.1	335.1	335.1	335.1	335.1	335.4
110°	372.8	374.4	376.0	377.7	379.3	380.1	380.1	380.1	380.1	380.1	380.1



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

CANDELA DISTRIBUTION (continued):

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	419.7	421.3	422.9	424.6	426.2	426.9	426.7	426.5	426.2	426.0	425.4
115°	488.9	490.5	492.1	493.7	495.4	495.9	495.4	494.8	494.3	493.7	493.5
117.5°	557.8	560.0	562.1	564.3	566.5	566.8	565.2	563.7	562.2	560.7	560.1
120°	603.7	605.9	608.1	610.3	612.5	612.5	610.3	608.1	605.9	603.7	603.7
122.5°	645.7	648.4	651.0	653.6	656.2	656.8	655.3	653.7	652.1	650.6	650.0
125°	711.2	713.7	716.1	718.6	721.0	721.9	721.0	720.3	719.4	718.6	717.8
127.5°	775.1	778.2	781.3	784.4	787.5	788.5	787.6	786.6	785.6	784.6	783.6
130°	815.2	818.7	822.3	825.8	829.2	830.8	830.3	829.7	829.2	828.6	828.0
132.5°	860.2	863.0	865.9	868.7	871.7	873.2	873.3	873.4	873.5	873.5	872.4
135°	920.3	923.2	926.2	929.3	932.3	934.0	934.5	935.1	935.7	936.1	935.9
137.5°	983.5	986.0	988.4	990.9	993.3	994.9	995.6	996.4	997.0	997.8	997.6
140°	1021.7	1024.2	1026.6	1029.1	1031.5	1033.4	1034.7	1036.1	1037.5	1038.8	1038.8
142.5°	1060.8	1063.3	1065.7	1068.2	1070.6	1072.2	1073.2	1074.1	1075.1	1076.0	1076.2
145°	1117.0	1119.0	1120.9	1122.8	1124.6	1126.4	1128.0	1129.6	1131.3	1132.9	1133.2
147.5°	1167.2	1169.4	1171.7	1174.0	1176.3	1178.0	1179.0	1180.2	1181.2	1182.3	1182.9
150°	1201.4	1203.0	1204.7	1206.3	1207.9	1209.3	1210.3	1211.4	1212.5	1213.6	1214.4
152.5°	1231.7	1233.3	1234.9	1236.5	1238.2	1239.6	1241.0	1242.3	1243.6	1244.9	1245.9
155°	1277.1	1278.0	1278.7	1279.6	1280.4	1281.2	1282.0	1282.8	1283.6	1284.5	1285.8
157.5°	1316.0	1316.5	1317.1	1317.7	1318.1	1318.7	1319.2	1319.7	1320.1	1320.7	1322.5
160°	1339.4	1340.0	1340.6	1341.1	1341.6	1342.1	1342.3	1342.6	1342.8	1343.1	1344.7
162.5°	1360.9	1361.1	1361.2	1361.3	1361.4	1361.6	1361.9	1362.2	1362.4	1362.7	1364.5
165°	1389.6	1389.3	1389.0	1388.7	1388.5	1388.4	1388.4	1388.4	1388.4	1388.4	1390.3
167.5°	1413.5	1412.7	1411.9	1411.1	1410.2	1409.9	1409.8	1409.8	1409.7	1409.6	1411.6
170°	1426.3	1425.4	1424.7	1423.8	1423.0	1422.5	1422.2	1421.9	1421.6	1421.4	1423.2
172.5°	1435.0	1434.3	1433.4	1432.6	1431.8	1431.3	1431.0	1430.7	1430.4	1430.1	1432.1
175°	1445.8	1445.0	1444.2	1443.3	1442.6	1441.9	1441.3	1440.8	1440.2	1439.6	1441.6
177.5°	1450.2	1449.5	1448.9	1448.2	1447.6	1447.1	1446.6	1446.1	1445.8	1445.3	1446.6
180°	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1	1596.1
2.5°	1588.6	1591.1	1593.7	1594.7	1594.2	1593.7	1593.2	1592.7
5°	1575.9	1578.9	1581.7	1582.6	1581.7	1580.7	1579.8	1578.9
7.5°	1550.4	1551.2	1552.1	1551.7	1550.0	1548.3	1546.7	1545.0
10°	1524.8	1523.9	1523.0	1521.5	1519.6	1517.7	1515.7	1513.8
12.5°	1495.6	1493.8	1492.1	1489.7	1486.5	1483.3	1480.1	1476.9
15°	1441.0	1434.8	1428.7	1424.1	1420.9	1417.7	1414.5	1411.3
17.5°	1379.1	1371.9	1364.6	1358.2	1352.7	1347.2	1341.6	1336.1
20°	1336.0	1327.9	1319.9	1312.4	1305.3	1298.3	1291.2	1284.1
22.5°	1288.6	1278.3	1267.9	1260.1	1254.9	1249.6	1244.3	1239.1
25°	1210.1	1197.0	1183.8	1174.9	1170.0	1165.2	1160.4	1155.6
27.5°	1135.3	1119.9	1104.6	1093.1	1085.4	1077.8	1070.2	1062.5
30°	1082.4	1066.0	1049.6	1037.2	1028.5	1019.8	1011.2	1002.5
32.5°	1029.3	1010.6	991.8	978.5	970.3	962.1	953.9	945.8
35°	946.1	926.0	905.7	892.0	885.0	877.9	870.8	863.8
37.5°	865.2	842.9	820.6	805.4	797.4	789.3	781.2	773.1
40°	811.0	788.2	765.4	749.9	741.5	733.1	724.8	716.4
42.5°	756.3	732.7	709.2	693.3	685.2	677.1	669.1	661.0
45°	676.7	653.8	631.0	615.9	608.1	600.4	592.7	585.0
47.5°	599.2	576.6	553.8	539.0	532.1	525.1	518.0	511.0
50°	549.4	527.3	505.1	490.6	483.9	477.1	470.4	463.6
52.5°	502.4	481.0	459.7	445.8	439.6	433.4	427.2	420.9
55°	430.9	411.7	392.4	379.8	373.6	367.5	361.5	355.3
57.5°	366.0	348.3	330.6	319.2	314.1	309.0	303.9	298.7
60°	321.1	304.8	288.4	277.7	272.5	267.4	262.2	257.1
62.5°	282.3	266.6	251.1	241.7	238.7	235.5	232.4	229.4
65°	229.5	218.6	207.6	201.7	200.8	199.8	198.9	197.9
67.5°	185.3	180.3	175.2	172.2	171.3	170.2	169.2	168.1
70°	161.2	158.0	154.8	152.5	151.2	149.9	148.6	147.3
72.5°	140.3	137.5	134.8	133.1	132.3	131.6	130.7	130.0
75°	111.0	108.9	106.6	105.3	105.0	104.6	104.3	104.0
77.5°	84.1	82.8	81.5	80.6	80.1	79.6	79.1	78.6
80°	66.7	65.5	64.2	63.5	63.5	63.5	63.5	63.5
82.5°	50.4	49.7	48.9	48.5	48.5	48.5	48.5	48.5
85°	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4
87.5°	17.1	16.7	16.3	16.2	16.2	16.3	16.3	16.4
90°	41.7	41.2	40.6	40.4	40.7	41.0	41.3	41.6
92.5°	39.1	39.2	39.3	39.4	39.4	39.5	39.6	39.6
95°	78.2	78.2	78.2	77.9	77.4	76.8	76.3	75.8
97.5°	131.5	131.5	131.5	131.5	131.4	131.4	131.3	131.3
100°	168.6	168.6	168.6	168.5	168.2	168.0	167.7	167.4
102.5°	209.2	209.4	209.6	209.6	209.3	209.1	208.8	208.5
105°	269.9	270.5	271.1	271.4	271.4	271.4	271.4	271.4
107.5°	335.5	335.7	336.0	335.5	334.2	333.0	331.7	330.5
110°	380.1	380.1	380.1	379.7	378.9	378.1	377.2	376.5



TEST NUMBER: P331860-830

CATALOG NUMBER: S122RDIW-S1005D1240U830-4F0-1E-UDD-F1

CANDELA DISTRIBUTION (continued):

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	424.7	424.0	423.4	422.8	422.2	421.6	421.0	420.4
115°	493.2	492.9	492.7	492.1	491.3	490.5	489.7	488.9
117.5°	559.4	558.7	558.1	557.4	556.6	555.7	555.0	554.1
120°	603.7	603.7	603.7	603.3	602.5	601.7	600.9	600.1
122.5°	649.4	648.8	648.1	647.4	646.9	646.2	645.6	645.1
125°	717.0	716.1	715.4	714.8	714.5	714.3	714.0	713.7
127.5°	782.7	781.7	780.7	779.8	778.9	778.1	777.2	776.3
130°	827.6	827.0	826.4	825.7	824.5	823.5	822.4	821.2
132.5°	871.2	870.0	868.8	867.8	867.0	866.0	865.2	864.3
135°	935.7	935.4	935.1	934.5	933.7	932.9	932.1	931.2
137.5°	997.3	997.1	996.9	996.3	995.1	994.1	993.0	991.9
140°	1038.8	1038.8	1038.8	1038.3	1037.2	1036.1	1035.0	1034.0
142.5°	1076.4	1076.7	1076.9	1076.4	1075.3	1074.2	1073.2	1072.0
145°	1133.5	1133.8	1134.0	1133.6	1132.6	1131.4	1130.4	1129.3
147.5°	1183.5	1184.1	1184.7	1184.5	1183.5	1182.4	1181.4	1180.3
150°	1215.2	1216.1	1216.8	1216.8	1216.1	1215.2	1214.4	1213.6
152.5°	1247.0	1247.9	1249.0	1249.0	1247.9	1247.0	1245.9	1244.9
155°	1287.2	1288.5	1289.9	1290.2	1289.4	1288.5	1287.7	1286.9
157.5°	1324.4	1326.2	1328.0	1328.3	1327.0	1325.7	1324.4	1323.0
160°	1346.4	1348.0	1349.6	1349.9	1348.9	1347.7	1346.7	1345.6
162.5°	1366.4	1368.2	1370.1	1370.4	1369.0	1367.7	1366.4	1365.2
165°	1392.1	1394.0	1396.0	1396.2	1394.9	1393.5	1392.1	1390.8
167.5°	1413.4	1415.3	1417.2	1417.5	1416.1	1414.7	1413.2	1411.8
170°	1425.1	1427.0	1429.0	1429.1	1427.5	1425.9	1424.2	1422.6
172.5°	1434.0	1435.9	1437.8	1437.8	1436.2	1434.6	1433.0	1431.3
175°	1443.5	1445.4	1447.3	1447.5	1445.8	1444.2	1442.6	1440.9
177.5°	1447.9	1449.3	1450.5	1450.5	1449.3	1447.9	1446.6	1445.3
180°	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2	1448.2

(END OF REPORT)