

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: NEO-RAY

Report Number: P333105-930

Luminaire Tested: **S124RDIW-S1195D1050U930-4F0-1E-UDD-F**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-79-08  
Report Number: P333105-930  
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-6,  
Test Lab: INNOVATION CENTER  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: NEO-RAY  
Catalog Number: S124RDIW-S1195D1050U930-4F0-1E-UDD-F  
Description: DEFINE 4 DIRECT-INDIRECT WALL MOUNT LED LUMINAIRE  
DOWNLIGHT 1195 LUMENS PER FOOT, FLUSH SATIN WHITE DIFFUSER, REGRESSED  
HOUSING  
UPLIGHT 1050 LUMENS PER FOOT, NO LENS  
Light Source: -  
Ballast/Driver: ELECTRONIC DRIVER


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7347.8 lumens  
Efficiency: N/A  
Efficacy: 109.0 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.09 / 1.24  
Luminous Opening: Rectangular (W 0.33' x L: 4' x H: 0')  
CIE Type: General Diffuse  
  
Input Watts (W): 67.4  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P333105-930  
CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

### Luminous Intensity Polar Plot

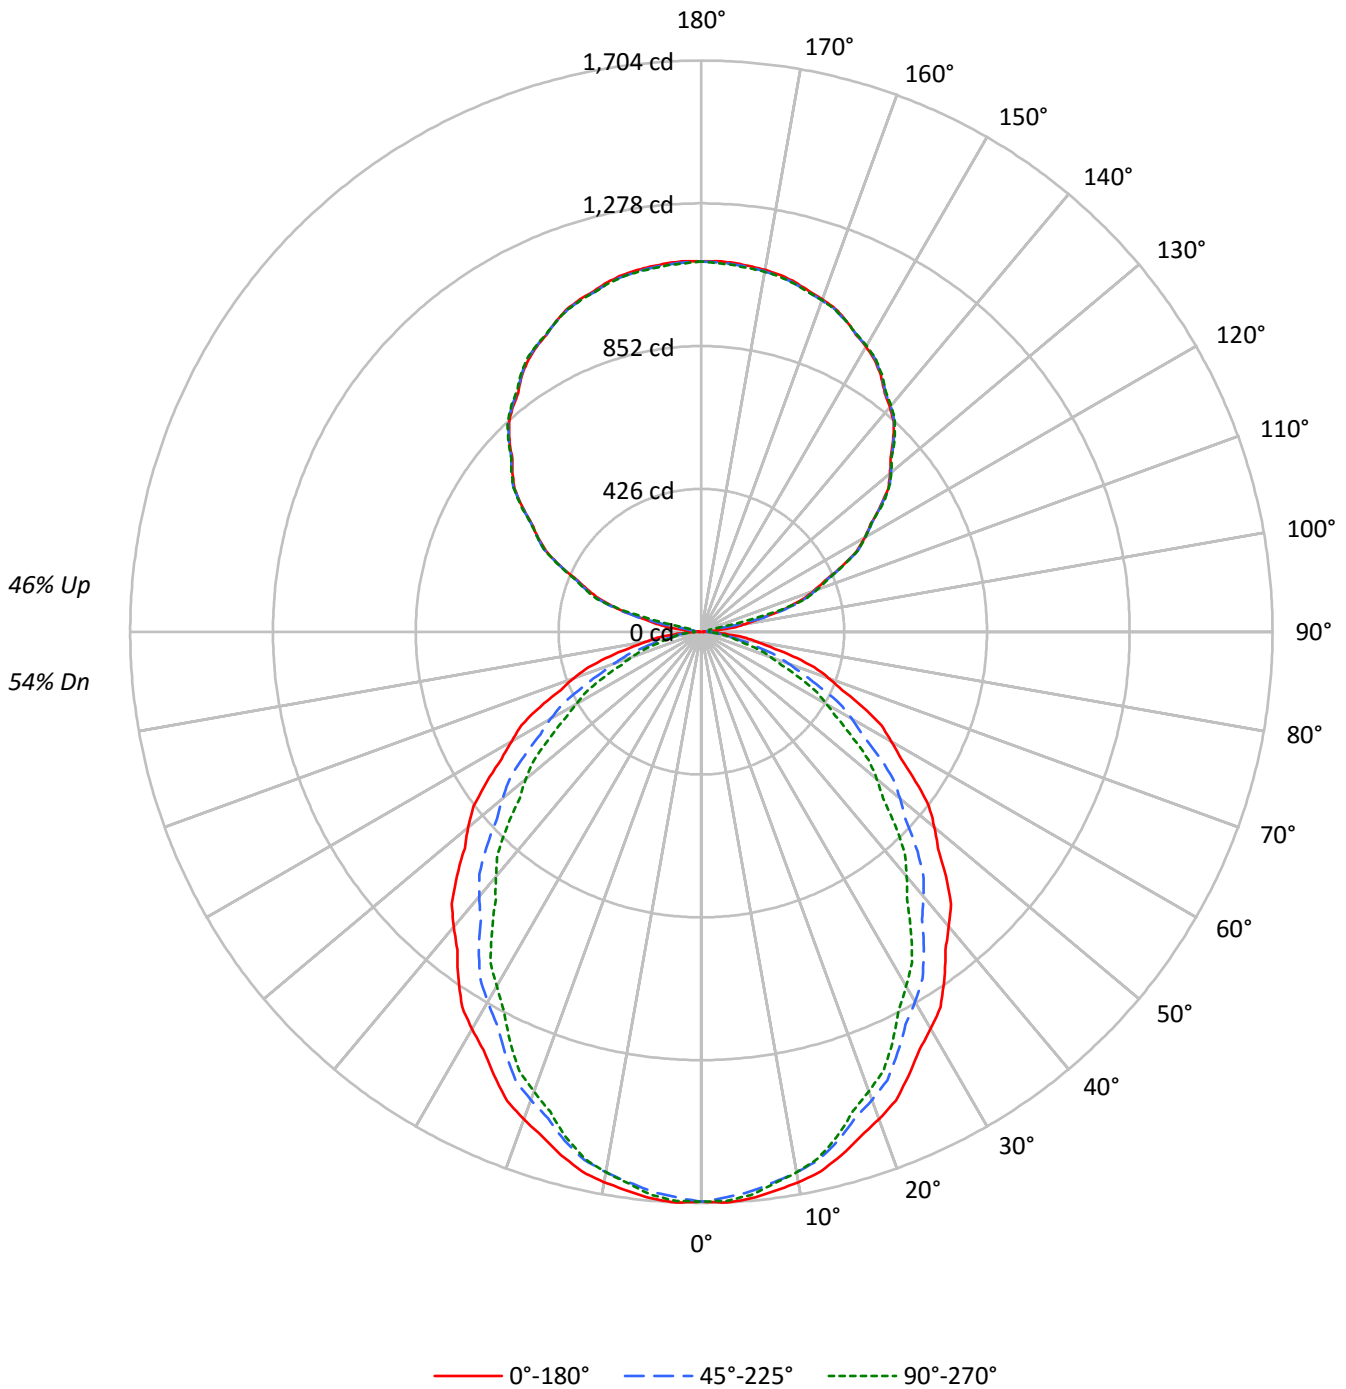



TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59	54
1	99	95	91	87	92	88	85	82	75	73	71	64	62	60	53	52	51	46
2	90	83	77	72	83	77	72	67	66	62	59	56	53	51	47	45	43	39
3	82	73	66	60	76	68	62	57	59	54	50	50	46	43	42	39	37	33
4	76	65	57	51	70	61	54	48	52	47	43	45	41	37	38	35	32	29
5	69	58	50	44	64	54	47	42	47	41	37	40	36	33	34	31	28	25
6	64	52	44	38	59	49	42	36	42	37	32	36	32	29	31	27	25	22
7	59	47	39	34	55	44	37	32	39	33	29	33	29	25	28	25	22	20
8	55	43	35	30	51	40	33	28	35	30	26	30	26	23	26	23	20	18
9	51	39	32	27	48	37	30	25	32	27	23	28	24	21	24	21	18	16
10	48	36	29	24	45	34	27	23	30	24	21	26	22	19	22	19	16	15

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	13726	13726	13726
5°	13757	13588	13674
10°	13671	13426	13426
15°	13514	13143	13046
20°	13298	12773	12538
25°	13023	12339	12026
30°	12755	11882	11384
35°	12458	11406	10738
40°	12101	10866	10043
45°	11772	10330	9334
50°	11396	9712	8584
55°	10994	9070	7769
60°	10551	8365	6936
65°	10147	7484	6117
70°	9557	6515	5193
75°	8812	5402	4223
80°	7685	4114	3873
85°	6512	3742	3492



TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	159.7	2.2
10°-20°	445.4	6.1
20°-30°	643.1	8.8
30°-40°	729.0	9.9
40°-50°	704.0	9.6
50°-60°	585.4	8.0
60°-70°	404.2	5.5
70°-80°	204.9	2.8
80°-90°	55.8	0.8
90°-100°	37.8	0.5
100°-110°	240.8	3.3
110°-120°	460.7	6.3
120°-130°	584.9	8.0
130°-140°	625.8	8.5
140°-150°	585.2	8.0
150°-160°	471.9	6.4
160°-170°	304.4	4.1
170°-180°	104.9	1.4
0°-30°	1248.2	17.0
0°-40°	1977.3	26.9
0°-60°	3266.6	44.5
0°-90°	3931.5	53.5
90°-120°	739.3	10.1
90°-150°	2535.2	34.5
90°-180°	3416.0	46.5
0°-180°	7347.8	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1700	1700	1700	1700	1700	
5°	1698	1692	1677	1689	1687	161
15°	1617	1604	1573	1570	1561	455
25°	1462	1437	1385	1364	1350	673
35°	1264	1221	1157	1114	1090	790
45°	1031	981	905	843	818	795
55°	781	727	644	579	552	698
65°	531	474	392	338	320	524
75°	282	234	173	144	135	298
85°	70	46	40	38	38	79
90°	2	11	18	23	25	5
95°	45	19	18	23	24	58
105°	249	254	258	263	236	260
115°	464	466	466	467	468	457
125°	653	656	654	657	658	582
135°	810	809	812	814	815	623
145°	933	936	936	937	938	583
155°	1023	1024	1022	1025	1023	472
165°	1080	1076	1076	1081	1075	305
175°	1104	1100	1100	1107	1098	105
180°	1104	1104	1104	1104	1104	



TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2
2.5°	1704.4	1703.5	1702.6	1701.6	1700.7	1699.0	1696.5	1693.9	1691.3	1688.8	1691.3
5°	1697.6	1696.5	1695.3	1694.2	1693.1	1690.7	1687.3	1683.8	1680.3	1676.8	1679.7
7.5°	1682.3	1681.1	1679.8	1678.6	1677.4	1674.5	1670.1	1665.6	1661.0	1656.5	1658.4
10°	1667.7	1666.2	1664.8	1663.4	1661.9	1658.6	1653.4	1648.2	1643.0	1637.8	1638.9
12.5°	1648.9	1647.3	1645.6	1643.9	1642.3	1638.3	1632.2	1626.1	1619.9	1613.8	1614.5
15°	1616.9	1614.3	1611.8	1609.2	1606.5	1601.6	1594.4	1587.1	1579.9	1572.6	1572.1
17.5°	1578.2	1574.3	1570.6	1566.8	1563.1	1556.9	1548.2	1539.5	1530.8	1522.2	1520.5
20°	1547.9	1544.2	1540.4	1536.7	1532.9	1526.1	1516.3	1506.4	1496.6	1486.8	1484.4
22.5°	1514.6	1510.4	1506.2	1501.9	1497.7	1490.4	1479.8	1469.3	1458.7	1448.2	1444.7
25°	1462.0	1456.8	1451.6	1446.4	1441.2	1432.6	1420.8	1408.9	1397.1	1385.2	1380.3
27.5°	1406.8	1400.3	1393.8	1387.2	1380.6	1371.1	1358.4	1345.7	1333.0	1320.4	1314.3
30°	1368.3	1361.1	1353.8	1346.5	1339.4	1328.9	1315.3	1301.7	1288.2	1274.6	1267.3
32.5°	1327.6	1319.5	1311.3	1303.2	1295.0	1283.9	1269.8	1255.8	1241.7	1227.7	1219.3
35°	1264.1	1254.8	1245.6	1236.3	1227.1	1215.2	1200.8	1186.3	1171.8	1157.4	1147.5
37.5°	1196.2	1186.6	1177.0	1167.5	1158.0	1145.2	1129.2	1113.1	1097.1	1081.1	1070.1
40°	1148.3	1138.7	1129.2	1119.7	1110.0	1097.1	1080.6	1064.0	1047.6	1031.1	1019.0
42.5°	1102.4	1092.4	1082.4	1072.4	1062.4	1048.8	1031.6	1014.4	997.3	980.1	967.7
45°	1031.1	1020.3	1009.7	999.0	988.3	974.2	956.9	939.6	922.2	904.8	890.6
47.5°	957.4	946.3	935.3	924.2	913.2	898.6	880.6	862.5	844.5	826.5	811.7
50°	907.4	896.1	884.8	873.6	862.3	847.3	828.8	810.3	791.8	773.3	758.9
52.5°	856.4	845.3	834.3	823.2	812.2	797.1	778.2	759.2	740.2	721.2	706.5
55°	781.1	769.6	758.0	746.4	734.8	719.7	700.8	682.1	663.2	644.4	629.4
57.5°	706.6	694.6	682.6	670.6	658.5	643.3	624.8	606.2	587.7	569.2	553.9
60°	653.5	642.0	630.4	618.8	607.2	592.2	573.7	555.2	536.6	518.1	503.1
62.5°	605.6	593.6	581.6	569.6	557.5	542.0	523.0	504.0	485.0	466.1	452.2
65°	531.2	518.7	506.3	493.8	481.4	465.9	447.4	428.9	410.4	391.8	379.4
67.5°	453.8	441.9	430.0	418.1	406.2	391.6	374.4	357.3	340.1	322.9	312.2
70°	404.9	392.7	380.6	368.4	356.3	341.9	325.5	309.0	292.5	276.0	266.4
72.5°	352.8	341.9	330.8	319.8	308.8	295.5	280.0	264.4	248.8	233.3	225.1
75°	282.5	271.8	261.1	250.4	239.7	227.6	213.9	200.3	186.8	173.2	166.5
77.5°	211.2	202.1	193.0	183.9	174.8	164.8	153.8	142.8	131.8	120.8	116.9
80°	165.3	156.9	148.5	140.1	131.8	123.3	114.5	105.9	97.2	88.5	87.6
82.5°	125.8	118.1	110.4	102.6	95.0	88.6	83.6	78.7	73.7	68.7	68.1
85°	70.3	64.5	58.7	52.9	47.1	43.9	43.0	42.1	41.3	40.4	39.8
87.5°	24.5	23.0	21.5	20.1	18.7	17.9	18.0	18.1	18.2	18.2	18.2
90°	2.4	4.5	6.5	8.6	10.5	12.3	13.8	15.2	16.7	18.2	19.2
92.5°	10.4	10.5	10.6	10.8	10.8	11.7	13.1	14.6	16.1	17.5	18.6
95°	45.4	39.2	32.9	26.7	20.5	17.4	17.6	17.8	18.0	18.2	19.2
97.5°	96.4	100.4	104.3	108.2	112.0	103.8	83.2	62.8	42.3	21.8	21.9
100°	135.5	138.8	142.1	145.4	148.7	137.7	112.3	87.0	61.7	36.4	33.3
102.5°	179.1	181.5	183.9	186.4	188.7	188.3	185.1	181.7	178.4	175.1	141.5
105°	248.7	249.7	250.9	251.9	253.1	254.0	254.9	255.9	256.8	257.7	259.3
107.5°	313.2	313.8	314.3	314.9	315.4	316.3	317.6	318.9	320.1	321.3	322.1
110°	356.9	357.4	357.9	358.5	359.1	359.9	361.0	362.1	363.2	364.3	364.7



TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**CANDELA DISTRIBUTION (continued):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
112.5°	399.2	400.1	401.1	402.1	403.1	403.9	404.4	404.9	405.4	405.9	405.9
115°	464.2	464.8	465.4	465.9	466.4	466.6	466.4	466.3	466.1	465.9	466.3
117.5°	522.9	523.6	524.3	525.1	525.8	526.4	526.8	527.2	527.6	528.0	527.9
120°	562.6	563.3	564.0	564.8	565.5	565.7	565.6	565.4	565.2	565.0	565.4
122.5°	599.6	600.0	600.4	600.9	601.3	601.7	601.9	602.2	602.4	602.7	602.9
125°	652.6	653.3	654.0	654.8	655.5	655.7	655.3	654.9	654.6	654.2	654.8
127.5°	702.8	703.0	703.2	703.4	703.5	704.0	704.9	705.7	706.5	707.4	707.4
130°	735.2	735.4	735.6	735.7	735.9	736.3	736.9	737.4	737.9	738.5	738.7
132.5°	764.9	765.2	765.6	765.9	766.2	766.8	767.4	768.2	768.8	769.6	769.7
135°	809.5	809.3	809.2	808.9	808.8	809.1	809.8	810.6	811.3	812.0	812.4
137.5°	849.0	849.1	849.1	849.2	849.3	849.7	850.5	851.3	852.2	853.0	853.4
140°	874.8	875.1	875.5	875.9	876.3	876.6	877.0	877.3	877.8	878.1	878.6
142.5°	897.9	898.5	899.2	899.9	900.6	901.0	901.2	901.4	901.6	901.9	902.3
145°	933.4	934.0	934.5	935.1	935.6	935.9	935.9	935.9	935.9	935.9	936.1
147.5°	961.6	962.7	963.8	964.7	965.8	966.2	966.0	965.9	965.6	965.5	965.6
150°	982.2	982.9	983.7	984.4	985.1	985.4	985.2	985.0	984.8	984.6	984.6
152.5°	999.3	1000.0	1000.5	1001.1	1001.7	1001.8	1001.5	1001.2	1000.9	1000.5	1000.8
155°	1023.4	1023.7	1023.9	1024.0	1024.2	1024.0	1023.4	1023.0	1022.4	1021.8	1022.5
157.5°	1043.8	1043.7	1043.6	1043.4	1043.3	1043.0	1042.4	1041.7	1041.1	1040.5	1041.5
160°	1055.6	1055.2	1054.6	1054.0	1053.4	1053.1	1053.0	1052.7	1052.6	1052.4	1053.4
162.5°	1066.2	1065.6	1064.9	1064.1	1063.5	1063.0	1062.8	1062.7	1062.5	1062.3	1063.4
165°	1079.6	1078.7	1077.8	1076.8	1076.0	1075.5	1075.5	1075.5	1075.5	1075.5	1077.0
167.5°	1090.2	1089.2	1088.3	1087.4	1086.4	1085.9	1085.7	1085.7	1085.6	1085.4	1087.0
170°	1096.2	1095.0	1094.0	1092.8	1091.8	1091.3	1091.4	1091.7	1091.8	1092.0	1093.5
172.5°	1100.1	1099.0	1097.9	1096.8	1095.7	1095.3	1095.4	1095.6	1095.8	1096.0	1097.5
175°	1104.4	1103.3	1102.2	1101.1	1100.0	1099.6	1099.8	1099.9	1100.1	1100.3	1102.0
177.5°	1106.4	1105.4	1104.3	1103.3	1102.3	1102.0	1102.2	1102.5	1102.8	1103.1	1104.2
180°	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4



TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2	1700.2
2.5°	1693.9	1696.5	1699.0	1700.1	1699.9	1699.7	1699.4	1699.2
5°	1682.6	1685.5	1688.4	1689.5	1689.0	1688.4	1687.8	1687.3
7.5°	1660.2	1662.1	1663.9	1664.4	1663.5	1662.6	1661.6	1660.7
10°	1640.1	1641.2	1642.4	1642.4	1641.2	1640.1	1638.9	1637.8
12.5°	1615.2	1615.9	1616.6	1616.1	1614.5	1612.9	1611.3	1609.6
15°	1571.5	1570.9	1570.3	1569.0	1567.0	1565.0	1563.0	1561.0
17.5°	1518.9	1517.3	1515.6	1513.4	1510.3	1507.2	1504.1	1501.0
20°	1482.1	1479.8	1477.5	1474.5	1470.7	1467.0	1463.1	1459.4
22.5°	1441.3	1437.8	1434.4	1431.1	1428.0	1424.9	1421.9	1418.8
25°	1375.3	1370.4	1365.5	1361.6	1358.7	1355.8	1352.9	1350.1
27.5°	1308.2	1302.1	1296.1	1290.9	1286.8	1282.6	1278.5	1274.3
30°	1260.0	1252.9	1245.6	1239.7	1235.0	1230.4	1225.8	1221.2
32.5°	1210.9	1202.5	1194.1	1187.7	1183.3	1178.9	1174.5	1170.1
35°	1137.7	1127.9	1118.0	1110.5	1105.3	1100.1	1094.9	1089.6
37.5°	1059.1	1048.1	1037.1	1029.0	1023.8	1018.6	1013.4	1008.2
40°	1006.8	994.7	982.5	973.8	968.6	963.4	958.2	953.0
42.5°	955.3	942.9	930.5	921.6	916.2	910.8	905.3	899.8
45°	876.4	862.3	848.1	838.4	833.2	828.0	822.8	817.6
47.5°	797.0	782.4	767.7	757.4	751.7	746.0	740.2	734.5
50°	744.4	729.9	715.4	705.5	700.0	694.5	689.0	683.5
52.5°	691.9	677.2	662.4	652.2	646.5	640.8	635.0	629.3
55°	614.3	599.3	584.2	574.0	568.5	563.0	557.5	552.0
57.5°	538.7	523.3	508.1	498.4	494.2	490.0	485.8	481.7
60°	488.0	473.0	458.0	448.2	443.5	438.9	434.2	429.6
62.5°	438.3	424.4	410.5	401.7	398.0	394.4	390.6	386.9
65°	367.0	354.6	342.1	334.1	330.7	327.2	323.8	320.2
67.5°	301.5	290.7	280.1	272.8	269.0	265.1	261.3	257.5
70°	256.9	247.4	237.8	231.6	228.7	225.8	222.9	220.0
72.5°	217.0	208.8	200.6	195.3	192.6	190.0	187.3	184.6
75°	159.9	153.2	146.5	142.4	140.6	138.8	137.1	135.4
77.5°	113.1	109.2	105.3	103.1	102.6	102.1	101.6	101.0
80°	86.8	85.9	85.0	84.5	84.2	83.9	83.6	83.3
82.5°	67.5	66.9	66.2	65.7	65.5	65.1	64.9	64.6
85°	39.2	38.6	38.1	37.7	37.7	37.7	37.7	37.7
87.5°	18.2	18.2	18.2	18.3	18.6	18.9	19.2	19.6
90°	20.4	21.4	22.6	23.3	23.6	24.1	24.4	24.8
92.5°	19.7	20.8	21.9	22.5	22.6	22.7	22.7	22.8
95°	20.4	21.4	22.6	23.2	23.4	23.6	23.8	24.0
97.5°	22.0	22.2	22.3	22.4	22.6	22.7	22.9	23.2
100°	30.1	27.0	23.9	22.4	22.6	22.7	22.9	23.2
102.5°	107.8	74.1	40.4	23.6	23.6	23.7	23.7	23.8
105°	261.1	262.7	264.3	261.9	255.3	248.7	242.1	235.5
107.5°	322.9	323.8	324.6	325.3	326.0	326.7	327.4	328.1
110°	365.0	365.4	365.7	366.2	366.8	367.3	367.9	368.4





TEST NUMBER: P333105-930

CATALOG NUMBER: S124RDIW-S1195D1050U930-4F0-1E-UDD-F

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
112.5°	405.8	405.7	405.6	405.9	406.7	407.3	408.1	408.7
115°	466.6	467.0	467.3	467.6	467.6	467.6	467.6	467.6
117.5°	527.8	527.8	527.7	527.7	527.6	527.5	527.4	527.3
120°	565.7	566.1	566.5	566.5	566.1	565.7	565.4	565.0
122.5°	603.2	603.3	603.6	603.5	603.2	602.8	602.4	602.0
125°	655.3	655.9	656.4	656.8	657.0	657.1	657.4	657.5
127.5°	707.2	707.1	706.9	706.9	706.7	706.5	706.4	706.3
130°	738.8	739.1	739.2	739.3	739.3	739.3	739.3	739.3
132.5°	769.9	770.1	770.3	770.3	770.1	770.0	769.9	769.7
135°	812.8	813.1	813.5	813.8	814.2	814.6	815.0	815.3
137.5°	853.8	854.2	854.6	854.8	854.6	854.5	854.4	854.3
140°	879.2	879.7	880.3	880.7	880.8	881.0	881.2	881.4
142.5°	902.7	903.1	903.5	903.7	903.8	903.8	903.8	903.8
145°	936.3	936.5	936.6	936.9	937.3	937.7	938.0	938.4
147.5°	965.8	965.9	966.0	966.2	966.5	966.6	966.8	966.9
150°	984.6	984.6	984.6	984.7	984.9	985.1	985.3	985.5
152.5°	1001.1	1001.4	1001.7	1001.8	1001.7	1001.5	1001.4	1001.4
155°	1023.3	1024.0	1024.7	1024.8	1024.3	1023.8	1023.2	1022.6
157.5°	1042.4	1043.3	1044.3	1044.3	1043.3	1042.4	1041.5	1040.5
160°	1054.6	1055.6	1056.8	1056.8	1055.6	1054.6	1053.4	1052.4
162.5°	1064.5	1065.6	1066.7	1066.7	1065.4	1064.1	1062.9	1061.6
165°	1078.5	1079.9	1081.4	1081.2	1079.6	1078.0	1076.4	1074.6
167.5°	1088.7	1090.3	1091.8	1091.8	1090.0	1088.1	1086.3	1084.4
170°	1094.9	1096.4	1097.9	1097.7	1095.8	1094.1	1092.2	1090.4
172.5°	1098.9	1100.4	1101.9	1101.6	1099.6	1097.6	1095.7	1093.6
175°	1103.6	1105.2	1106.9	1106.6	1104.4	1102.2	1100.0	1097.8
177.5°	1105.5	1106.6	1107.8	1107.5	1105.7	1104.0	1102.2	1100.5
180°	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4	1104.4

(END OF REPORT)