

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P436718

Luminaire Tested: **LSSQ1B08509035D010TExxSL**

Issue Date: 12/2/2020

Test Information

Test Method: LM-41-14
Report Number: P436718
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2010-014-3)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 12/2/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSSQ1B08509035D010TExxSL
Description: PORTFOLIO 1INCH CYLINDER, 50 DEG REFLECTOR OPTIC
Light Source: HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 963.5 lumens
Efficiency: N/A
Efficacy: 58.4 lumens/watt
Spacing Criteria (0/90/45): 0.96 / 0.96 / 0.9
Luminous Opening: Rectangular (W 0.08' x L: 0.08' x H: 0')
CIE Type: Direct


Input Watts (W): 16.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P436718

CATALOG NUMBER: LSSQ1B08509035D010TExxSL

Luminous Intensity Polar Plot

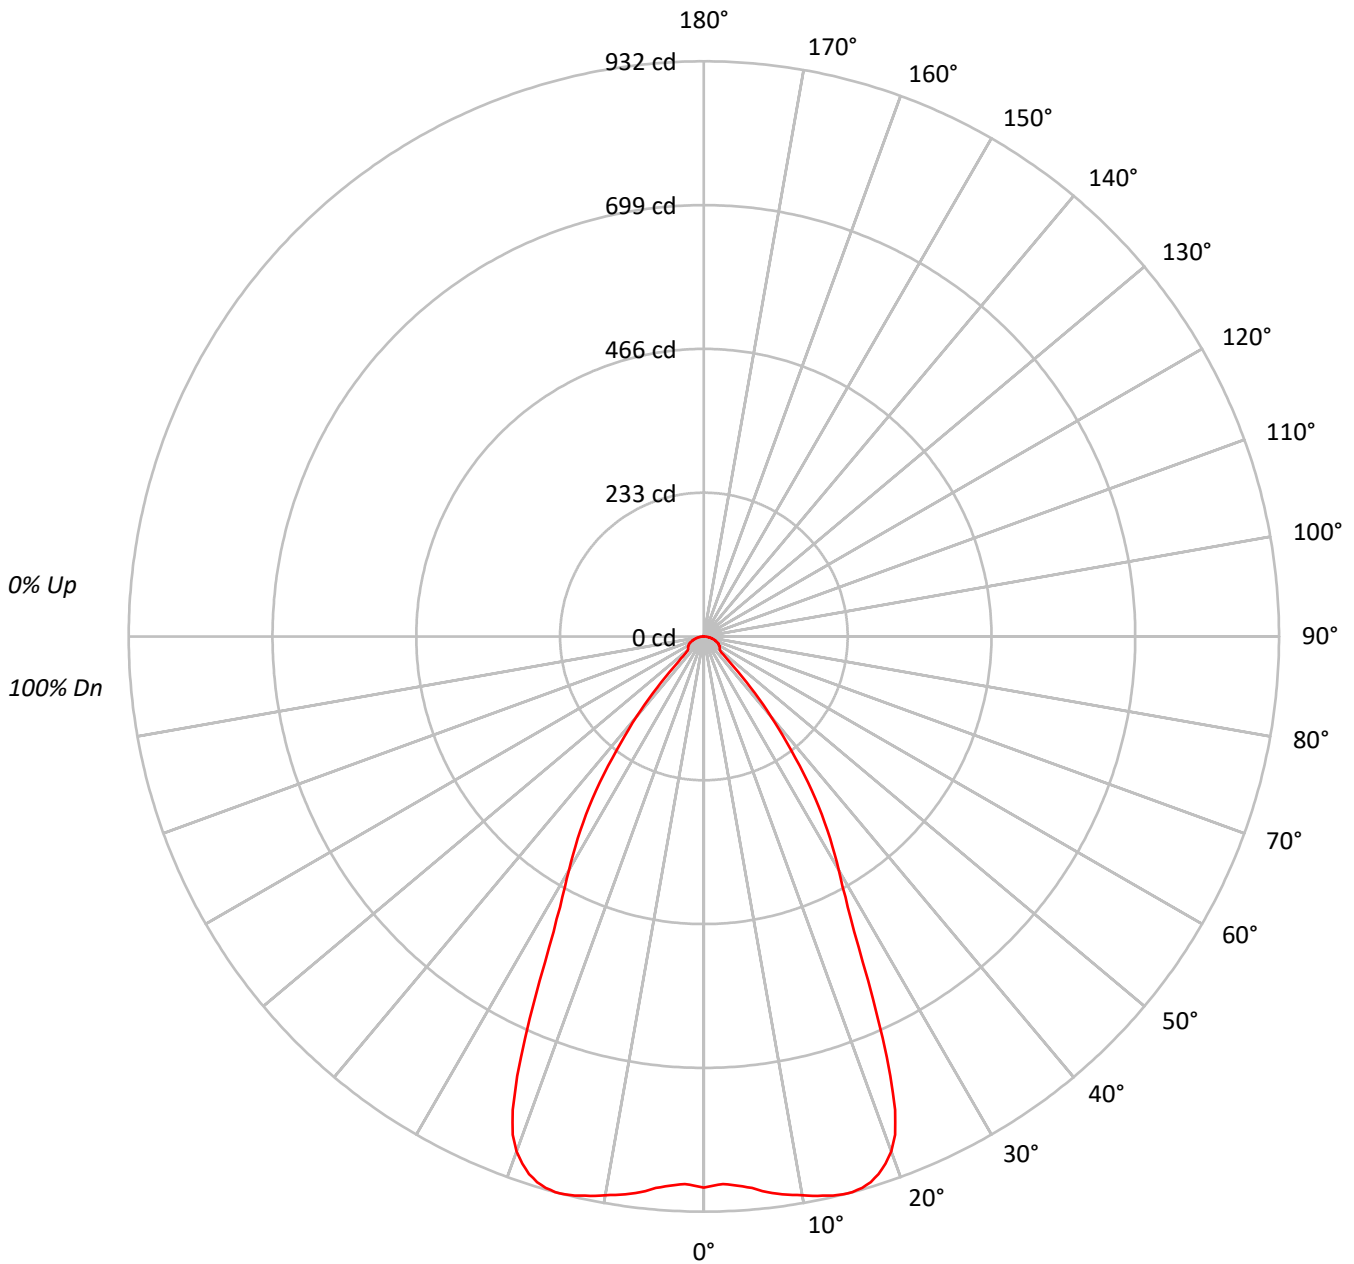



TEST NUMBER: P436718

CATALOG NUMBER: LSSQ1B08509035D010TExxSL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																											
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92																											
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84																											
3	101	94	88	84	99	92	87	83	89	85	82	87	83	80	85	82	79	77																											
4	95	87	81	76	93	86	80	76	84	79	75	81	77	74	80	76	73	72																											
5	90	81	75	70	88	80	74	70	78	73	69	77	72	69	75	71	68	66																											
6	85	76	69	65	84	75	69	65	73	68	64	72	67	64	71	66	63	62																											
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58																											
8	77	67	61	56	76	66	60	56	65	60	56	64	59	56	63	59	55	54																											
9	73	63	57	53	72	62	57	52	61	56	52	61	56	52	60	55	52	51																											
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48																											

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1395450
5°	1407211
10°	1458386
15°	1507277
20°	1476194
25°	1117844
30°	788614
35°	582530
40°	345520
45°	131697
50°	81431
55°	85537
60°	88124
65°	92798
70°	90911
75°	88140
80°	84581
85°	75295



TEST NUMBER: P436718

CATALOG NUMBER: LSSQ1B08509035D010TExxSL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	86.5	9.0
10°-20°	261.0	27.1
20°-30°	297.0	30.8
30°-40°	187.2	19.4
40°-50°	58.9	6.1
50°-60°	28.0	2.9
60°-70°	24.3	2.5
70°-80°	15.7	1.6
80°-90°	5.0	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	644.5	66.9
0°-40°	831.7	86.3
0°-60°	918.5	95.3
0°-90°	963.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	963.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	893	
5°	897	87
15°	932	261
25°	648	297
35°	305	187
45°	60	59
55°	31	28
65°	25	24
75°	15	16
85°	4	5
90°	0	



TEST NUMBER: P436718

CATALOG NUMBER: LSSQ1B08509035D010TExxSL

CANDELA DISTRIBUTION (FULL):

	0°
0°	893.1
1°	889.9
2°	887.8
3°	889.9
4°	893.1
5°	897.2
6°	903.5
7°	908.7
8°	912.9
9°	916.1
10°	919.2
11°	923.4
12°	926.5
13°	929.7
14°	931.8
15°	931.8
16°	929.7
17°	924.4
18°	916.1
19°	903.5
20°	887.8
21°	864.8
22°	827.2
23°	773.8
24°	712.1
25°	648.4
26°	587.7
27°	536.5
28°	496.7
29°	464.3
30°	437.1
32.5°	373.3
35°	305.4
37.5°	231.1
40°	169.4
42.5°	111.9
45°	59.6
47.5°	38.7
50°	33.5
52.5°	32.4
55°	31.4
57.5°	30.3
60°	28.2



TEST NUMBER: P436718

CATALOG NUMBER: LSSQ1B08509035D010TExxSL

CANDELA DISTRIBUTION (continued):

	0°
67.5°	22.0
70°	19.9
72.5°	17.8
75°	14.6
77.5°	12.5
80°	9.4
82.5°	7.3
85°	4.2
87.5°	2.1
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







62.5°		27.2
65°		25.1



(END OF REPORT)