

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P402529

Luminaire Tested: **LD1MRT52D010TR509040MMS1MW**

Issue Date: 6/3/2020



**Test Information**

Test Method: LM-41-14  
Report Number: P402529  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1912-604-8)  
Test Lab: INNOVATION CENTER (G3)  
Issue Date: 6/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LD1MRT52D010TR509040MMS1MW  
Description: 1 INCH 50° OPTIC WITH MATTE METALIC SILVER BAFFLE  
Light Source: HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1085.2 lumens  
Efficiency: N/A  
Efficacy: 89.7 lumens/watt  
Spacing Criteria (0/90/45): 0.77 / 0.77 / 0.71  
Luminous Opening: Rectangular (W 0.1' x L: 1.29' x H: 0')  
CIE Type: Direct

Input Watts (W): 12.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P402529

CATALOG NUMBER: LD1MRT52D010TR509040MMS1MW

### Luminous Intensity Polar Plot

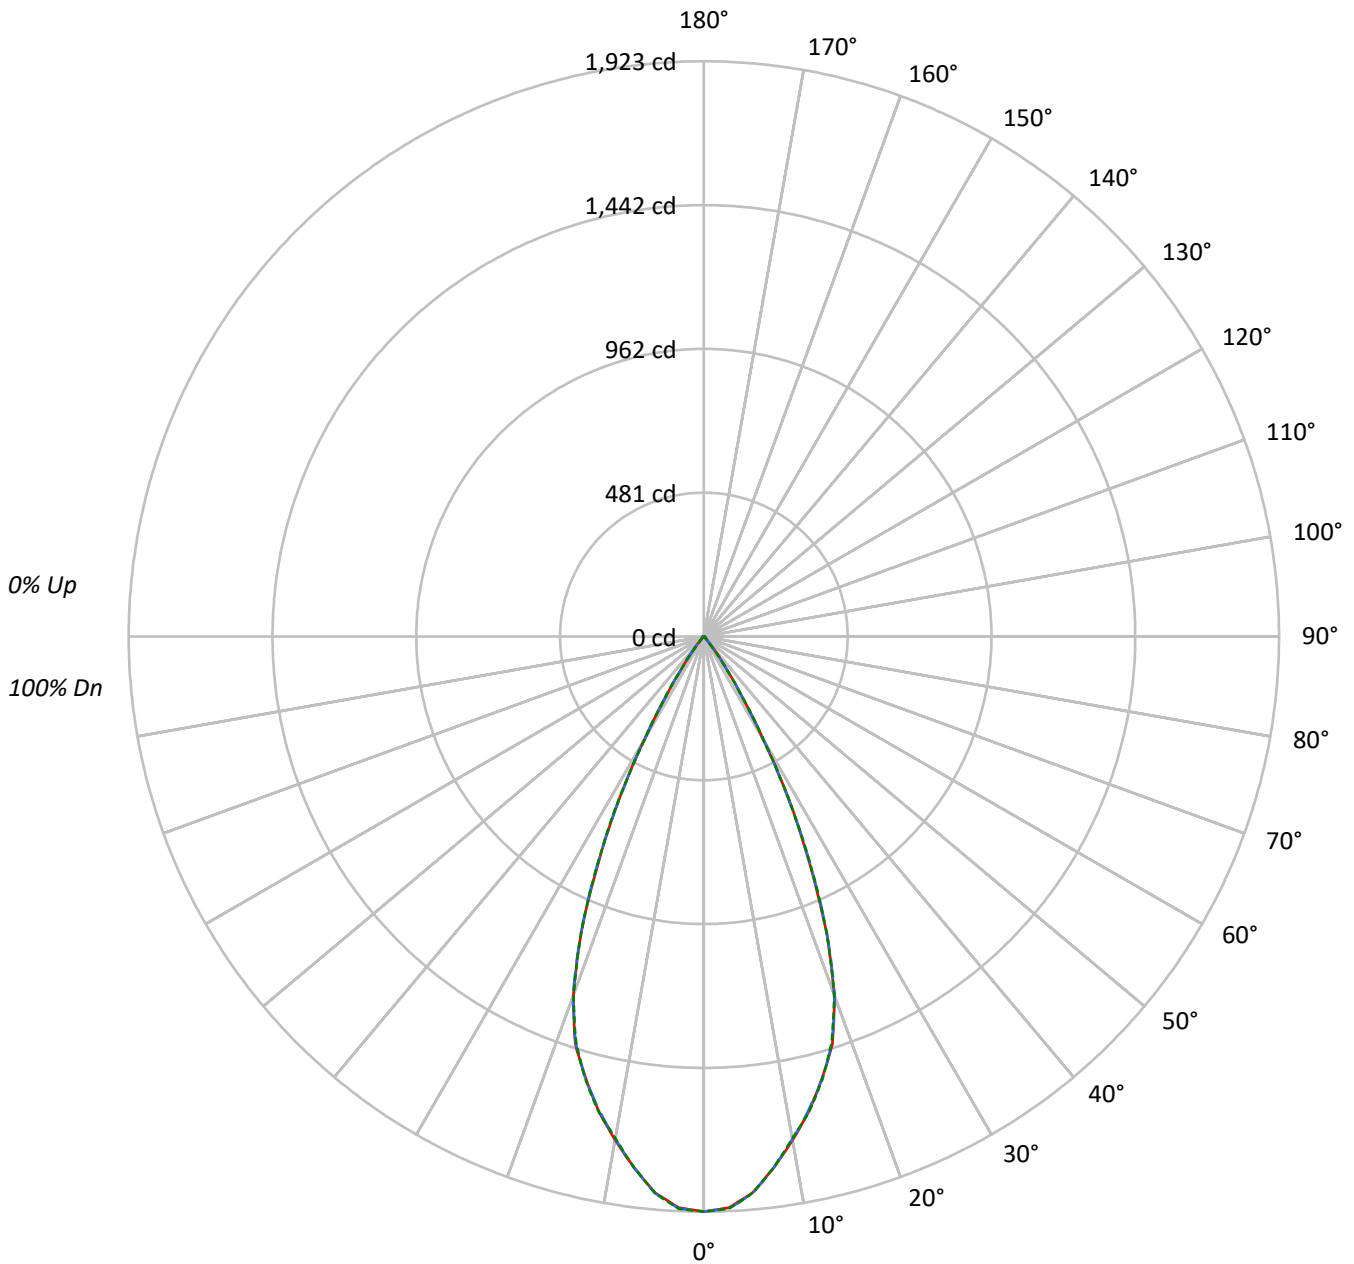



TEST NUMBER: P402529

CATALOG NUMBER: LD1MRT52D010TR509040MMS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95																			
2	110	105	102	99	107	104	100	98	100	98	96	98	95	94	95	93	92	90																			
3	105	99	95	92	103	98	94	91	96	92	90	93	90	88	91	89	87	85																			
4	101	94	89	86	99	93	89	85	91	87	84	89	86	83	87	85	82	81																			
5	97	89	84	81	95	89	84	80	87	83	80	85	82	79	84	81	78	77																			
6	93	85	80	76	91	84	79	76	83	79	75	82	78	75	80	77	75	73																			
7	89	81	76	72	88	80	76	72	79	75	72	78	74	71	77	74	71	70																			
8	85	77	72	69	84	77	72	69	76	71	68	75	71	68	74	70	68	67																			
9	82	74	69	65	81	73	69	65	73	68	65	72	68	65	71	67	65	64																			
10	79	71	66	62	78	70	66	62	70	65	62	69	65	62	68	64	62	61																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	153808	153808	153808
5°	149914	150115	150027
10°	138813	138610	138382
15°	126527	126676	126850
20°	108529	108861	108444
25°	73564	74474	74350
30°	36442	36673	36544
35°	12169	12247	11514
40°	2778	2705	2339
45°	1086	1211	1007
50°	884	933	797
55°	795	795	697
60°	624	688	576
65°	398	473	341
70°	0	94	0
75°	0	0	0
80°	0	0	0
85°	0	0	0



TEST NUMBER: P402529

CATALOG NUMBER: LD1MRT52D010TR509040MMS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	173.1	15.9
10°-20°	424.3	39.1
20°-30°	377.7	34.8
30°-40°	94.3	8.7
40°-50°	9.0	0.8
50°-60°	4.9	0.5
60°-70°	2.0	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	975.0	89.8
0°-40°	1069.3	98.5
0°-60°	1083.2	99.8
0°-90°	1085.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1085.2	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1923	1923	1923	1923	1923	
5°	1867	1874	1869	1868	1868	173
15°	1528	1536	1530	1527	1532	424
25°	833	843	844	849	842	376
35°	125	129	125	124	118	94
45°	10	10	11	9	9	9
55°	6	6	6	5	5	5
65°	2	2	2	2	2	2
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P402529

CATALOG NUMBER: LD1MRT52D010TR509040MMS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	1922.6	1922.6	1922.6	1922.6	1922.6
2.5°	1911.6	1920.1	1914.0	1914.4	1914.7
5°	1866.8	1873.6	1869.3	1867.9	1868.2
7.5°	1791.2	1797.2	1790.5	1792.9	1790.1
10°	1708.8	1714.8	1706.3	1706.3	1703.5
12.5°	1625.0	1631.4	1621.1	1620.0	1626.8
15°	1527.7	1535.5	1529.5	1526.6	1531.6
17.5°	1429.3	1428.2	1424.7	1422.9	1421.1
20°	1274.8	1281.2	1278.7	1268.1	1273.8
22.5°	1071.7	1072.1	1075.6	1077.4	1072.8
25°	833.4	842.7	843.7	849.4	842.3
27.5°	617.5	619.3	609.7	610.4	617.2
30°	394.5	399.9	397.0	399.9	395.6
32.5°	227.6	232.2	230.5	232.6	233.0
35°	124.6	129.3	125.4	123.6	117.9
37.5°	61.8	61.8	63.2	58.2	55.4
40°	26.6	27.3	25.9	24.5	22.4
42.5°	13.5	13.5	14.2	12.1	11.7
45°	9.6	9.6	10.7	9.2	8.9
47.5°	8.2	8.2	8.9	7.8	7.5
50°	7.1	7.1	7.5	6.7	6.4
52.5°	6.4	6.4	6.7	6.0	5.7
55°	5.7	5.7	5.7	5.3	5.0
57.5°	4.6	5.0	5.0	4.6	4.3
60°	3.9	3.9	4.3	3.9	3.6
62.5°	3.2	3.2	3.2	3.2	2.8
65°	2.1	2.1	2.5	2.1	1.8
67.5°	0.4	0.7	1.8	0.0	0.0
70°	0.0	0.0	0.4	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°    - - 45°-225°    - - - - 90°-270°







(END OF REPORT)